LAKEVIEW SUMMIT


PHASE ONE

NATHAN BUTLER SURVEY, ABSTRACT NO. 21 CITY OF ROCKWALL ROCKWALL COUNTY, TEXAS

34.839 ACRES

GENERAL NOTES (APPLICABLE TO ALL SHEETS)

- 1. Excavated material shall be placed as directed by the Owner.
- 2. Construction shall meet the requirements of the latest revision of the Standards of Design and Standard Details for the City of Rockwall.
- 3. All fill areas to be density controlled and compacted to 95% density at optimum moisture content.
- 4. Pavement thickness shall be a minimum of 6" thickness with a strength of 3600 psi at 28 days and reinforced with No.3 bar at 24" centers each way.
- 5. All streets shall be constructed with min. 6% lime stabilized subgrade compacted to 95% standard proctor density, lime series needs to be performed to verify.
- 6. It shall be the responsibility of the Contractor to locate and verify all existing utilities prior to the beginning of construction to insure no conflicts between all utility lines.
- 7. Where water pipelines either cross or otherwise come within 9 feet of a sanitary sewer pipeline, the sewer pipeline shall be with a minimum working pressure Class 150 psi.
- 8. All water lines installed to be PVC pipe Class 200 conforming to AWWA Standard C-900, fitting shall be mechanical or 0-ring.
- 9. All water lines are to be installed a minimum of 48" deep measured from top of pipe.
- 10. All storm inlets shall be cast-in-place.
- 11. Utility contractor shall use MEGALUGS when install the water line and double strap services when installing the services.
- 12. Water services shall be a minimum of 1" schedule 40 polyethelene pipe installed with two in-line nylon ball cutoff valves inside the meter box. Corporation cock shall be Muellar No. H-15000 w/ straight coupling nut or approved equal. Curb stops shall be Muellar No. H-15174 MK oriseal or approved equal.
- 13. All water lines shall be pressure tested and disinfected in accordance with
- 14. All gate valves shall be Muellar or approved equal and conform to AWWA C-500 specifications. All gate valves shall be iron body, bronze mounted, double disk, parallel seat, non-rising stem, internal wedging type.
- 15. All fire hydrants shall be located 2' to 6' behind curb line. All fire hydrants shall be Muellar or approved equal.

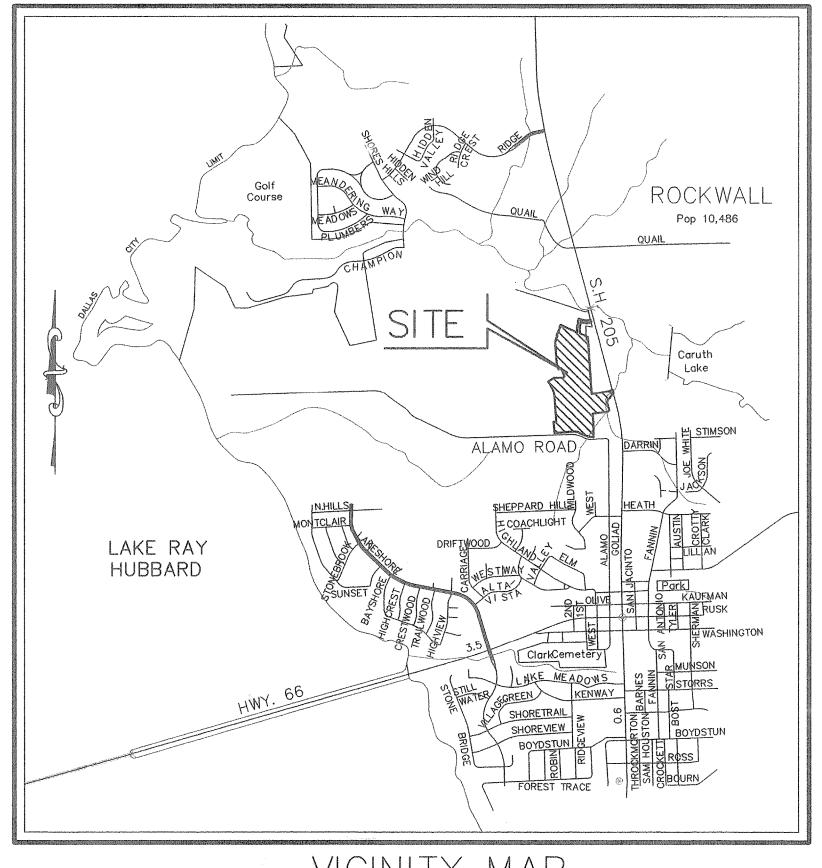

VICINITY MAP

SHEET INDEX

- 1. COVER SHEET 2. FILE PLAT
- 3. FILE PLAT
- 4. FILE PLAT
- 5. DRAINAGE AREA MAP
- 5A. DRAINAGE AREA MAP-PHASE ONE 6. GRADING PLAN-PHASE ONE
- 6A. GRADING PLAN-PHASE ONE
- 6B. GRADING PLAN-PHASE ONE
- 6C. RETAINING WALL PLAN
- 6D. RETAINING WALL PLAN 6E. TEMPORARY DITCH PROFILE
- 6F. TEMPORARY DITCH PROFILE
- 7. GRADING PLAN W/TREES-PRELIMINARY OFFSITE
- 8. GRADING PLAN W/TREES-PRELIMINARY OFFSITE
- 9. GRADING PLAN W/TREES-PRELIMINARY OFFSITE
- 10. TREE PLAN-PHASE ONE
- 11. PAVING PLAN & PROFILE-CALISTOGA STA 0+00 TO 11+00
- 12. PAVING PLAN & PROFILE-CALISTOGA 11+00 TO 22+39.66
- 13. PAVING PLAN & PROFILE-BERKELEY STA 7+67.07 TO 10+79.00
- 14. PAVING PLAN & PROFILE-FREMONT STA 4+49.33 TO 9+08.68 15. PAVING PLAN & PROFILE-SAUSALITO
- STA 14+85.84 TO 1944.01 16. PAVING PLAN & PROFILE-GEARY
- STA 19+27.36 TO 25+24.39 17. PAVING PLAN & PROFILE-MONTERREY
- STA 18+51.01 TO 24+30.77 18. PAVING PLAN & PROFILE-SALINAS
- STA 0+00 TO 6+93.31 19. PAVING PLAN & PROFILE—HAYWARD STA 0+00 TO 5+31.11
- 20.PAVING PLAN & PROFILE-LOS ALTOS STA 0+00 7+22.58
- 21. PAVING PLAN & PROFILE-N. ALAMO STA 18+00 TO 27+69.33
- 22.PAVING PLAN & PROFILE-ALLEY K STA 0+00 TO 6+51.94
- 23.PAVING PLAN & PROFILE-ALLEY L STA 0+00 TO 4+24.53 24.PAVING PLAN & PROFILE-ALLEY O
- STA 0+00 TO 6+21.24 25.PAVING PLAN & PROFILE-ALLEY N STA 0+00 TO 7+70.95

W.L. DOUPHRATE

THE SEAL APPEARING ON THIS

DOCUMENT WAS AUTHORIZED BY

W.L. DOUPHRATE II TEXAS, P.E.

NO. 60102 ON 7/10/00

- 26.PAVING PLAN & PROFILE-ALLEY X STA 8+90.30 TO 14+70.99
- 27.PAVING PLAN & PROFILE-JOGGING TRAIL
- 27A. S.H. 205 TURN LANES-NORTH 27B.S.H. 205 TURN LANES-SOUTH
- 28.WATER PLAN
- 29. SANITARY SEWER PLAN 30. SANITARY SEWER PROFILE
- LINES C. D & D-1 31. SANITARY SEWER PROFILE
- LINES E. F. G & H 32. SANITARY SEWER PROFILE
- LINE I 33.STORM PLAN & PROFILE
- LINE B 34.STORM PLAN & PROFILE
- LINES C & D 35.STORM PLAN & PROFILE
- 36.STORM PLAN & PROFILE
- LINES G.H & I 37.STORM PLAN & PROFILE LINE J
- 38.STORM PLAN & PROFILE LINE K & DETENTION POND

5

- 39.STORM PLAN & PROFILE LINE L
- 40.STORM PLAN & PROFILE LINES M & N
- 40A.STORM PLAN & PROFILE LINE O 40B.DETENTION POND CALCULATIONS
- 41. EROSION CONTROL PLAN 41A.LANDSCAPING PLANS
- 41B.LANDSCAPING PLANS 41C.LANDSCAPING PLANS
- 42.EROSION CONTROL DETAILS
- 43.DETAILS

RECORD DRAWINGS:

THE INTENT OF THE OWNER AND ENGINEER WAS TO CONSTRUCT THESE FACILITIES ACCORDING TO THESE PLANS AS APPROVED BY THE CITY OF Rockwall. THE LINES AND GRADES WERE SET ON THE GROUND FOR CONSTRUCTION ACCORDING TO SAID PLANS. THE CITY OF Rockwall INSPECTED THE CONSTRUCTION. THE OWNER NOR ENGINEER DID NOT VERIFY LINES OR GRADES AFTER CONSTRUCTION. WE ARE NOT AWARE OF ANY CHANGES OR REVISIONS TO THESE PLANS DURING CONSTRUCTION EXCEPT AS NOTED

CONTRACTOR TO VERIFY IN THE FIELD THE LOCATION OF ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION. INFORMATION PROVIDED WITHIN THESE PLANS DOES NOT RELIEVE THE CONTRACTOR OF THE FULL AND TOTAL RESPONSIBILITY FOR THE PROTECTION OF EXISTING UTILITIES NOR ANY DAMAGES CAUSED BY SAID CONTRACTOR DURING CONSTRUCTION.

FEBRUARY 2000

BENCHMARK:

BRASS CAP MONUMENT NO. 10 SET IN CONCRETE IN THE CENTER OF GRASS MEDIAN IN MASTERS DRIVE BETWEEN NORTH LAKESHORE & SHORES BLVD. N 7032464.6317, E 2589554.1518 ELEV. = 524.62

OWNER/DEVELOPER: PULTE HOMES OF TEXAS, L.P. 1431 GREENWAY DRIVE, SUITE 700 IRVING, TEXAS 75038

(972) 751-1499

