
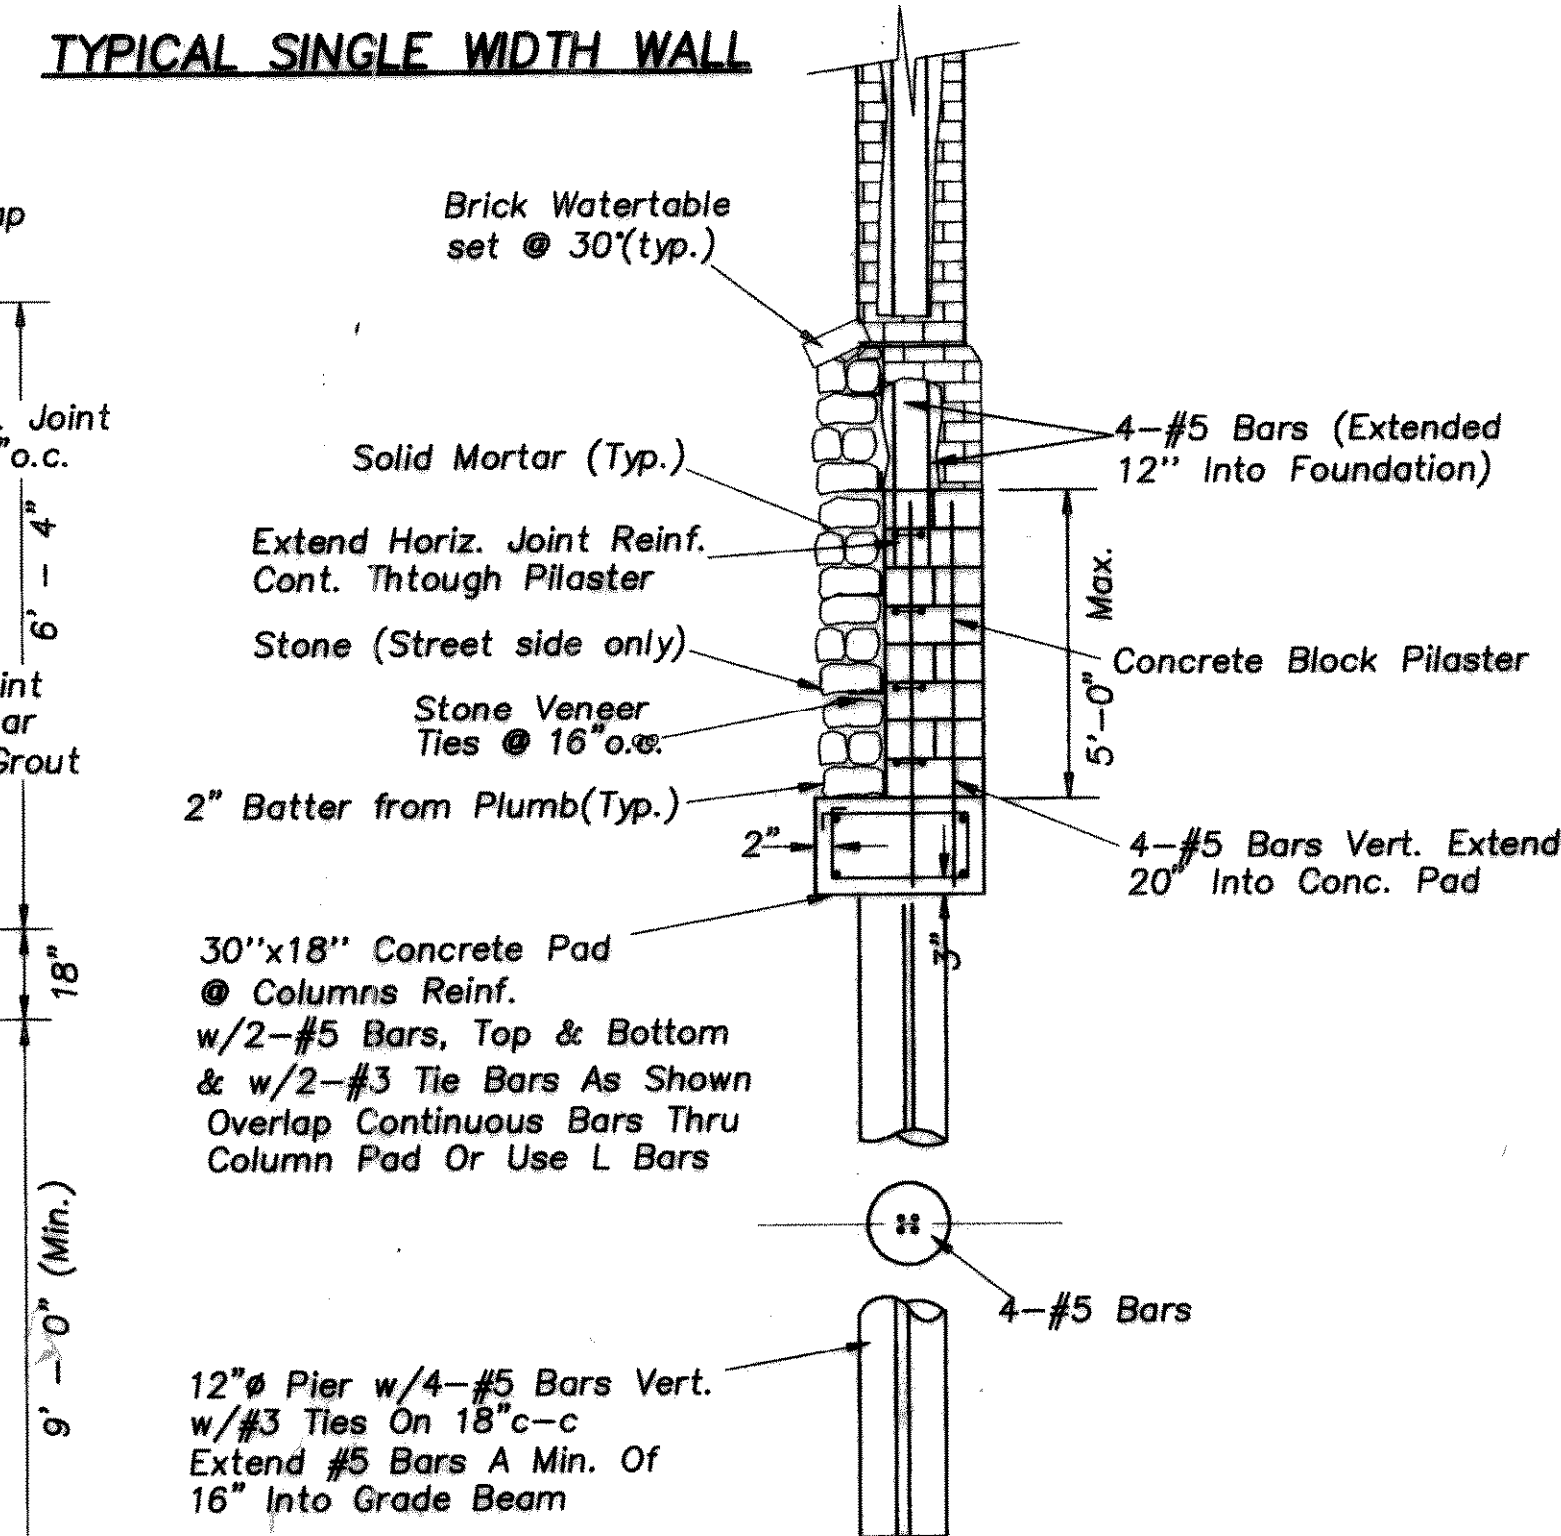
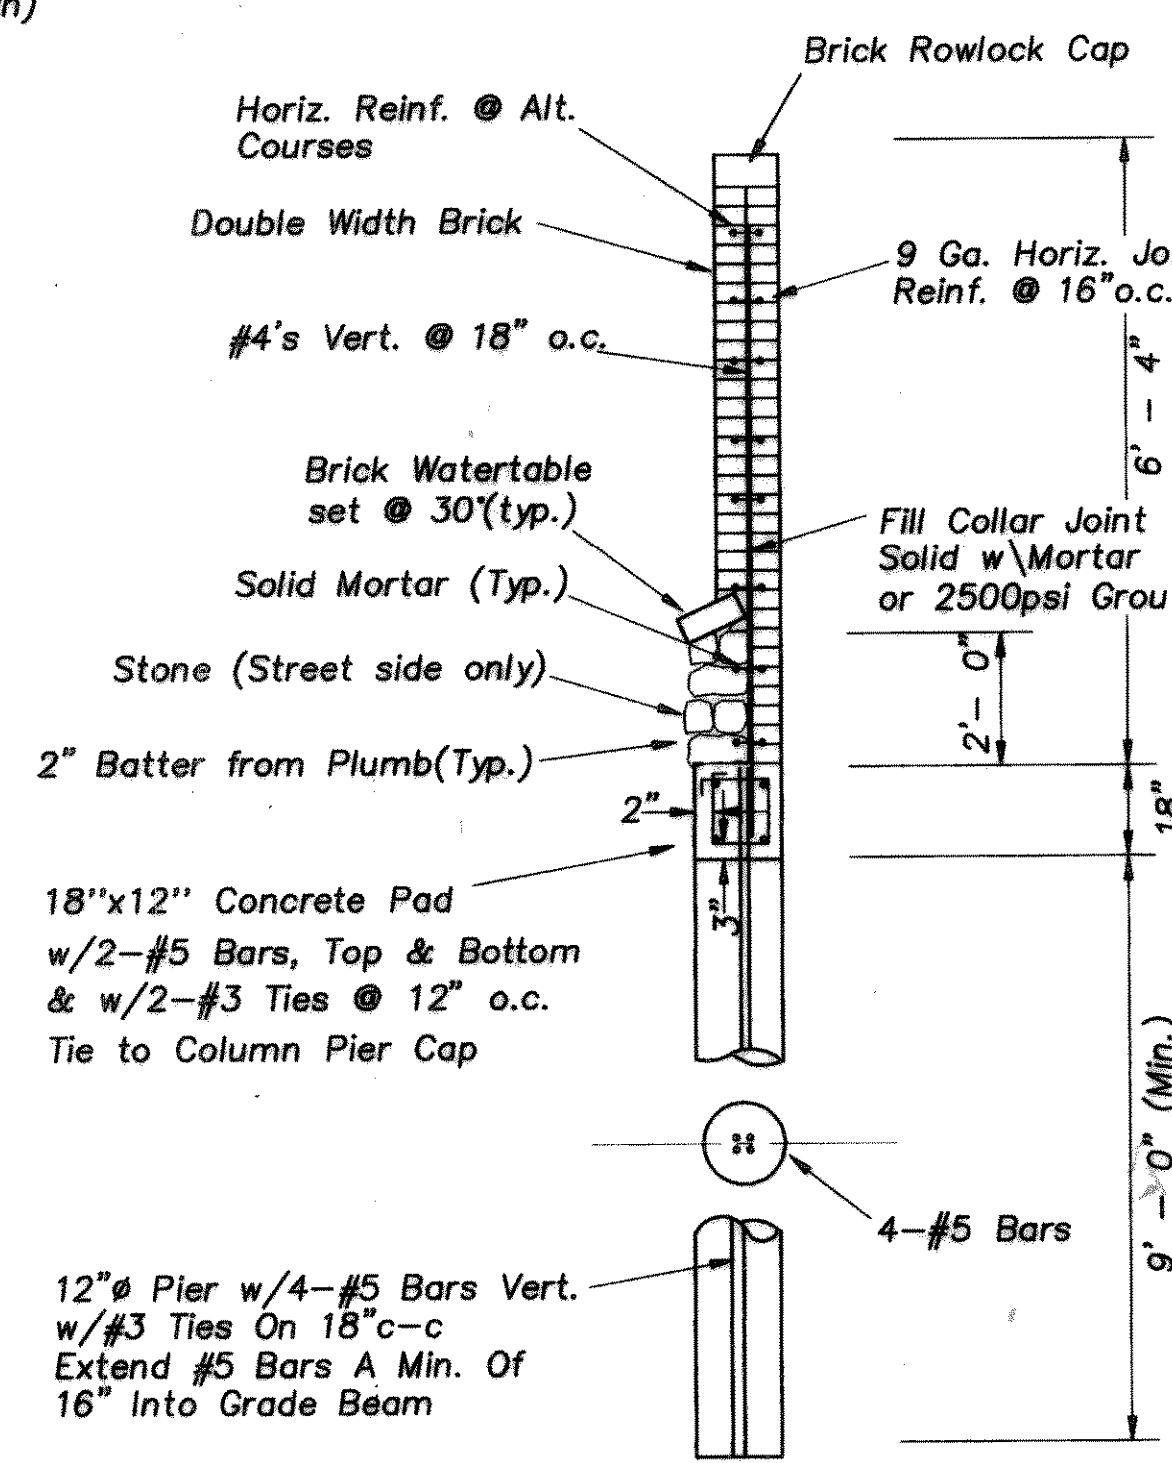
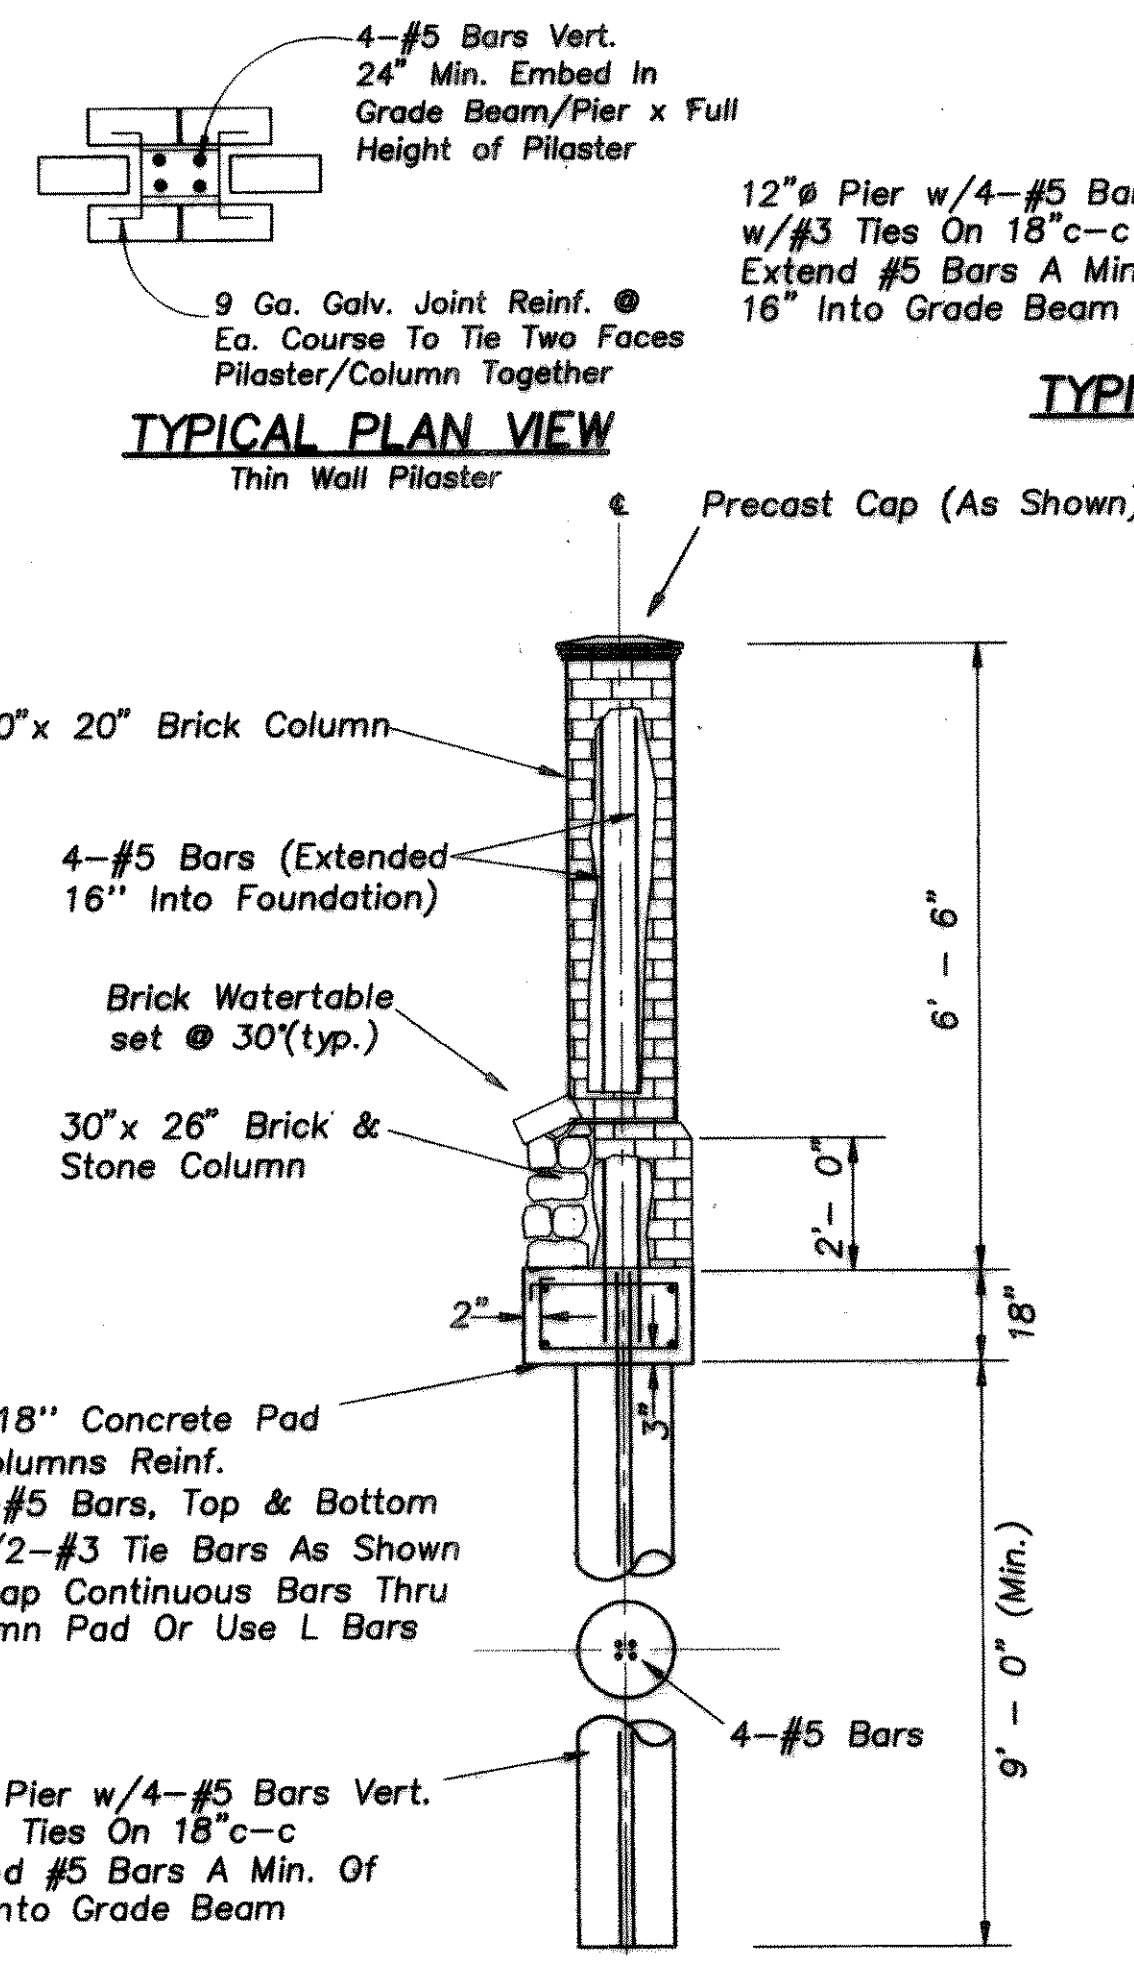
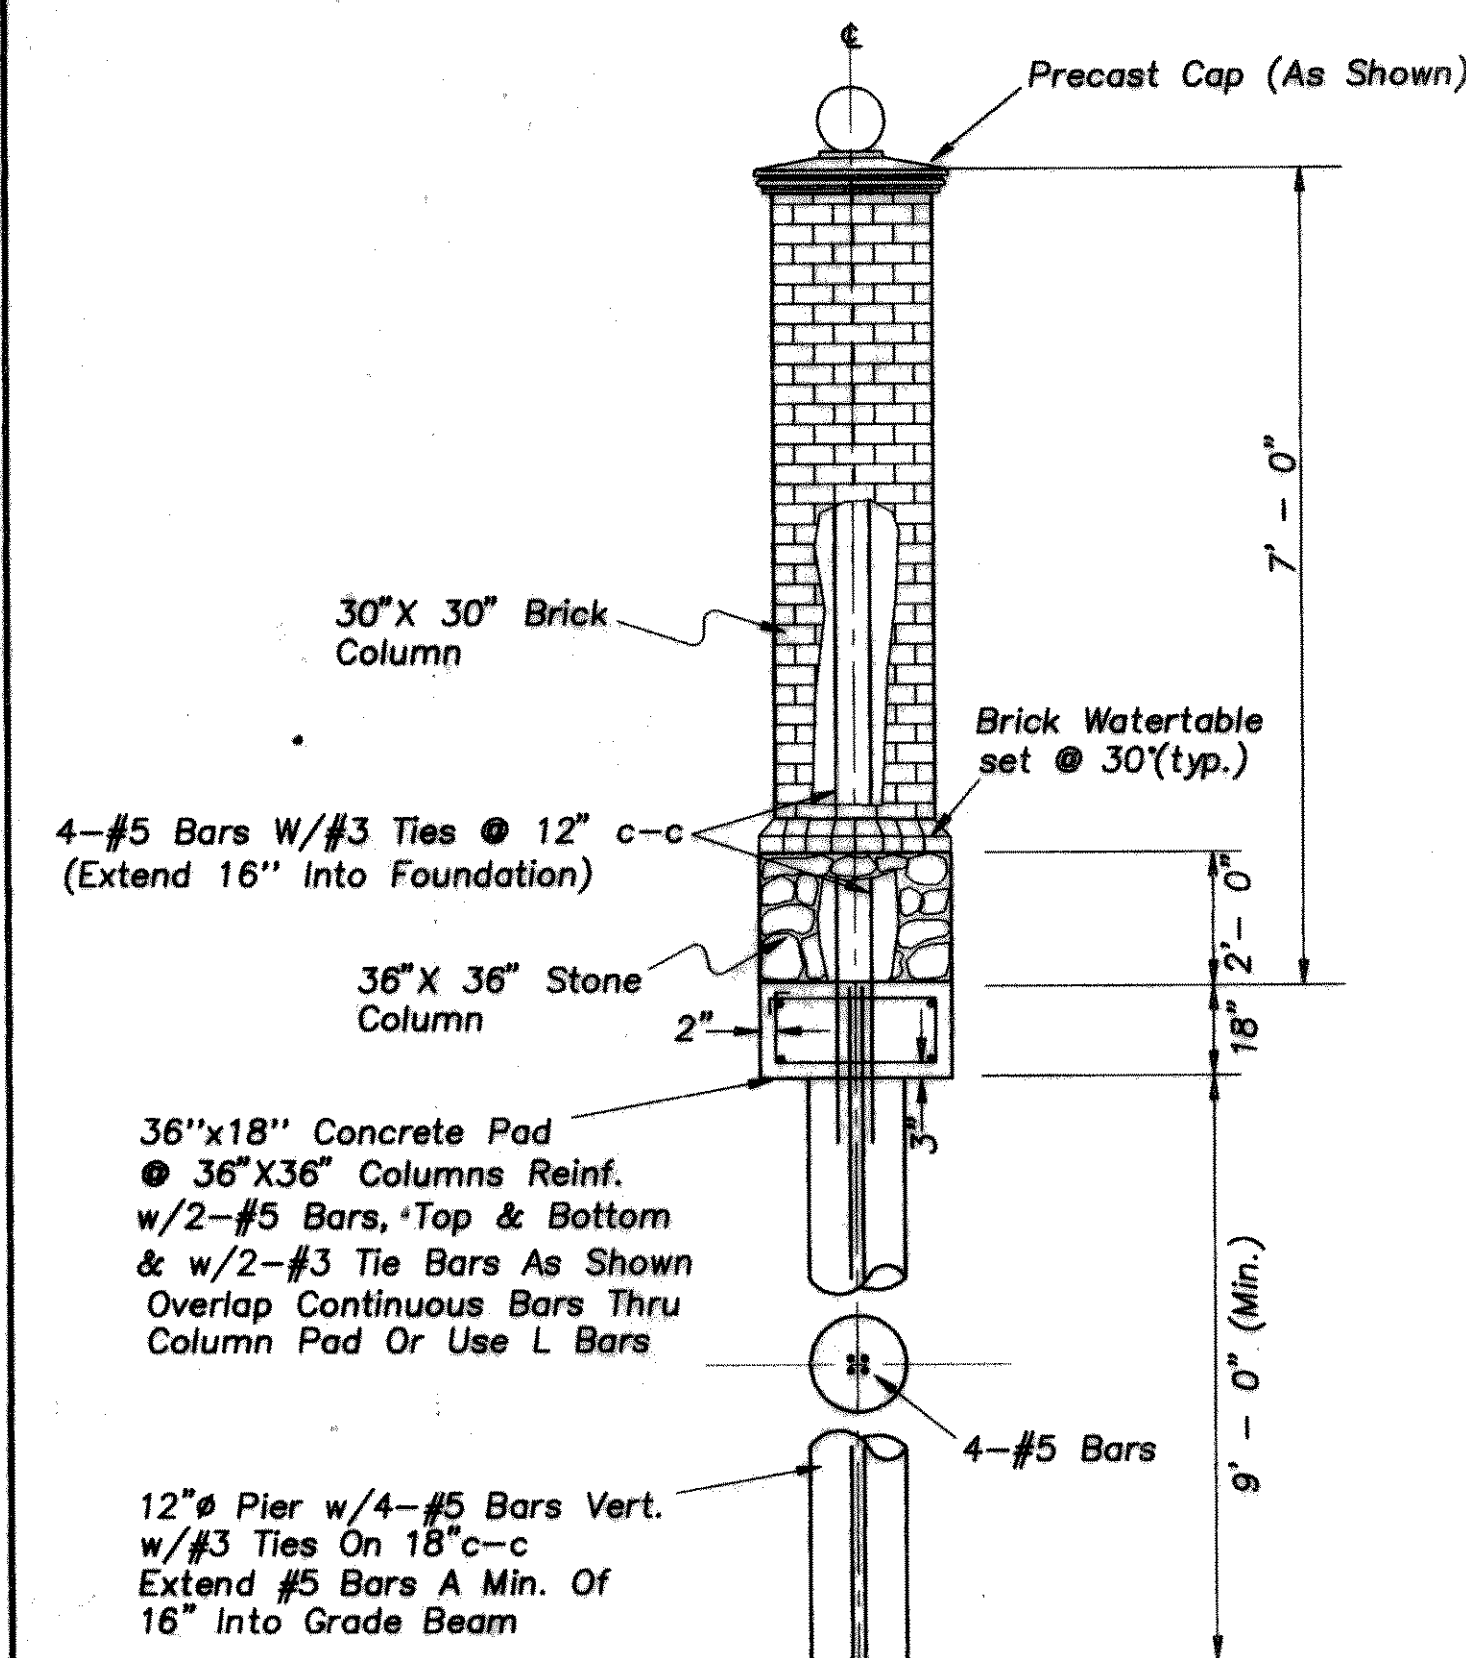
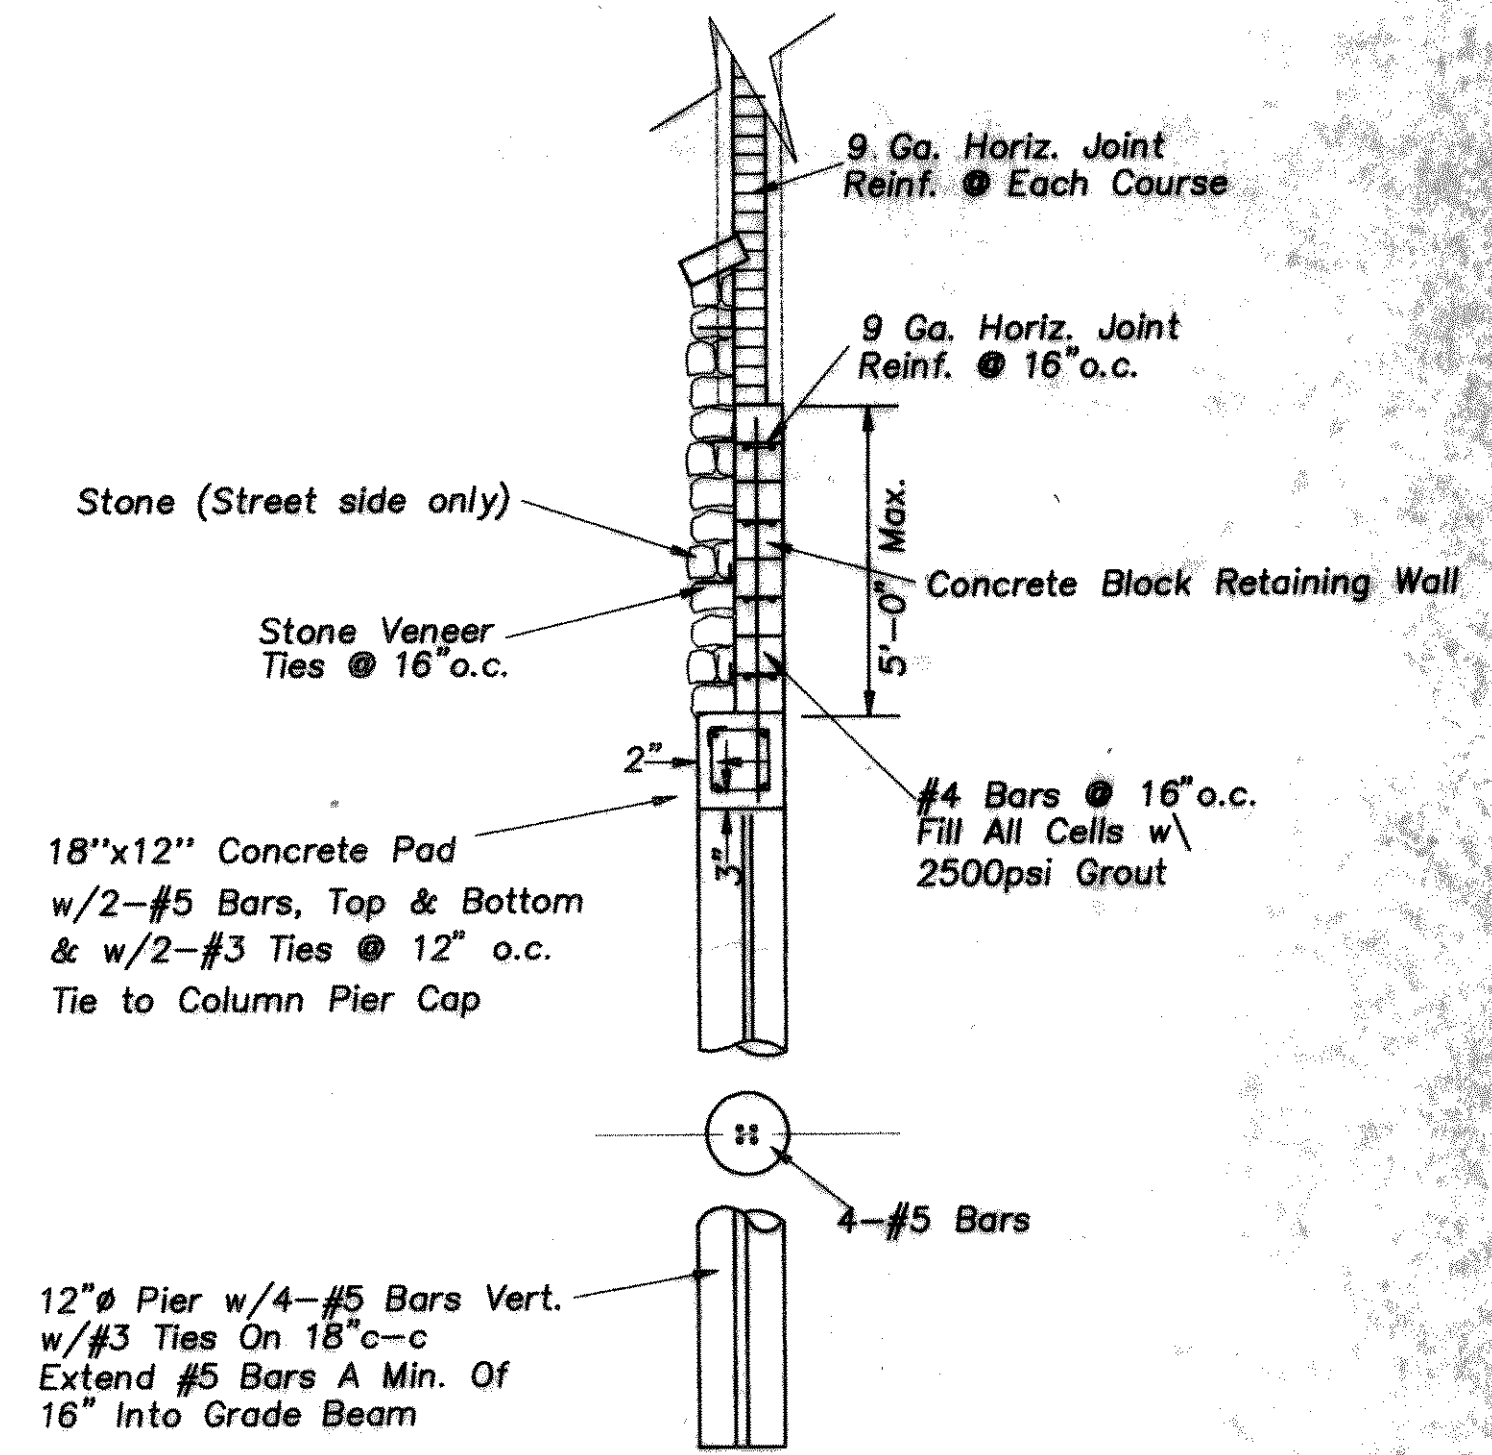
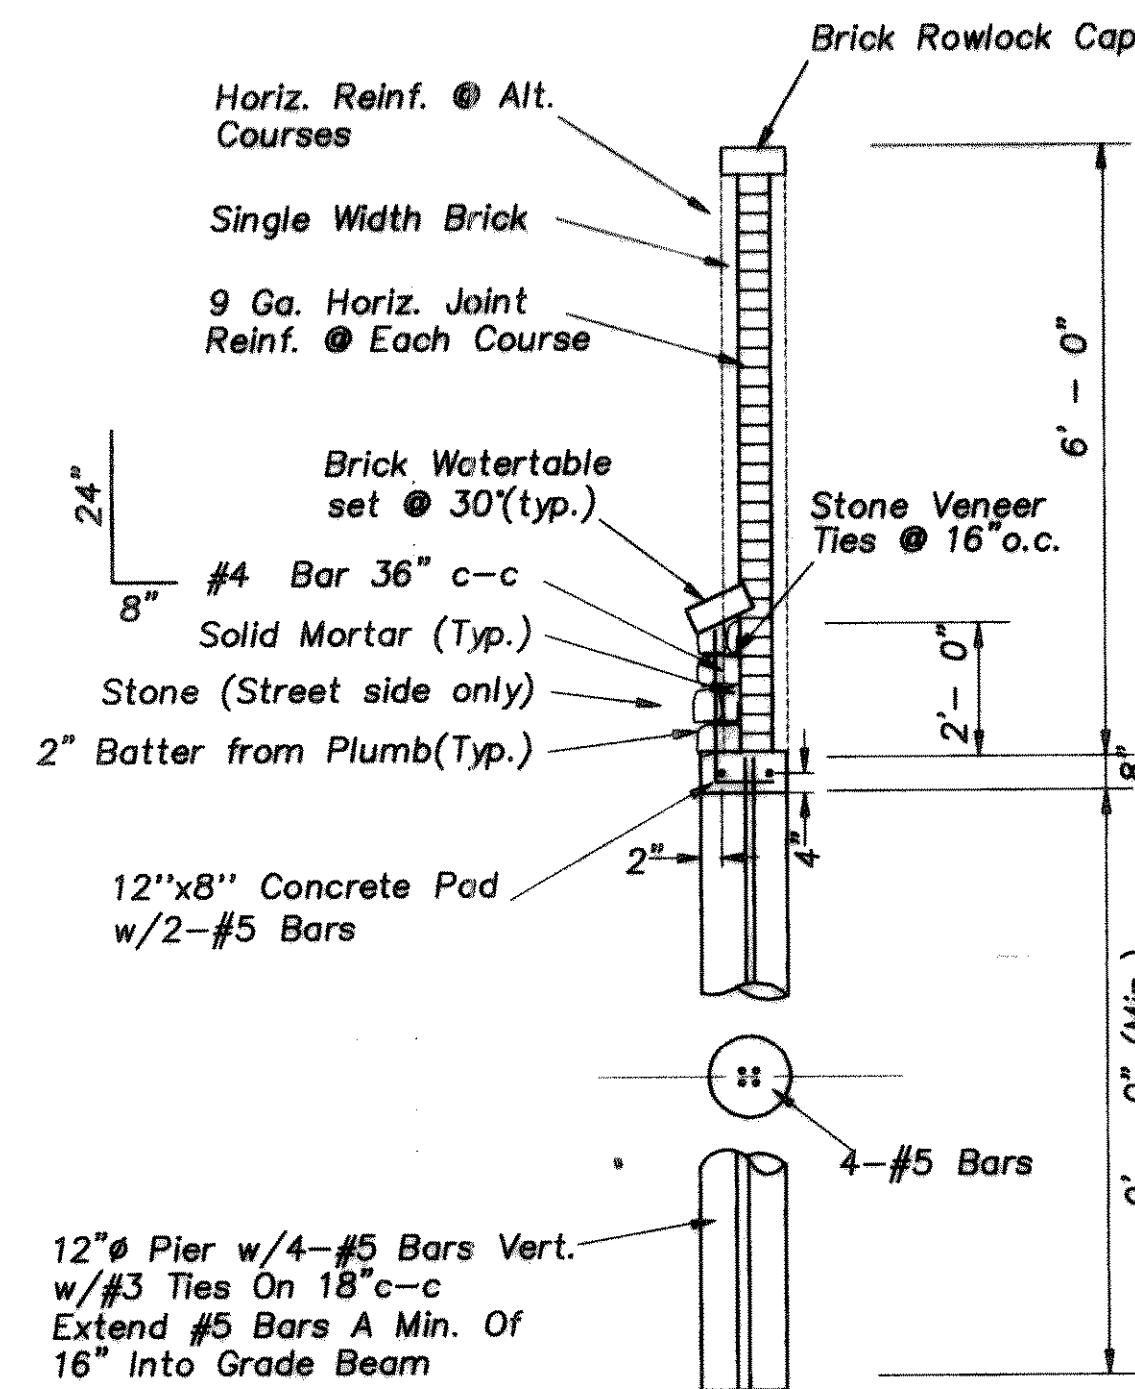
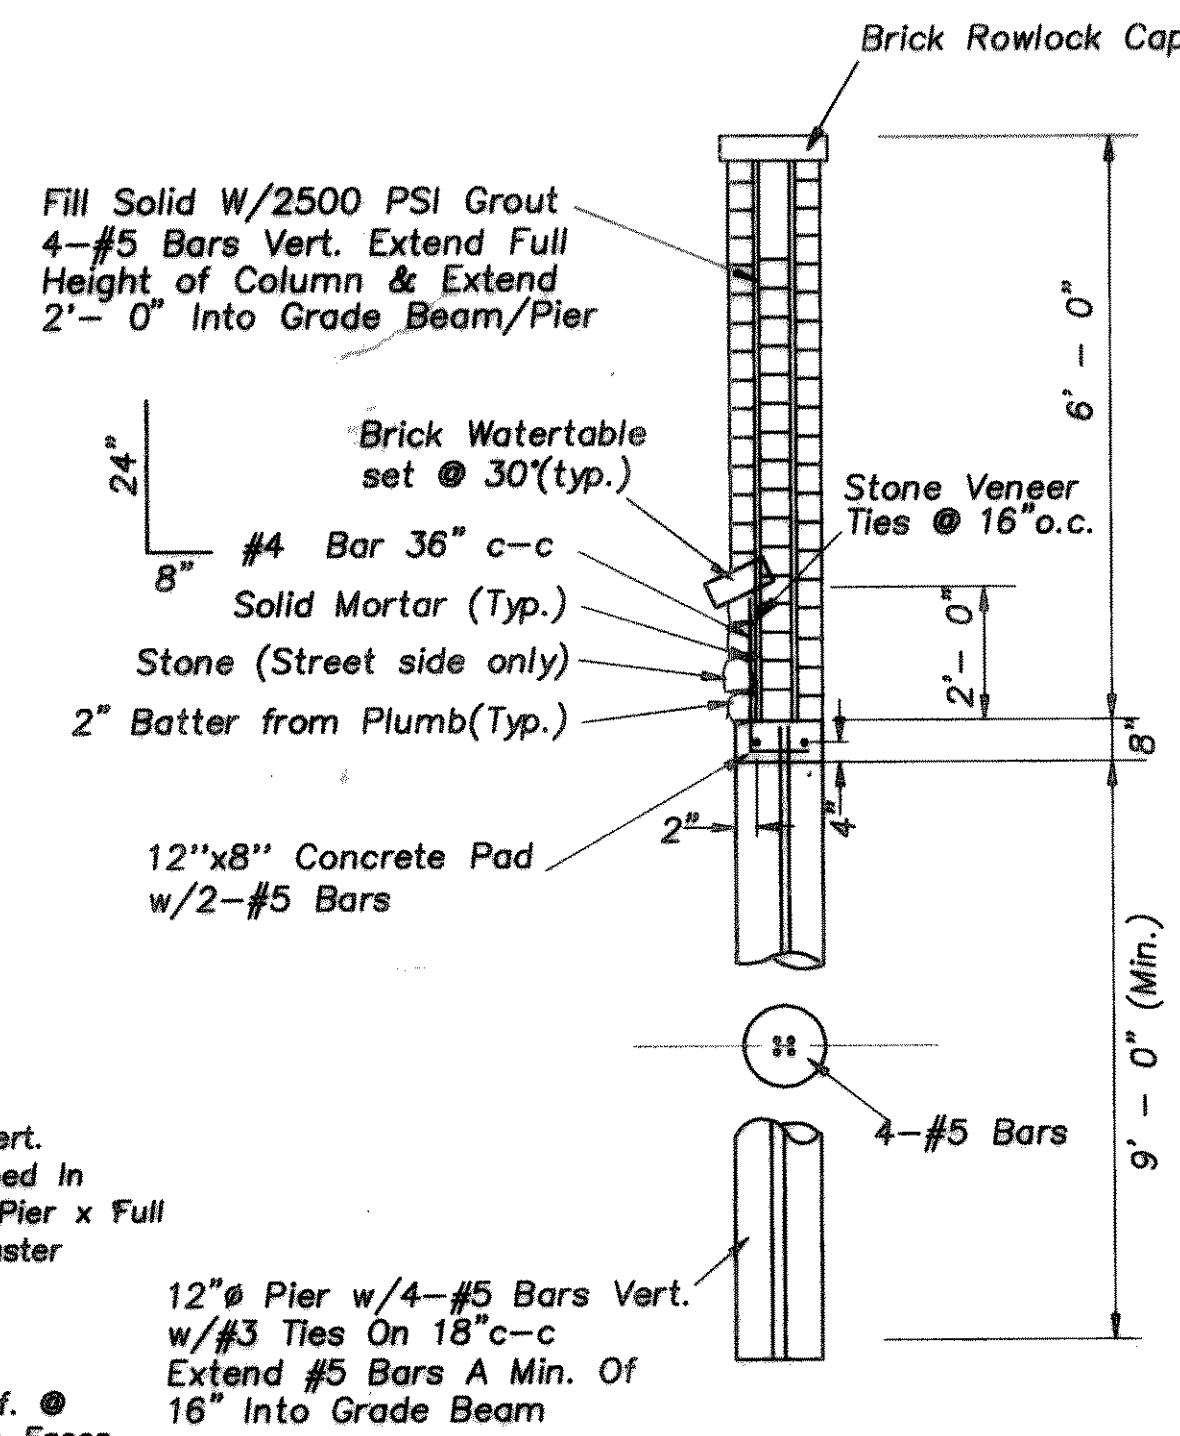
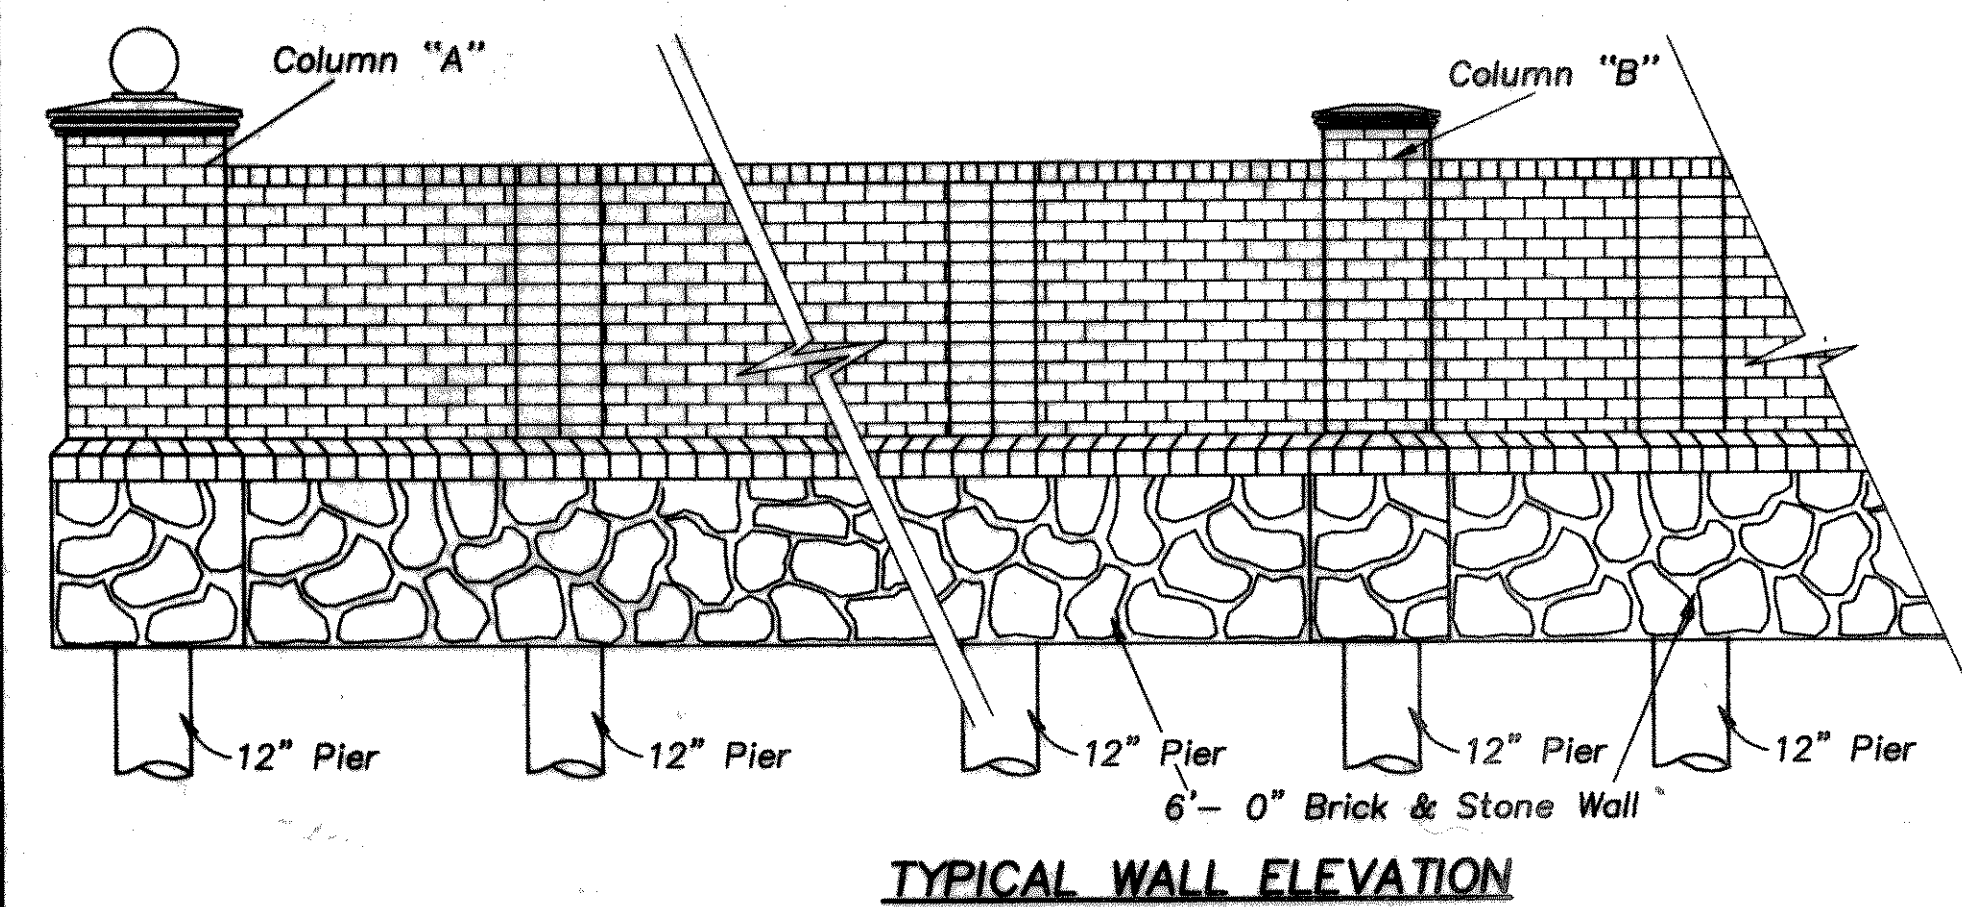
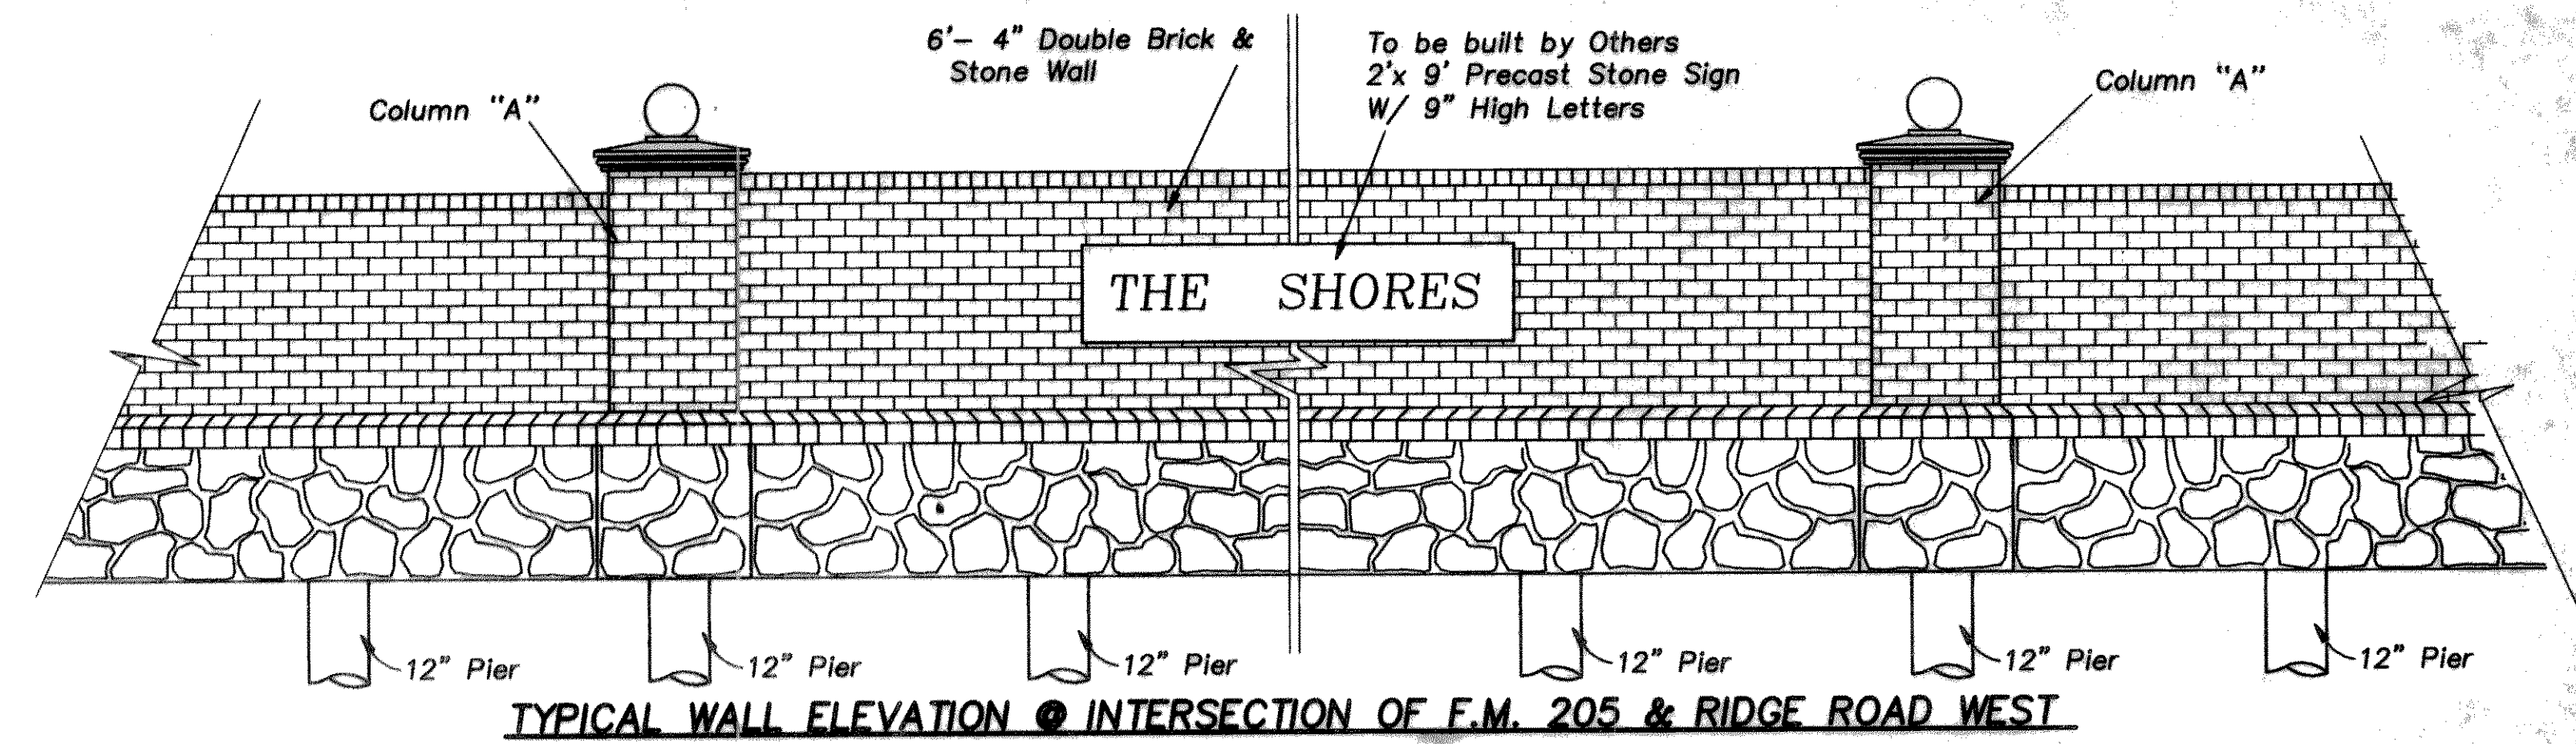


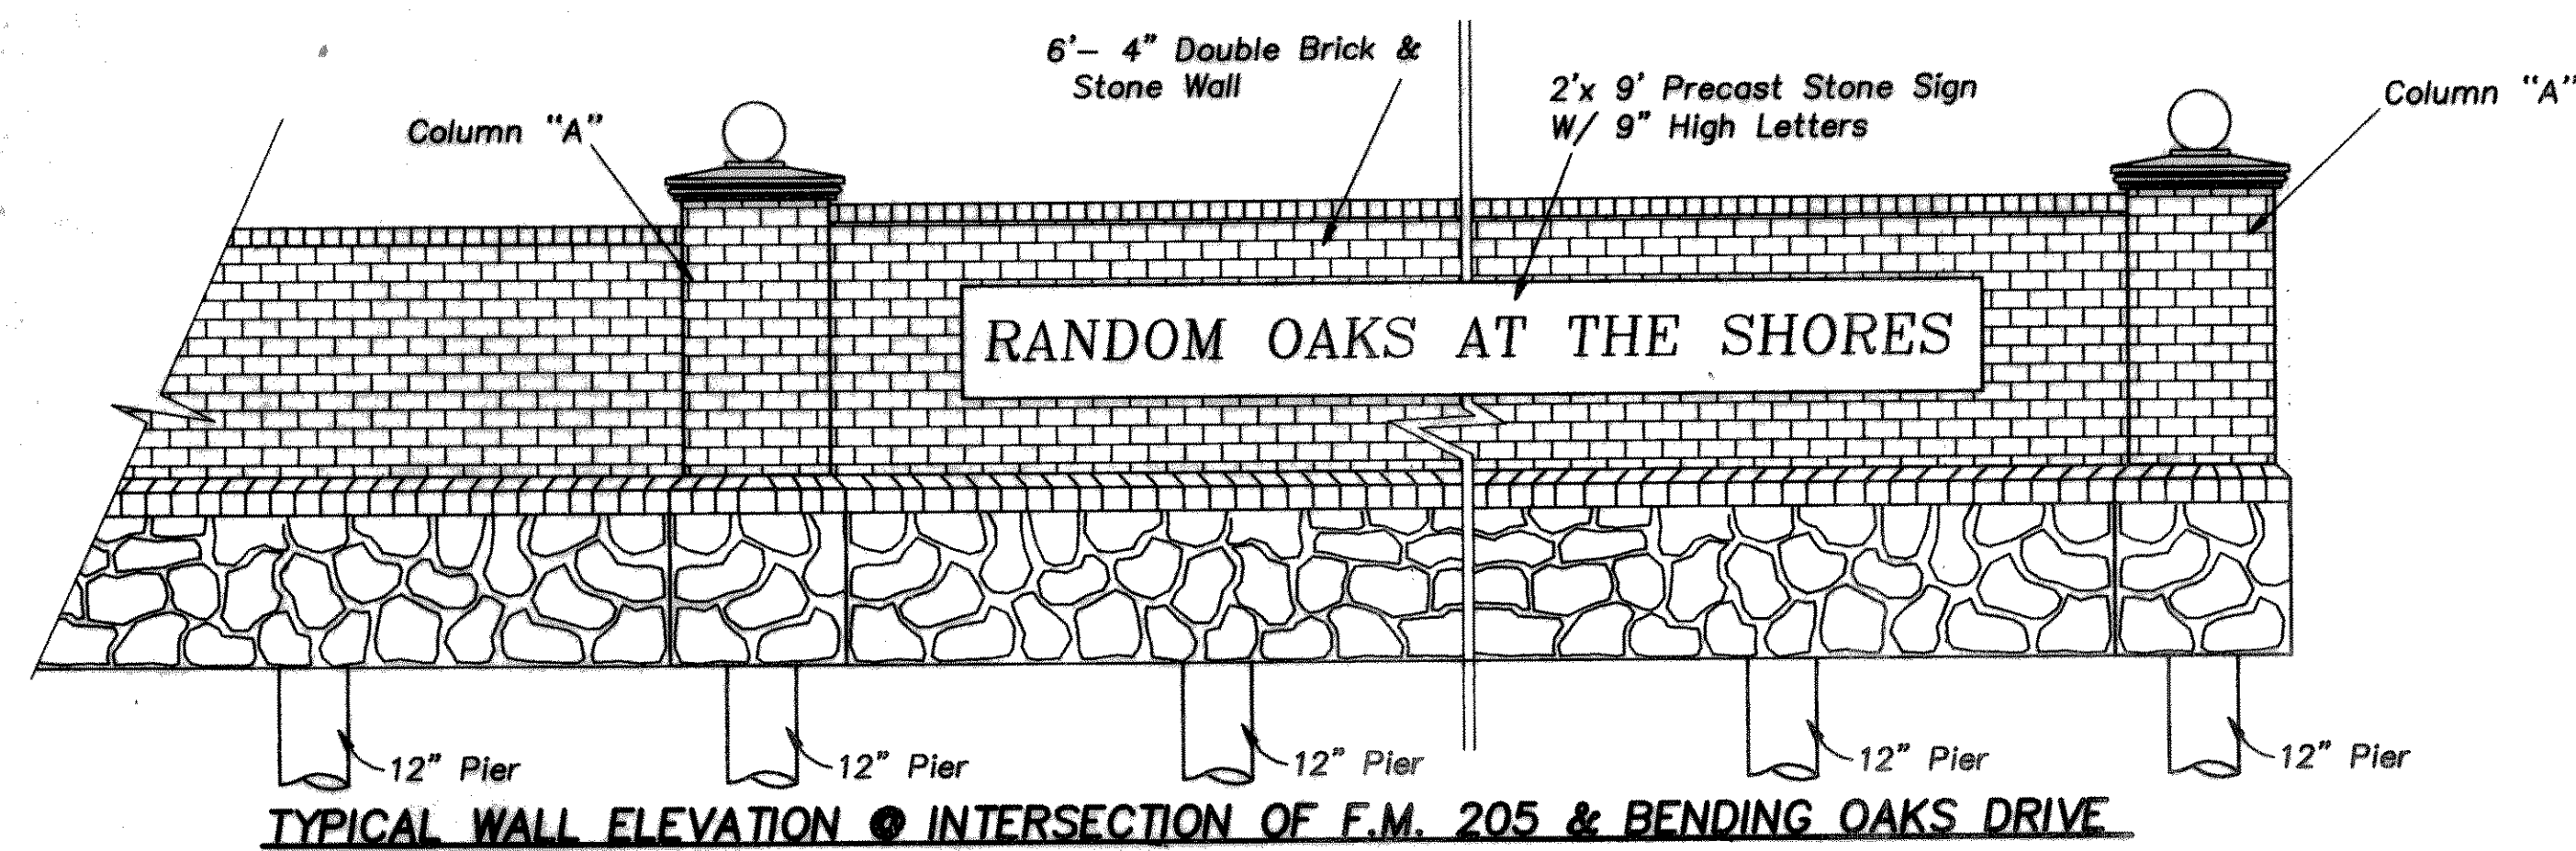

- 12" PIER NOTES:**
1. Concrete Comp. Strength - 4000 P.S.I.
 2. Reinforcement Steel- ASTM A615-GR 60
 3. Clean Bottom Of Hole Prior To Placement Of Concrete.
 4. Concrete Shall Be Placed Within 8 Hours Of Drilling.
 5. Design Wind Pressure 20 PSF

Piers to be placed @ Columns and/or 12' c-c. Max.

SCREENING WALL DETAILS						
RANDOM OAKS AT THE SHORES						
City Of Rockwall, Rockwall County, Texas						
TIPTON ENGINEERING, INC.						
6330 Belt Line Rd. ~ Suite C ~ Garland, Texas 75043						
DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
T.E. inc.	T.E. inc.	12/94	1" = 3'		#4032dp	3