



PLANNING AND ZONING CASE CHECKLIST

PLANNING AND ZONING DEPARTMENT
385 S. GOLIAD STREET
ROCKWALL, TX 75087

P&Z CASE # MIS2022-019 P&Z DATE 08/30/2022 CC DATE _____ Approved/Denied

ARCHITECTURAL REVIEW BOARD DATE _____ HPAB DATE _____ PARK BOARD DATE _____

Zoning Application

- Specific Use Permit
- Zoning Change
- PD Concept Plan
- PD Development Plan

Site Plan Application

- Site Plan
- Landscape Plan
- Treescape Plan
- Photometric Plan
- Building Elevations
- Material Samples
- Color Rendering

Platting Application

- Master Plat
- Preliminary Plat
- Final Plat
- Replat
- Administrative/Minor Plat
- Vacation Plat
- Landscape Plan
- Treescape Plan

HPAB Application

- Exhibit

Miscellaneous Application

- Variance/Exception Request

- Copy of Ordinance (ORD# _____)
- Applications
- Receipt
- Location Map
- HOA Map
- PON Map
- FLU Map
- Newspaper Public Notice
- 500-foot Buffer Public Notice
- Project Review
- Staff Report
- Correspondence
- Copy-all Plans Required
- Copy-Mark-Ups
- City Council Minutes – Laserfiche
- Minutes-Laserfiche
- Plat Filled Date _____
 - Cabinet # _____
 - Slide # _____

Notes: _____

Zoning Map Updated _____



DEVELOPMENT APPLICATION

City of Rockwall
Planning and Zoning Department
385 S. Goliad Street
Rockwall, Texas 75087

STAFF USE ONLY

PLANNING & ZONING CASE NO.

NOTE: THE APPLICATION IS NOT CONSIDERED ACCEPTED BY THE CITY UNTIL THE PLANNING DIRECTOR AND CITY ENGINEER HAVE SIGNED BELOW.

DIRECTOR OF PLANNING:

CITY ENGINEER:

PLEASE CHECK THE APPROPRIATE BOX BELOW TO INDICATE THE TYPE OF DEVELOPMENT REQUEST [SELECT ONLY ONE BOX]:

PLATTING APPLICATION FEES:

- MASTER PLAT (\$100.00 + \$15.00 ACRE) ¹
- PRELIMINARY PLAT (\$200.00 + \$15.00 ACRE) ¹
- FINAL PLAT (\$300.00 + \$20.00 ACRE) ¹
- REPLAT (\$300.00 + \$20.00 ACRE) ¹
- AMENDING OR MINOR PLAT (\$150.00)
- PLAT REINSTATEMENT REQUEST (\$100.00)

SITE PLAN APPLICATION FEES:

- SITE PLAN (\$250.00 + \$20.00 ACRE) ¹
- AMENDED SITE PLAN/ELEVATIONS/LANDSCAPING PLAN (\$100.00)

ZONING APPLICATION FEES:

- ZONING CHANGE (\$200.00 + \$15.00 ACRE) ¹
- SPECIFIC USE PERMIT (\$200.00 + \$15.00 ACRE) ^{1 & 2}
- PD DEVELOPMENT PLANS (\$200.00 + \$15.00 ACRE) ¹

OTHER APPLICATION FEES:

- TREE REMOVAL (\$75.00)
- VARIANCE REQUEST/SPECIAL EXCEPTIONS (\$100.00) ²

NOTES:

¹: IN DETERMINING THE FEE, PLEASE USE THE EXACT ACREAGE WHEN MULTIPLYING BY THE PER ACRE AMOUNT. FOR REQUESTS ON LESS THAN ONE ACRE, ROUND UP TO ONE (1) ACRE.
²: A \$1,000.00 FEE WILL BE ADDED TO THE APPLICATION FEE FOR ANY REQUEST THAT INVOLVES CONSTRUCTION WITHOUT OR NOT IN COMPLIANCE TO AN APPROVED BUILDING PERMIT.

PROPERTY INFORMATION [PLEASE PRINT]

ADDRESS 2727 S. John King Blvd, Rockwall, TX 75032

SUBDIVISION Rockwall Heath High School 9th Grade Center

LOT 1 BLOCK A

GENERAL LOCATION Rockwall 9th Grade Center - South site - at the Gene Burton Academy

ZONING, SITE PLAN AND PLATTING INFORMATION [PLEASE PRINT]

CURRENT ZONING AG CURRENT USE PUBLIC SCHOOL

PROPOSED ZONING NEIGHBORHOOD SERVICES PROPOSED USE PUBLIC SCHOOL

ACREAGE 27.446 LOTS [CURRENT] 1 LOTS [PROPOSED] 1

- SITE PLANS AND PLATS:** BY CHECKING THIS BOX YOU ACKNOWLEDGE THAT DUE TO THE PASSAGE OF HB3167 THE CITY NO LONGER HAS FLEXIBILITY WITH REGARD TO ITS APPROVAL PROCESS, AND FAILURE TO ADDRESS ANY OF STAFF'S COMMENTS BY THE DATE PROVIDED ON THE DEVELOPMENT CALENDAR WILL RESULT IN THE DENIAL OF YOUR CASE.

OWNER/APPLICANT/AGENT INFORMATION [PLEASE PRINT/CHECK THE PRIMARY CONTACT/ORIGINAL SIGNATURES ARE REQUIRED]

OWNER Rockwall Independent School District APPLICANT Glenn Engineering Corp.

CONTACT PERSON William Salee - Executive Director of Operations

CONTACT PERSON Robert Howman

ADDRESS 1191 T.L. Townsend Drive

ADDRESS 4500 Fuller Drive

Suite 220

CITY, STATE & ZIP Rockwall, Texas 75087

CITY, STATE & ZIP Irving, Texas 75038

PHONE 469-698-7031

PHONE 972-989-2174 cell

E-MAIL will.salee@rockwallisd.org

E-MAIL rahowman@glennengineering.com

NOTARY VERIFICATION [REQUIRED]

BEFORE ME, THE UNDERSIGNED AUTHORITY, ON THIS DAY PERSONALLY APPEARED Will Salee [OWNER] THE UNDERSIGNED, WHO STATED THE INFORMATION ON THIS APPLICATION TO BE TRUE AND CERTIFIED THE FOLLOWING:


I HEREBY CERTIFY THAT I AM THE OWNER FOR THE PURPOSE OF THIS APPLICATION; ALL INFORMATION SUBMITTED HEREIN IS TRUE AND CORRECT; AND THE APPLICATION FEE OF \$ 100.00 TO COVER THE COST OF THIS APPLICATION, HAS BEEN PAID TO THE CITY OF ROCKWALL ON THIS THE 19th DAY OF August, 2022. BY SIGNING THIS APPLICATION, I AGREE THAT THE CITY OF ROCKWALL (I.E. "CITY") IS AUTHORIZED AND PERMITTED TO PROVIDE INFORMATION CONTAINED WITHIN THIS APPLICATION TO THE PUBLIC. THE CITY IS ALSO AUTHORIZED AND PERMITTED TO REPRODUCE ANY COPYRIGHTED INFORMATION SUBMITTED IN CONJUNCTION WITH THIS APPLICATION, IF SUCH REPRODUCTION IS ASSOCIATED OR IN RESPONSE TO A REQUEST FOR PUBLIC INFORMATION."

GIVEN UNDER MY HAND AND SEAL OF OFFICE ON THIS THE 19th DAY OF August, 2022

OWNER'S SIGNATURE

NOTARY PUBLIC IN AND FOR THE STATE OF TEXAS

Will Salee
Diana Chapman

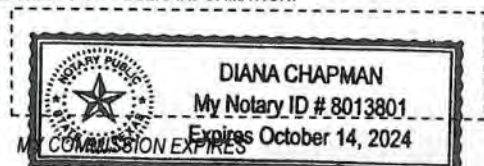



August 19, 2022

Ryan Miller
Director of Planning
City of Rockwall
385 South Goliad
Rockwall, TX 75087

**Rockwall ISD – Updated Site Plans for Ninth Grade Center Projects:
SP 2022-17 (FM1141& Quail Run) & SP2022-18 (John King Blvd at GBCCA)**

Mr. Miller,

Per recent site plan approval for the above referenced projects on July 12, 2022 by the Planning & Zoning Commission, there were the following conditional approval items noted by the city staff that are to be addressed related to landscape plan requirements and sports field/court lighting:

North Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing landscaping along the right-of-way of Panhandle Drive (i.e. berms and shrubbery with a minimum of one [1] canopy tree and one [1] accent tree per 50-feet of linear frontage). In addition, the Landscape Plan should show one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

South Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

Rockwall ISD is submitting updated landscape plans showing the number and location of proposed trees to include in regards to the detention areas. The North plan submitted with this letter includes the required landscaping along the Panhandle Drive right of way as required.

Landscape Plan – Detention Areas

Rockwall ISD is requesting a partial variance for consideration by the Planning & Zoning Commission. The space available around the perimeter of the detention pond is limited due to the required location on the site for these detention areas. At both sites, 3-tiered screening elements are adjacent to the detention areas limiting the amount of trees that can feasibly fit around and near the detention basin. Forcing trees in this area will create a scenario where tree canopy growth will inhibit any ground cover, reduce tree health, and increase the likelihood of erosion due to the lack of groundcover. All other required trees for the 3-tier screening and required parking lot trees are shown to be provided and we will be in compliance. As a result, the district is asking for the following variance:

Approval to disperse throughout the site as many of the required detention canopy and accent trees in open areas possible that are not reserved for future potential building expansions and in a manner that will not create a hazard, nuisance or erosion issue. Once those spaces are exhausted we propose to then omit the following numbers of trees per site:



North Site:

Number of Required Detention Trees: (155) Number of trees proposed to be planted: (101)
Omit (36) Canopy Trees & (18) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (162) Canopy Trees & (245) Accent Trees: (407) Total for Screening
- Required Trees at Parking Areas: (39) Canopy Trees

Total Number of Trees to be planted if variance is approved: (547) Total North Site Trees

South Site:

Number of Required Detention Trees: (198) Number of trees proposed to be planted: (132)
Omit (43) Canopy Trees & (23) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (234) Canopy Trees & (70) Accent Trees: (304) Total for Screening
- Required Trees at Parking Areas: (53) Canopy Trees

Total Number of Trees to be planted if variance is approved: (489) Total South Site Trees

In lieu of investing resources in dispersed trees that do not serve the purpose of beautifying the detention area and would have to be removed in the future, the district would like to direct those resources to beautifying and creating community accessible amenities for the detention areas in the following ways as an alternate compliance method for consideration:

1. Create a Wet Pond - In lieu of a dry detention basin, the district would propose to make these a constant level wet retention pond while still functioning to detain runoff as required.
 - a. The pond would include an aeration fountain element
 - b. The pond would include circulation plumbing to minimize algae growth
 - c. The pond will have an organic shape and have a flagstone border
 - d. The district would utilize HVAC condensate collection to fill the pond in hot, humid summer & spring seasons where pond evaporation is the greatest.
2. Create Park Amenities -The district would create a park area that is accessible to the community off the adjacent thoroughfare (John King – South & Quail Run Road – North) from the required 10-foot wide walk pathways at both locations.
 - a. Please refer the provided rendered images of park areas for proposed aesthetics
 - b. Park area will include 10' meandering pathways to pond overlook areas
 - c. Park area will include multiple park bench seating areas off of walkways
 - d. Park area will include landscape boulders within park area as an enhanced landscape feature to reinforce a more natural park setting.

This alternative method proposed to beautify the pond would transform an otherwise unattractive drainage area on both sites to a park amenity that can be utilized by both the school district and the community and will ensure resources expended provide permanent beautification elements to the site. Rockwall ISD requests acceptance of this variance and the alternate compliance method in lieu of planting the partial amount of trees requested to be omitted at each site.



Sports Field Lighting – Exception Request

Per the above referenced comment, Rockwall ISD is requesting the following exceptions to install sports field lighting as necessary for utilization by the campus when daylight levels are not adequate for practice and game events:

1. Tennis Court Lighting – 40' above tennis court surface
2. Baseball Field Lighting – 70' above baseball field surface
3. Football/Soccer Field Lighting – 80' above field surface

Sports field lighting product data and photometric data are included in this request for review. All parking lot lighting at both site locations will be 25' above adjacent parking surfaces and be in compliance. The need for this exception request is to ensure light levels are adequate for these sports fields/courts for playability and safety.

The following mitigation items are proposed to be implemented:

1. Implementation of 3-tier landscape screening as required by City of Rockwall.
2. Intentional site location of fields on the property to minimize adjacency to the densest residential areas as possible as discussed in previous P&Z meetings.
3. Use of current LED sports field technology that allows LED lamps to be screened and focused on the play fields with minimal light spread beyond the field area.
4. Sports field/court lighting will be controlled by the district's energy management system. This will require users to make reservations to turn lights on and create the ability to have lockout times when lights cannot be used and the ability to turn off the fixtures remotely if required.

Rockwall ISD requests acceptance of the requested light pole height exceptions as proposed to ensure adequate playability of and safety of the field use.

I look forward to attending the Planning & Zoning Commission in person on August 30th to provide a presentation and address any questions the commission may have in regards to the districts proposed requests.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Will Salee', is written over a light blue horizontal line.

Will Salee
Executive Director of Operations

N89°00'23"E
34.15'
(DEED CALL
N89°49'51"E
36.45')

N88°21'21" E 3926.93'

PART OF 58
N.L. L6
VOL. 38,

L6



L2

L3

L5

L4

SITE DATA SUMMARY	
EXISTING ZONING	AG
PROPOSED ZONING	PD FOR NS USES (2002-015)
USE	PUBLIC SCHOOL
LOT AREA	3,464,762 S.F. OR 75.54 AC.
BUILDING AREA (FLOOR AREA)	
PROPOSED FIRST FLOOR	150,170 S.F.
PROPOSED SECOND FLOOR	41,019 S.F.
TOTAL BUILDING AREA	191,189 S.F.
TOTAL FLOOR AREA (FIRST FLOOR)	150,170 S.F.
LOT COVERAGE	150,170 S.F./3,464,762 S.F. = 4.33%
FLOOR AREA RATE	0.051
TOTAL IMPERVIOUS AREA	813,028.31 S.F. OR 18.66 AC.
BUILDING HEIGHT	137'-10" (2 STORY)
TOTAL REQUIRED PARKING (1 PER 5 STUDENTS)	203 SPACES
PARKING PROVIDED	
PARKING SURFACE	
9.0x18.0'	304 SPACES
9.0x20.0'	209 SPACES
15.0x30.0'	19 SPACES
TOTAL PARKING PROVIDED	532 SPACES

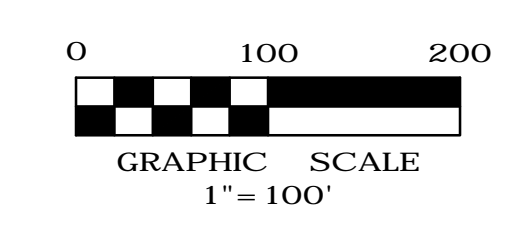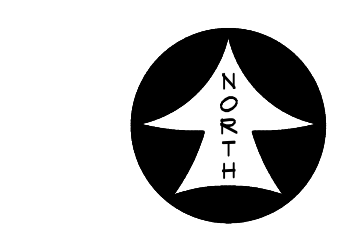

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMUO

CITY OF ROCKWALL CASE NO. SP2022-018

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS
RELEASED FOR PERMIT
REVIEW UNDER THE
AUTHORITY OF:
MICHAEL RAMSEY
REGISTERED LANDSCAPE
ARCHITECT #1901
IT IS NOT TO BE USED
FOR CONSTRUCTION
PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, L.L.C.
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET


NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

**OVERALL
LANDSCAPE PLAN**


JOB 21572.0000
DATE 08/16/22
SHEET

L 1

MATCHLINE SEE SHEET L2

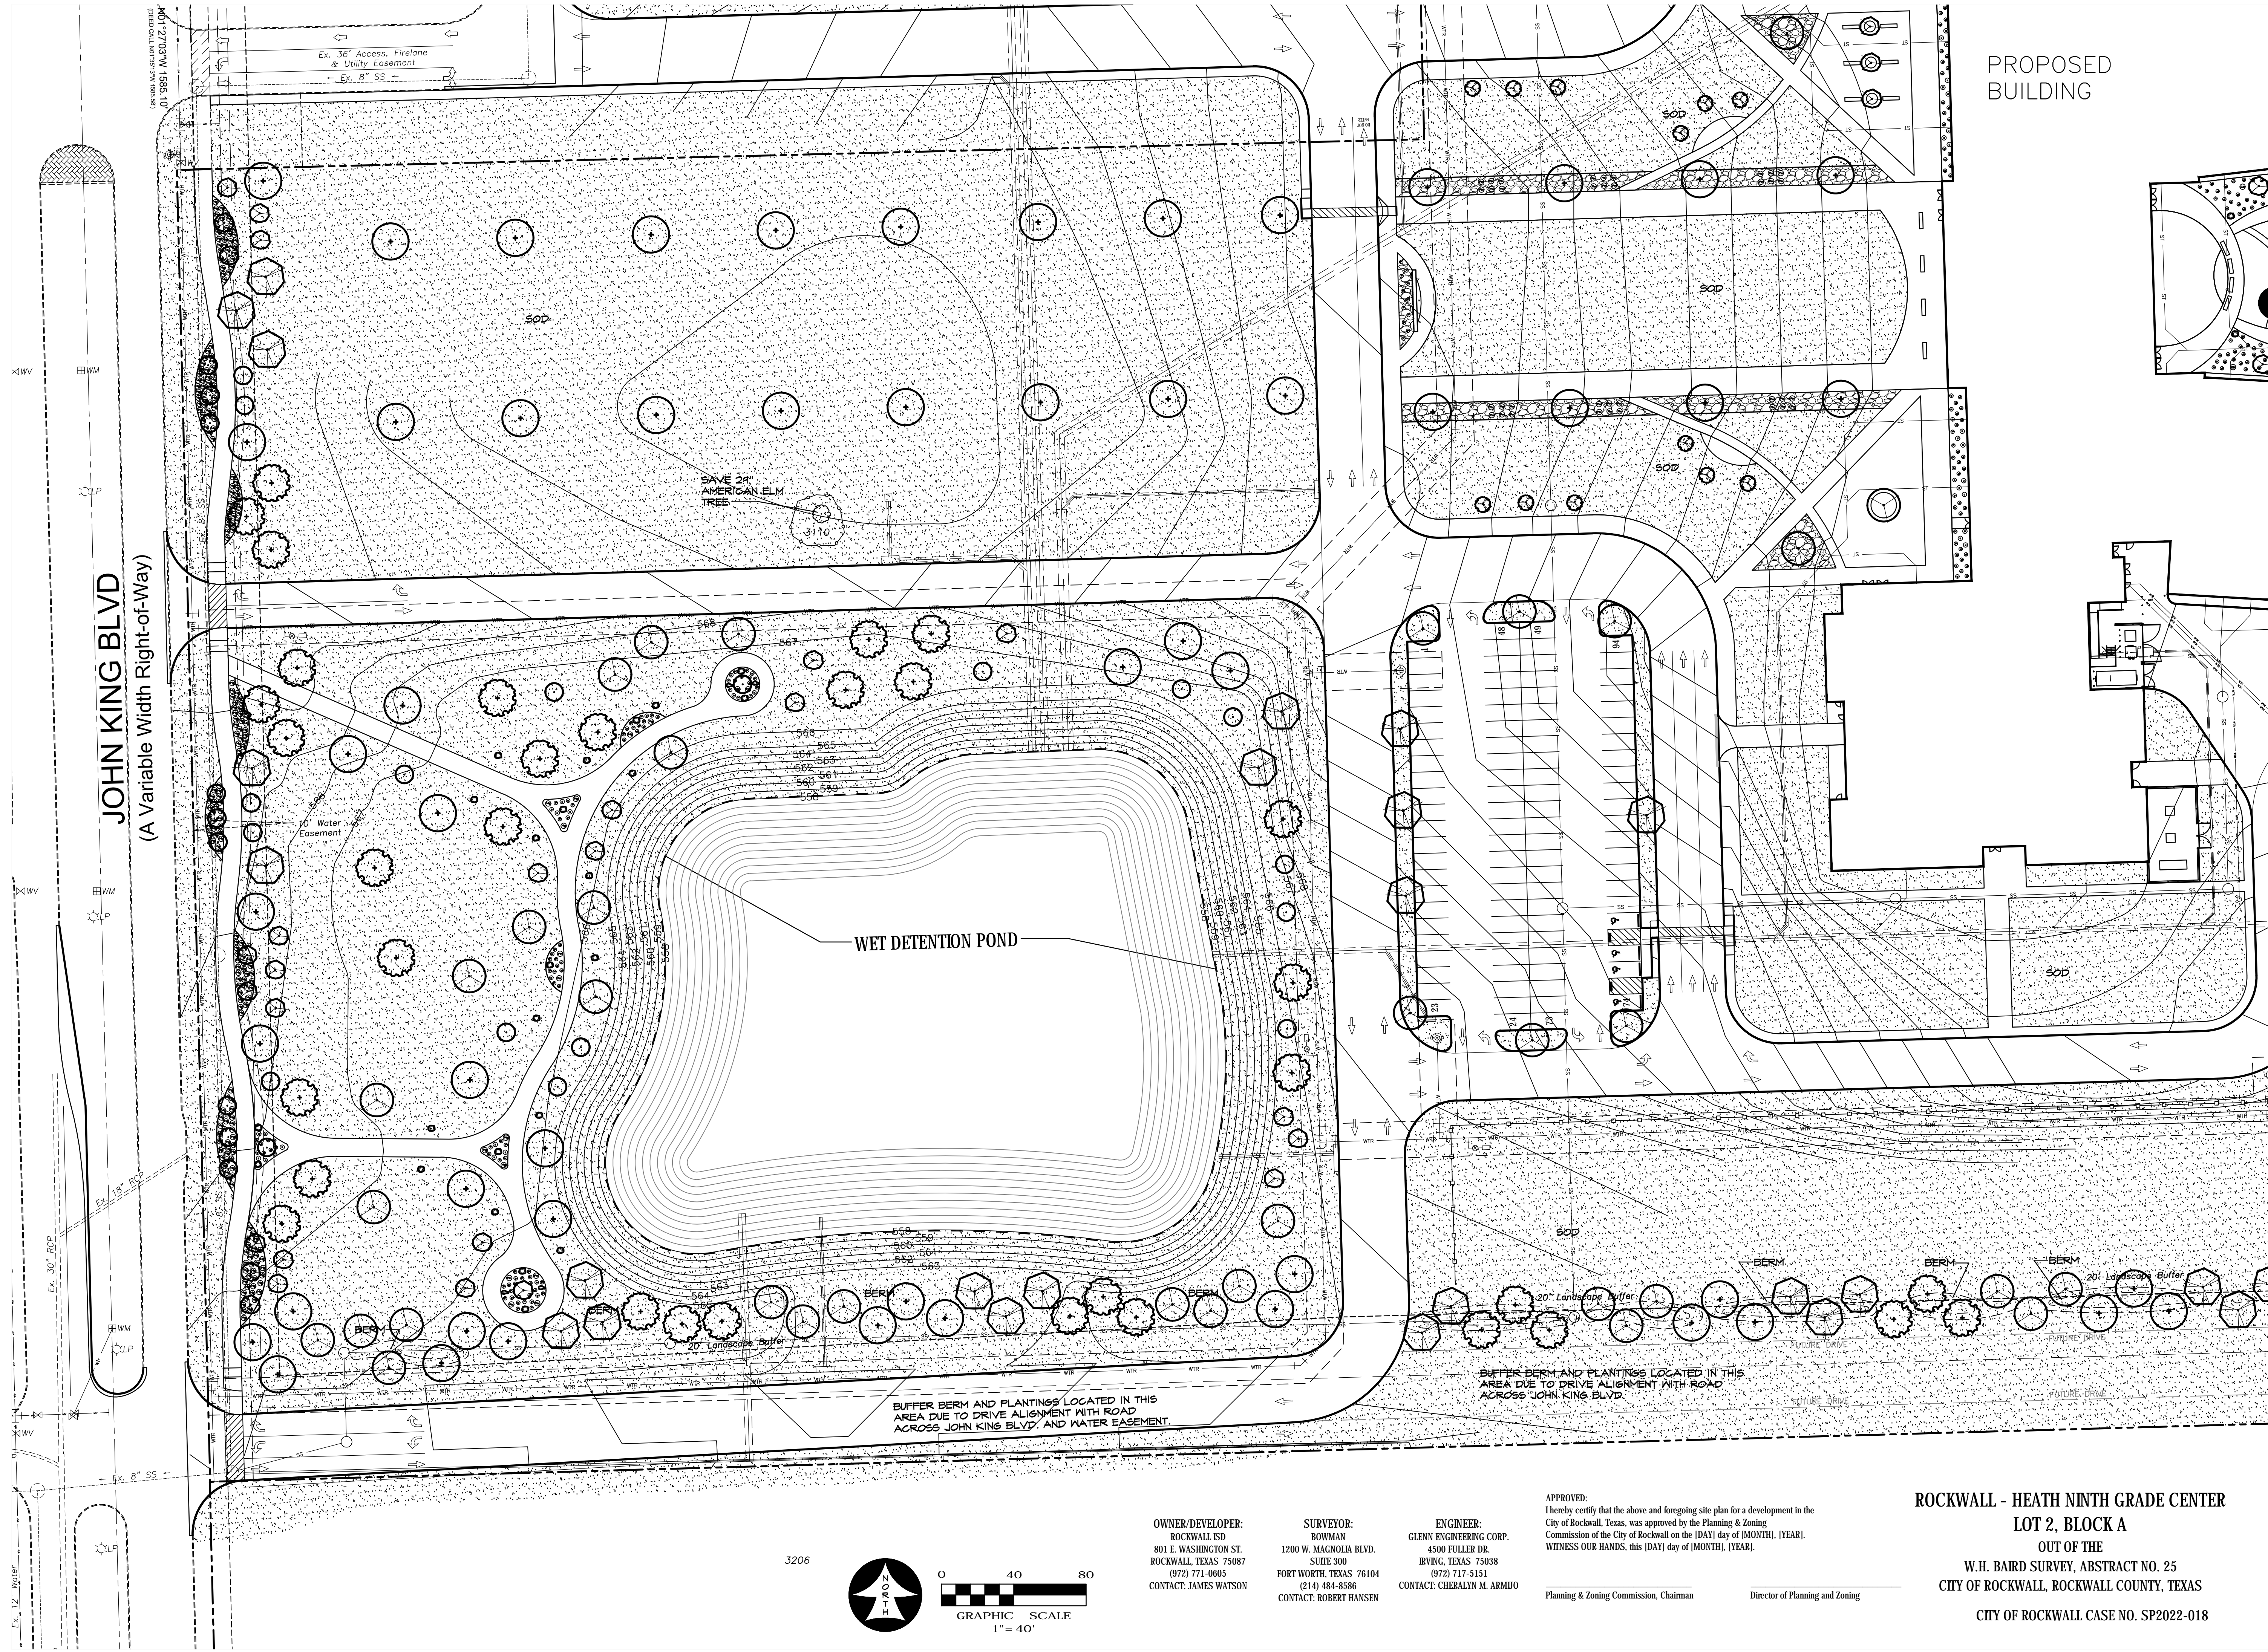

PROPOSED BUILDING

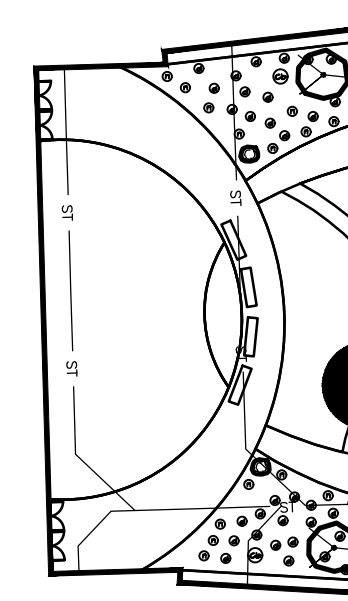

MATCHLINE SEE SHEET L4

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

LANDSCAPE PLAN
AREA B

JOB 21572.0000
DATE 08/16/22
SHEET

L 3

JOHN KING BLVD
(A Variable Width Right-of-Way)

WET DETENTION POND

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD. AND WATER EASEMENT.

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD.

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO



APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR]. WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].


Planning & Zoning Commission, Chairman

Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

3206

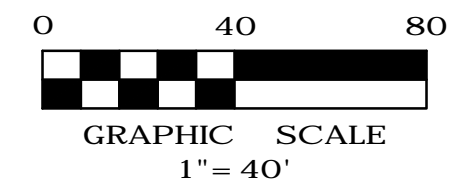

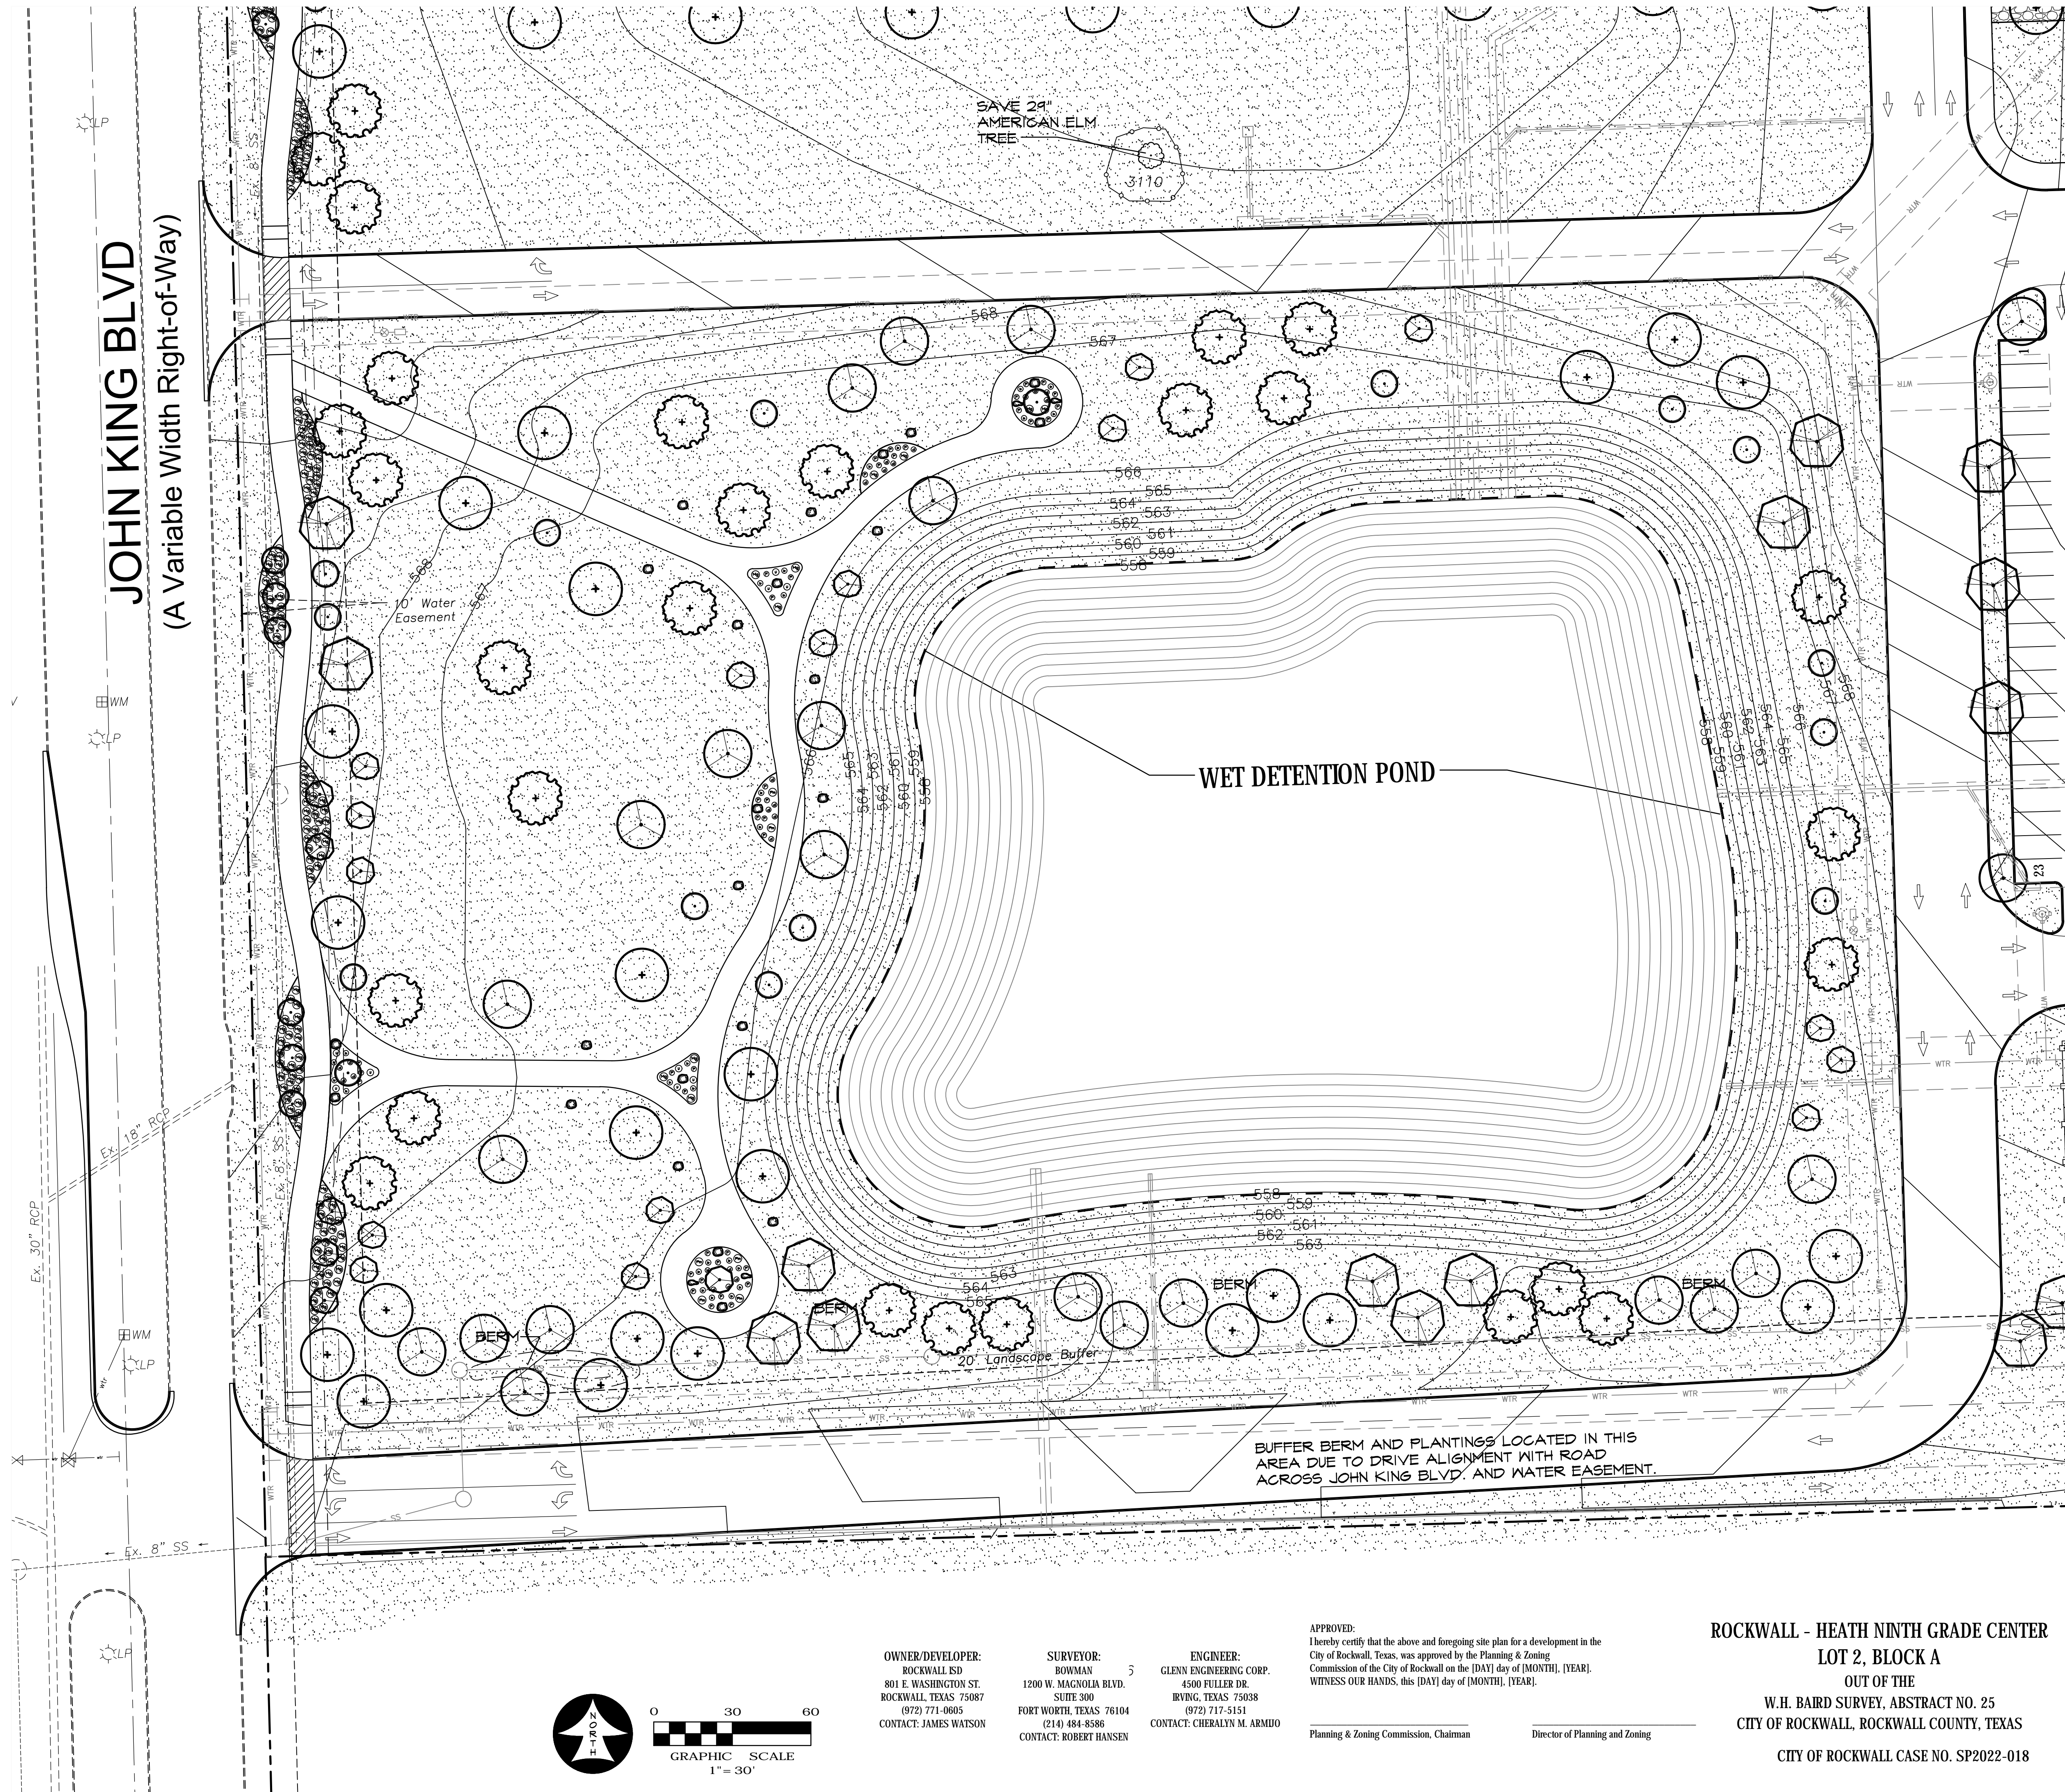

CORGAN ■

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES	
1	05/11/22 30% PROGRESS SET
2	07/06/22 60% PROGRESS SET
3	08/04/22 90% PROGRESS SET
4	08/16/22 95% PROGRESS SET
5	
6	

REVISIONS	

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S.John King Blvd, Rockwall, TX 75032

DETENTION ENLARGEMENT

JOB 21572.0000
DATE 08/16/22
SHEET

L 3B

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON


SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman
Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

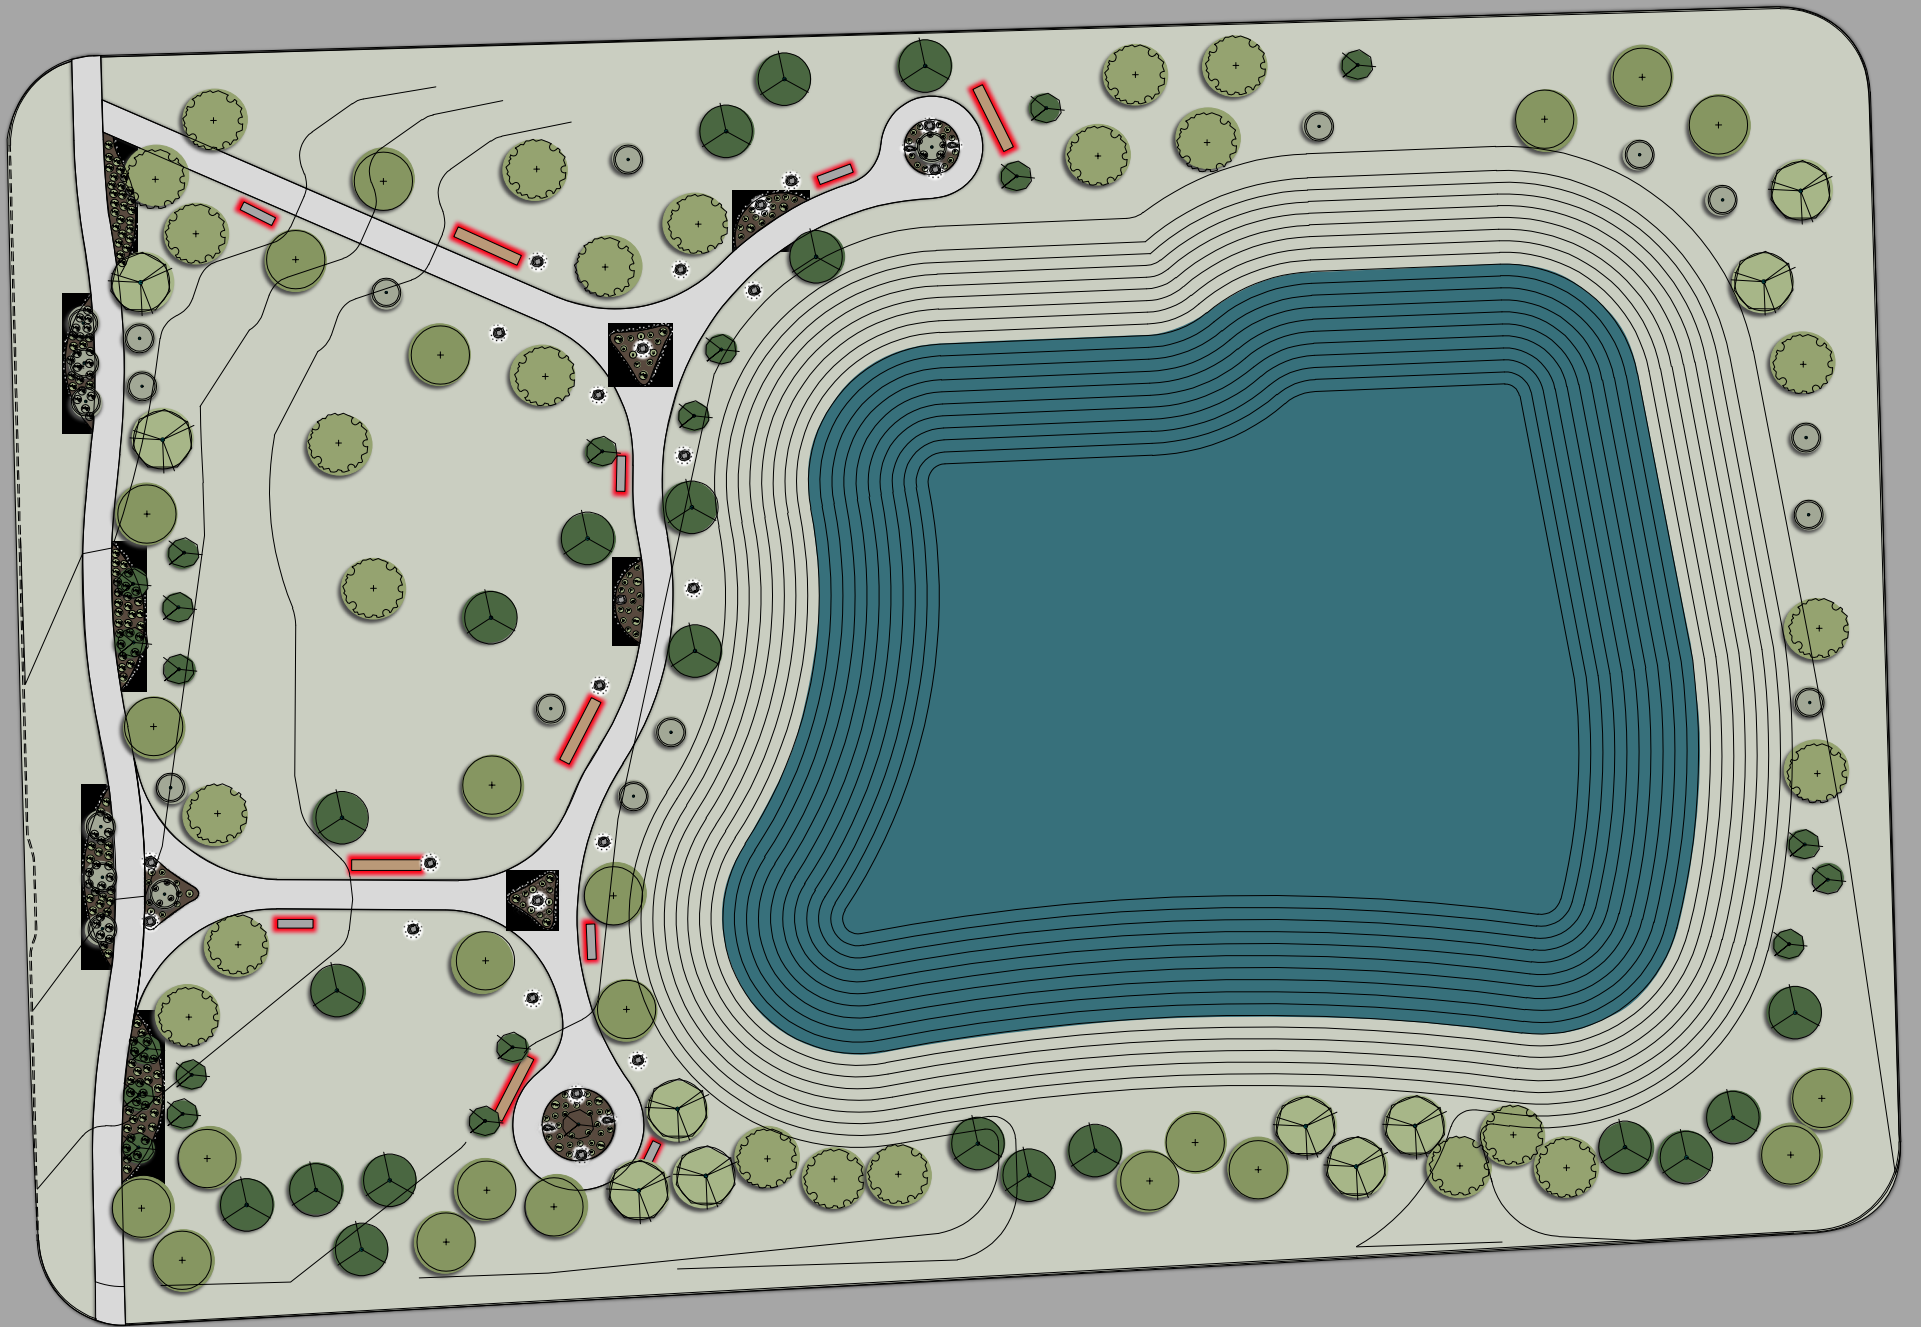





Rockwall ISD 9th Grade Center South

Rockwall, TX

Lighting System

Pole / Fixture Summary						
Pole ID	Pole Height	Mtg Height	Fixture Qty	Luminaire Type	Load	Circuit
A1-A2	70'	70'	4	TLC-LED-1500	5.72 kW	D
B1-B2	80'	16'	1	TLC-BT-575	0.58 kW	D
		80'	6	TLC-LED-1500	8.58 kW	D
C1-C2	70'	70'	3	TLC-LED-1200	3.51 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
D1-D2	70'	70'	4	TLC-LED-1200	4.68 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
F1-F4	80'	80'	7	TLC-LED-1500	10.01 kW	A
		16'	2	TLC-BT-575	1.15 kW	A
T1-T2	40'	40'	2	TLC-LED-600	1.16 kW	B
T3	40'	40'	2	TLC-LED-600	1.16 kW	B
		40'	2	TLC-LED-600	1.16 kW	C
T4	40'	40'	2	TLC-LED-600	1.16 kW	C
		40'	2	TLC-LED-600	1.16 kW	B
T5-T6	40'	40'	2	TLC-LED-600	1.16 kW	C
18			94		103.50 kW	

Circuit Summary			
Circuit	Description	Load	Fixture Qty
A	Football	44.64 kW	36
B	Tennis 1-2	4.64 kW	8
C	Tennis 3-4	4.64 kW	8
D	Baseball	49.58 kW	42

Fixture Type Summary							
Type	Source	Wattage	Lumens	L90	L80	L70	Quantity
TLC-LED-1500	LED 5700K - 75 CRI	1430W	160,000	>120,000	>120,000	>120,000	48
TLC-LED-1200	LED 5700K - 75 CRI	1170W	136,000	>120,000	>120,000	>120,000	14
TLC-BT-575	LED 5700K - 75 CRI	575W	52,000	>120,000	>120,000	>120,000	16
TLC-LED-600	LED 5700K - 75 CRI	580W	65,600	>120,000	>120,000	>120,000	16

Light Level Summary

Calculation Grid Summary								
Grid Name	Calculation Metric	Illumination					Circuits	Fixture Qty
		Ave	Min	Max	Max/Min	Ave/Min		
Baseball (Infield)	Horizontal Illuminance	52.7	39	69	1.75	1.35	D	42
Baseball (Outfield)	Horizontal Illuminance	33.4	26	45	1.75	1.28	D	42
Football	Horizontal Illuminance	36	31	43	1.40	1.16	A	36
Tennis 1-2	Horizontal Illuminance	37.5	30	48	1.61	1.25	B	8
Tennis 3-4	Horizontal Illuminance	37.1	30	49	1.64	1.24	C	8
Track	Horizontal Illuminance	18.7	3	38	11.34	6.22	A	36

From Hometown to Professional



We Make It Happen.

Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.


EQUIPMENT LIST FOR AREAS SHOWN							
Pole				Luminaires			
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID / OTHER GRIDS
4	F1-F4	80'	-	15.5'	TLC-BT-575	2	2 0
				80'	TLC-LED-1500	7	7 0
4	TOTALS					36	36 0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Football
Size:	360' x 160'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
	Entire Grid
Guaranteed Average:	30
Scan Average:	35.95
Maximum:	43
Minimum:	31
Avg / Min:	1.17
Guaranteed Max / Min:	2.5
Max / Min:	1.40
UG (adjacent pts):	1.17
CU:	0.47
No. of Points:	72
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

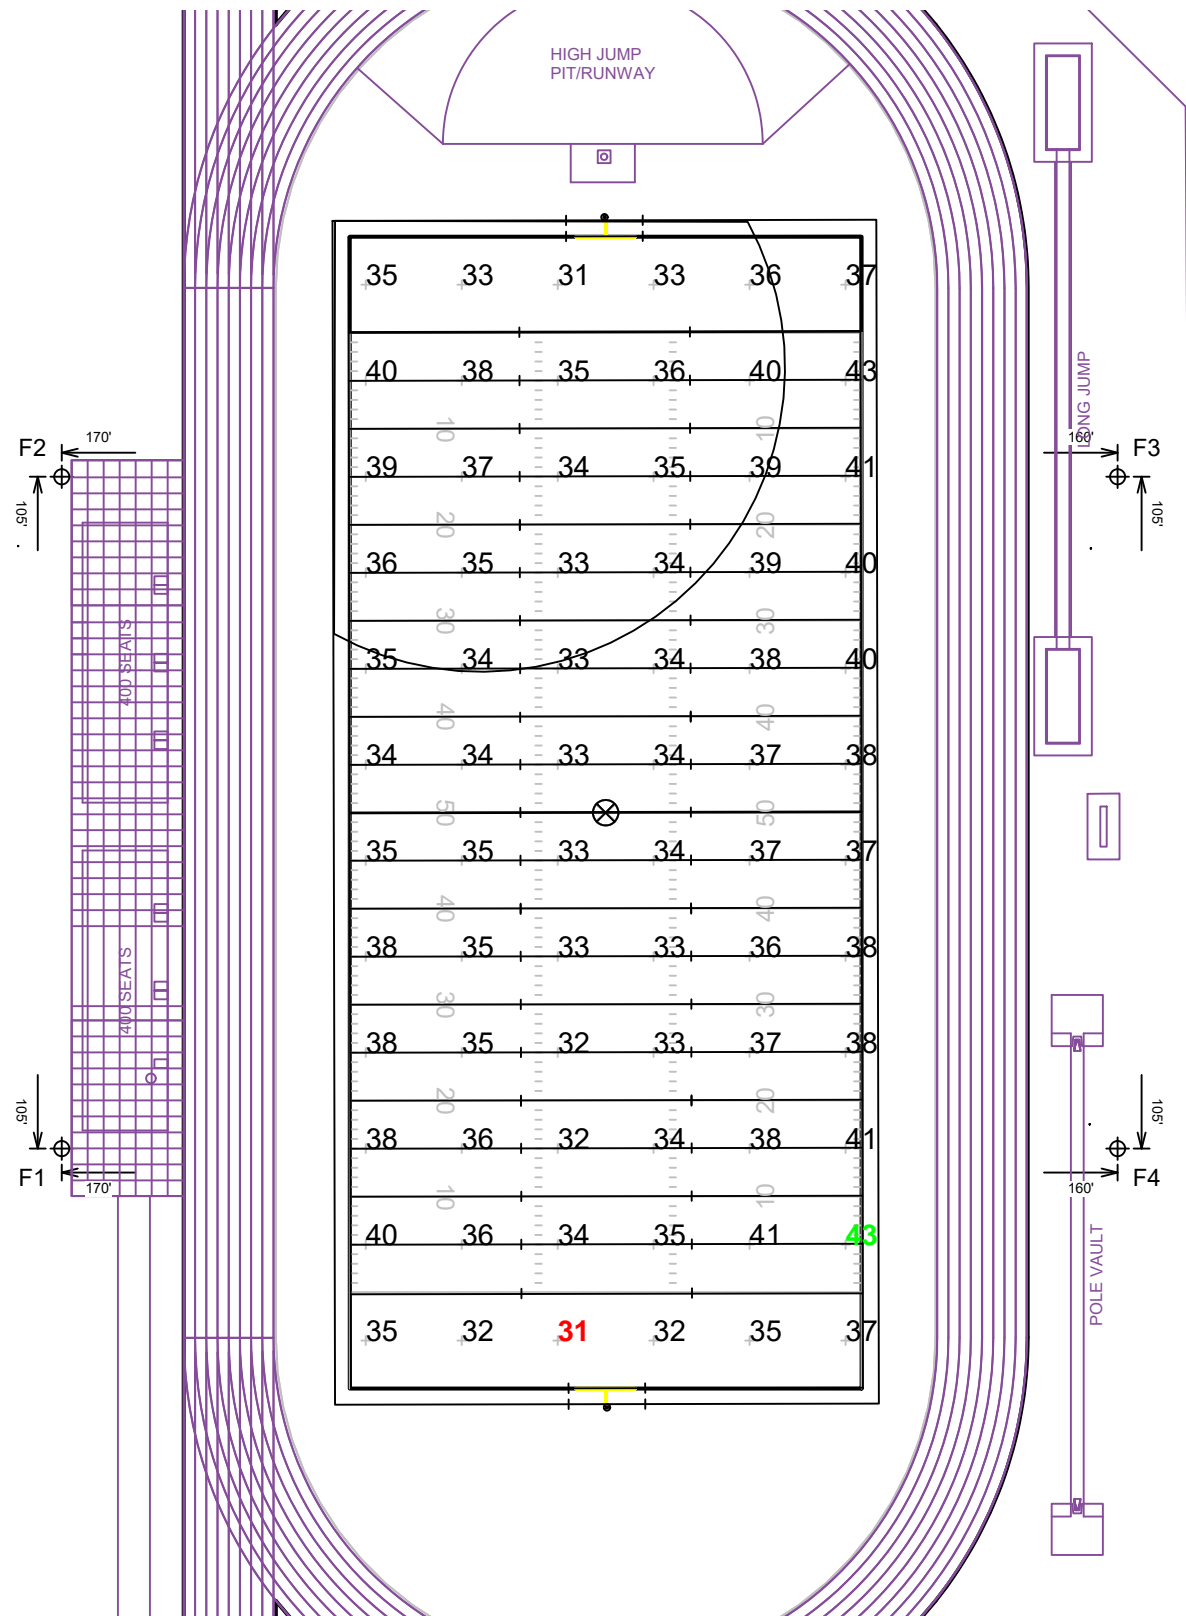


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) Ⓢ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.


EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
4	F1-F4	80'	0'	15.52'	TLC-BT-575	2	2	0
				80'	TLC-LED-1500	7	7	0
4	TOTALS					36	36	0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Track
Size:	Irregular
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Scan Average:	18.66
Maximum:	38
Minimum:	3
Avg / Min:	5.56
Max / Min:	11.34
UG (adjacent pts):	0.00
CU:	0.16
No. of Points:	48
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

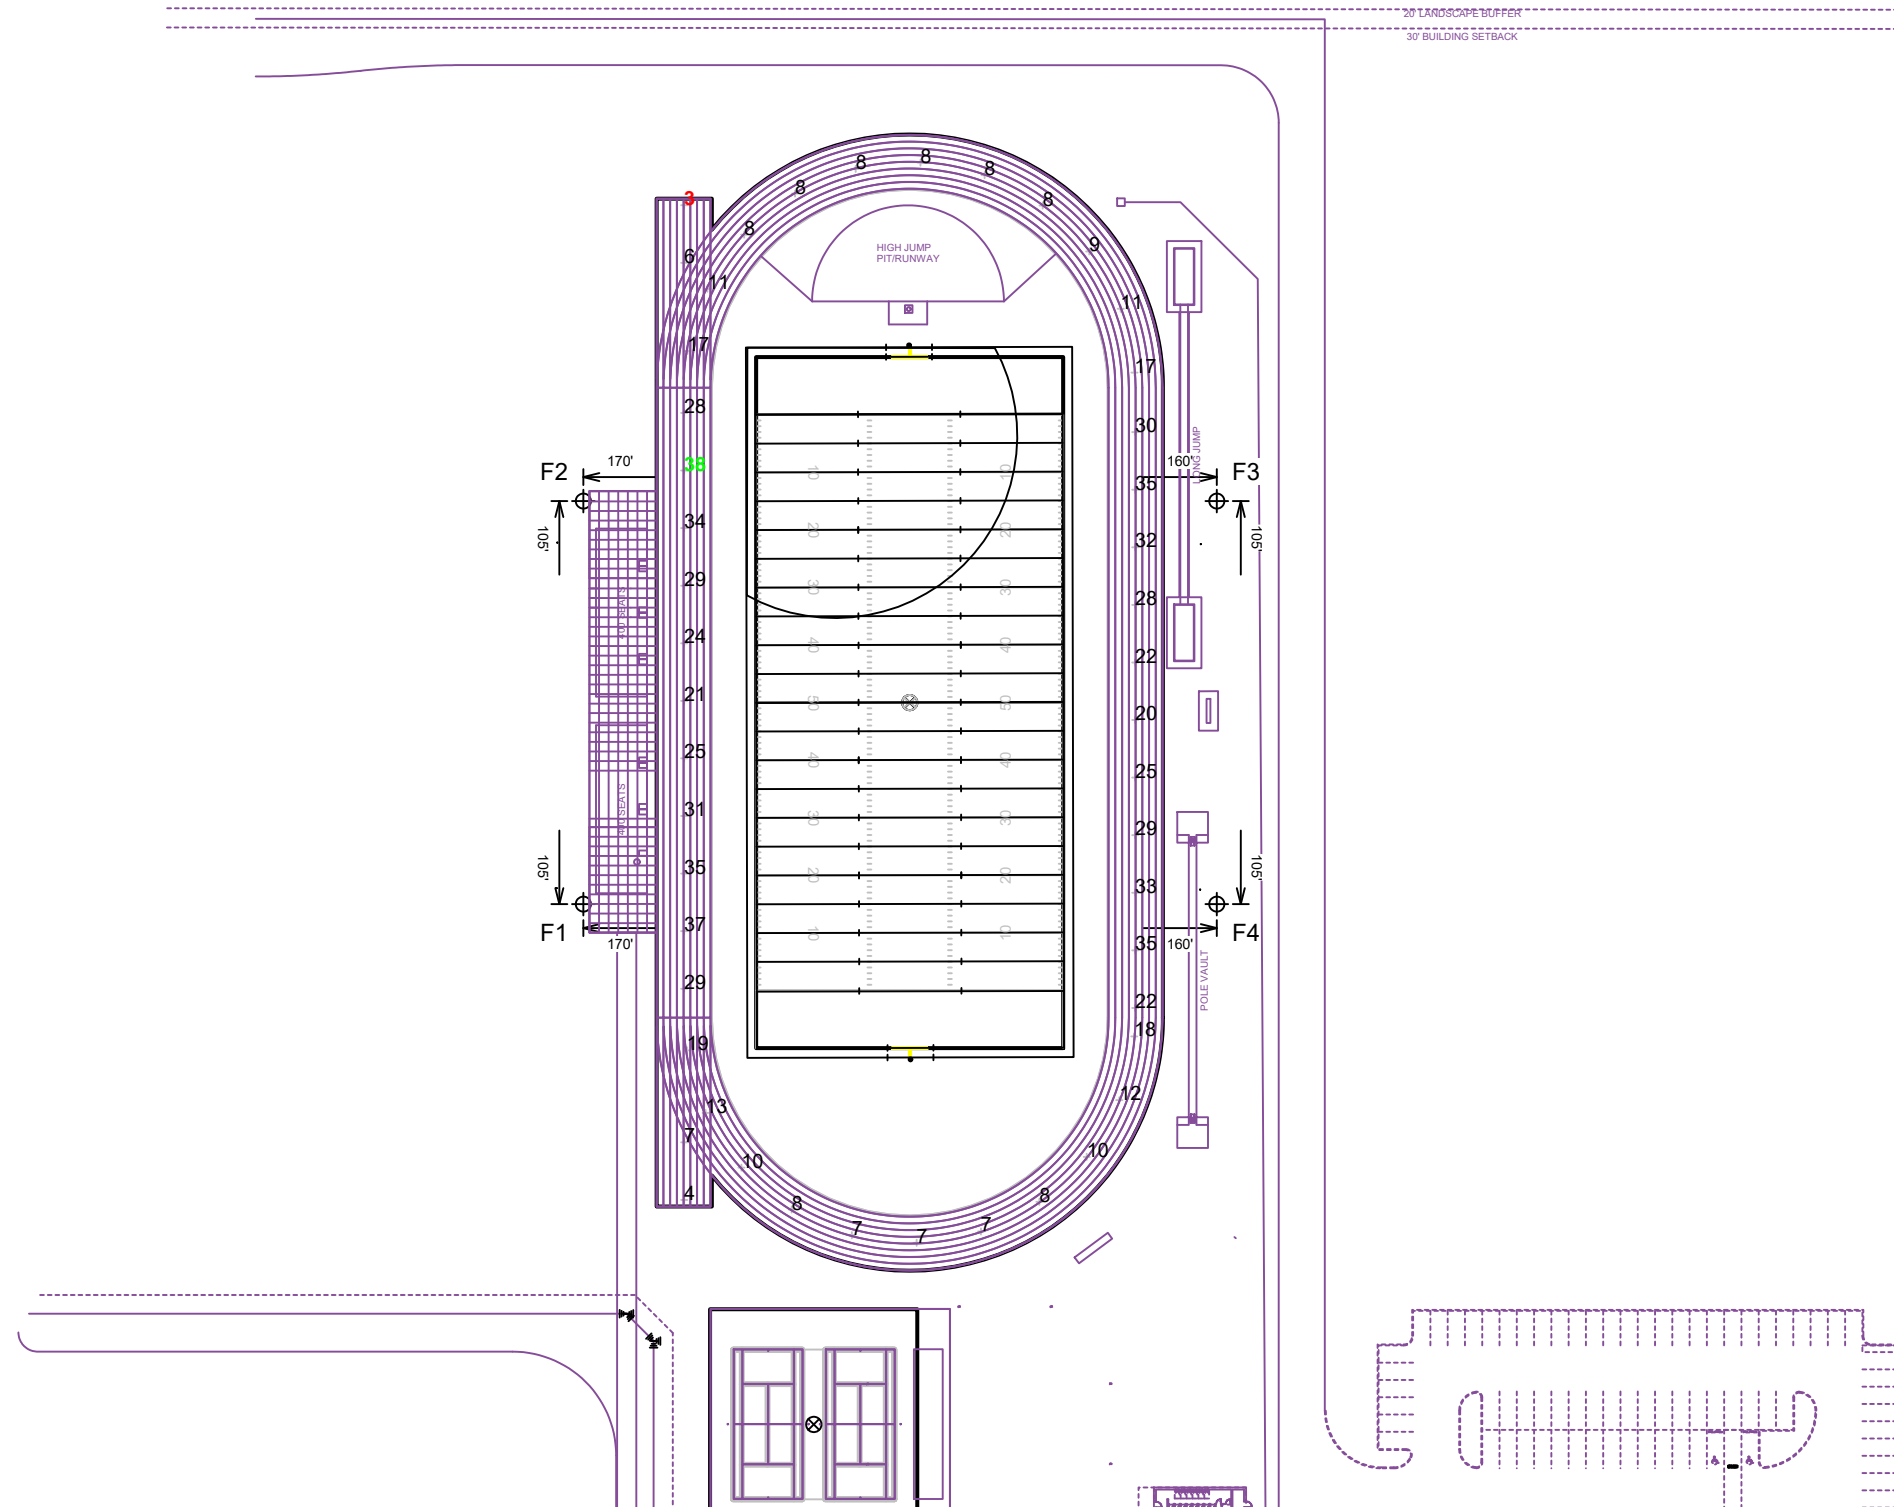


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume $\pm 3\%$ nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) \oplus dimensions are relative to 0,0 reference point(s) \otimes



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY

Rockwall ISD 9th Grade Center South

Rockwall, TX

EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T1-T2	40'	-	40'	TLC-LED-600	2	2	0
2	T3-T4	40'	-	40'	TLC-LED-600	4	2	2
4	TOTALS					12	8	4

GRID SUMMARY	
Name:	Tennis 1-2
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade



ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.52
Maximum:	48
Minimum:	30
Avg / Min:	1.26
Guaranteed Max / Min:	2.5
Max / Min:	1.61
UG (adjacent pts):	0.00
CU:	0.89
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	B
No. of Luminaires:	8
Total Load:	4.64 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

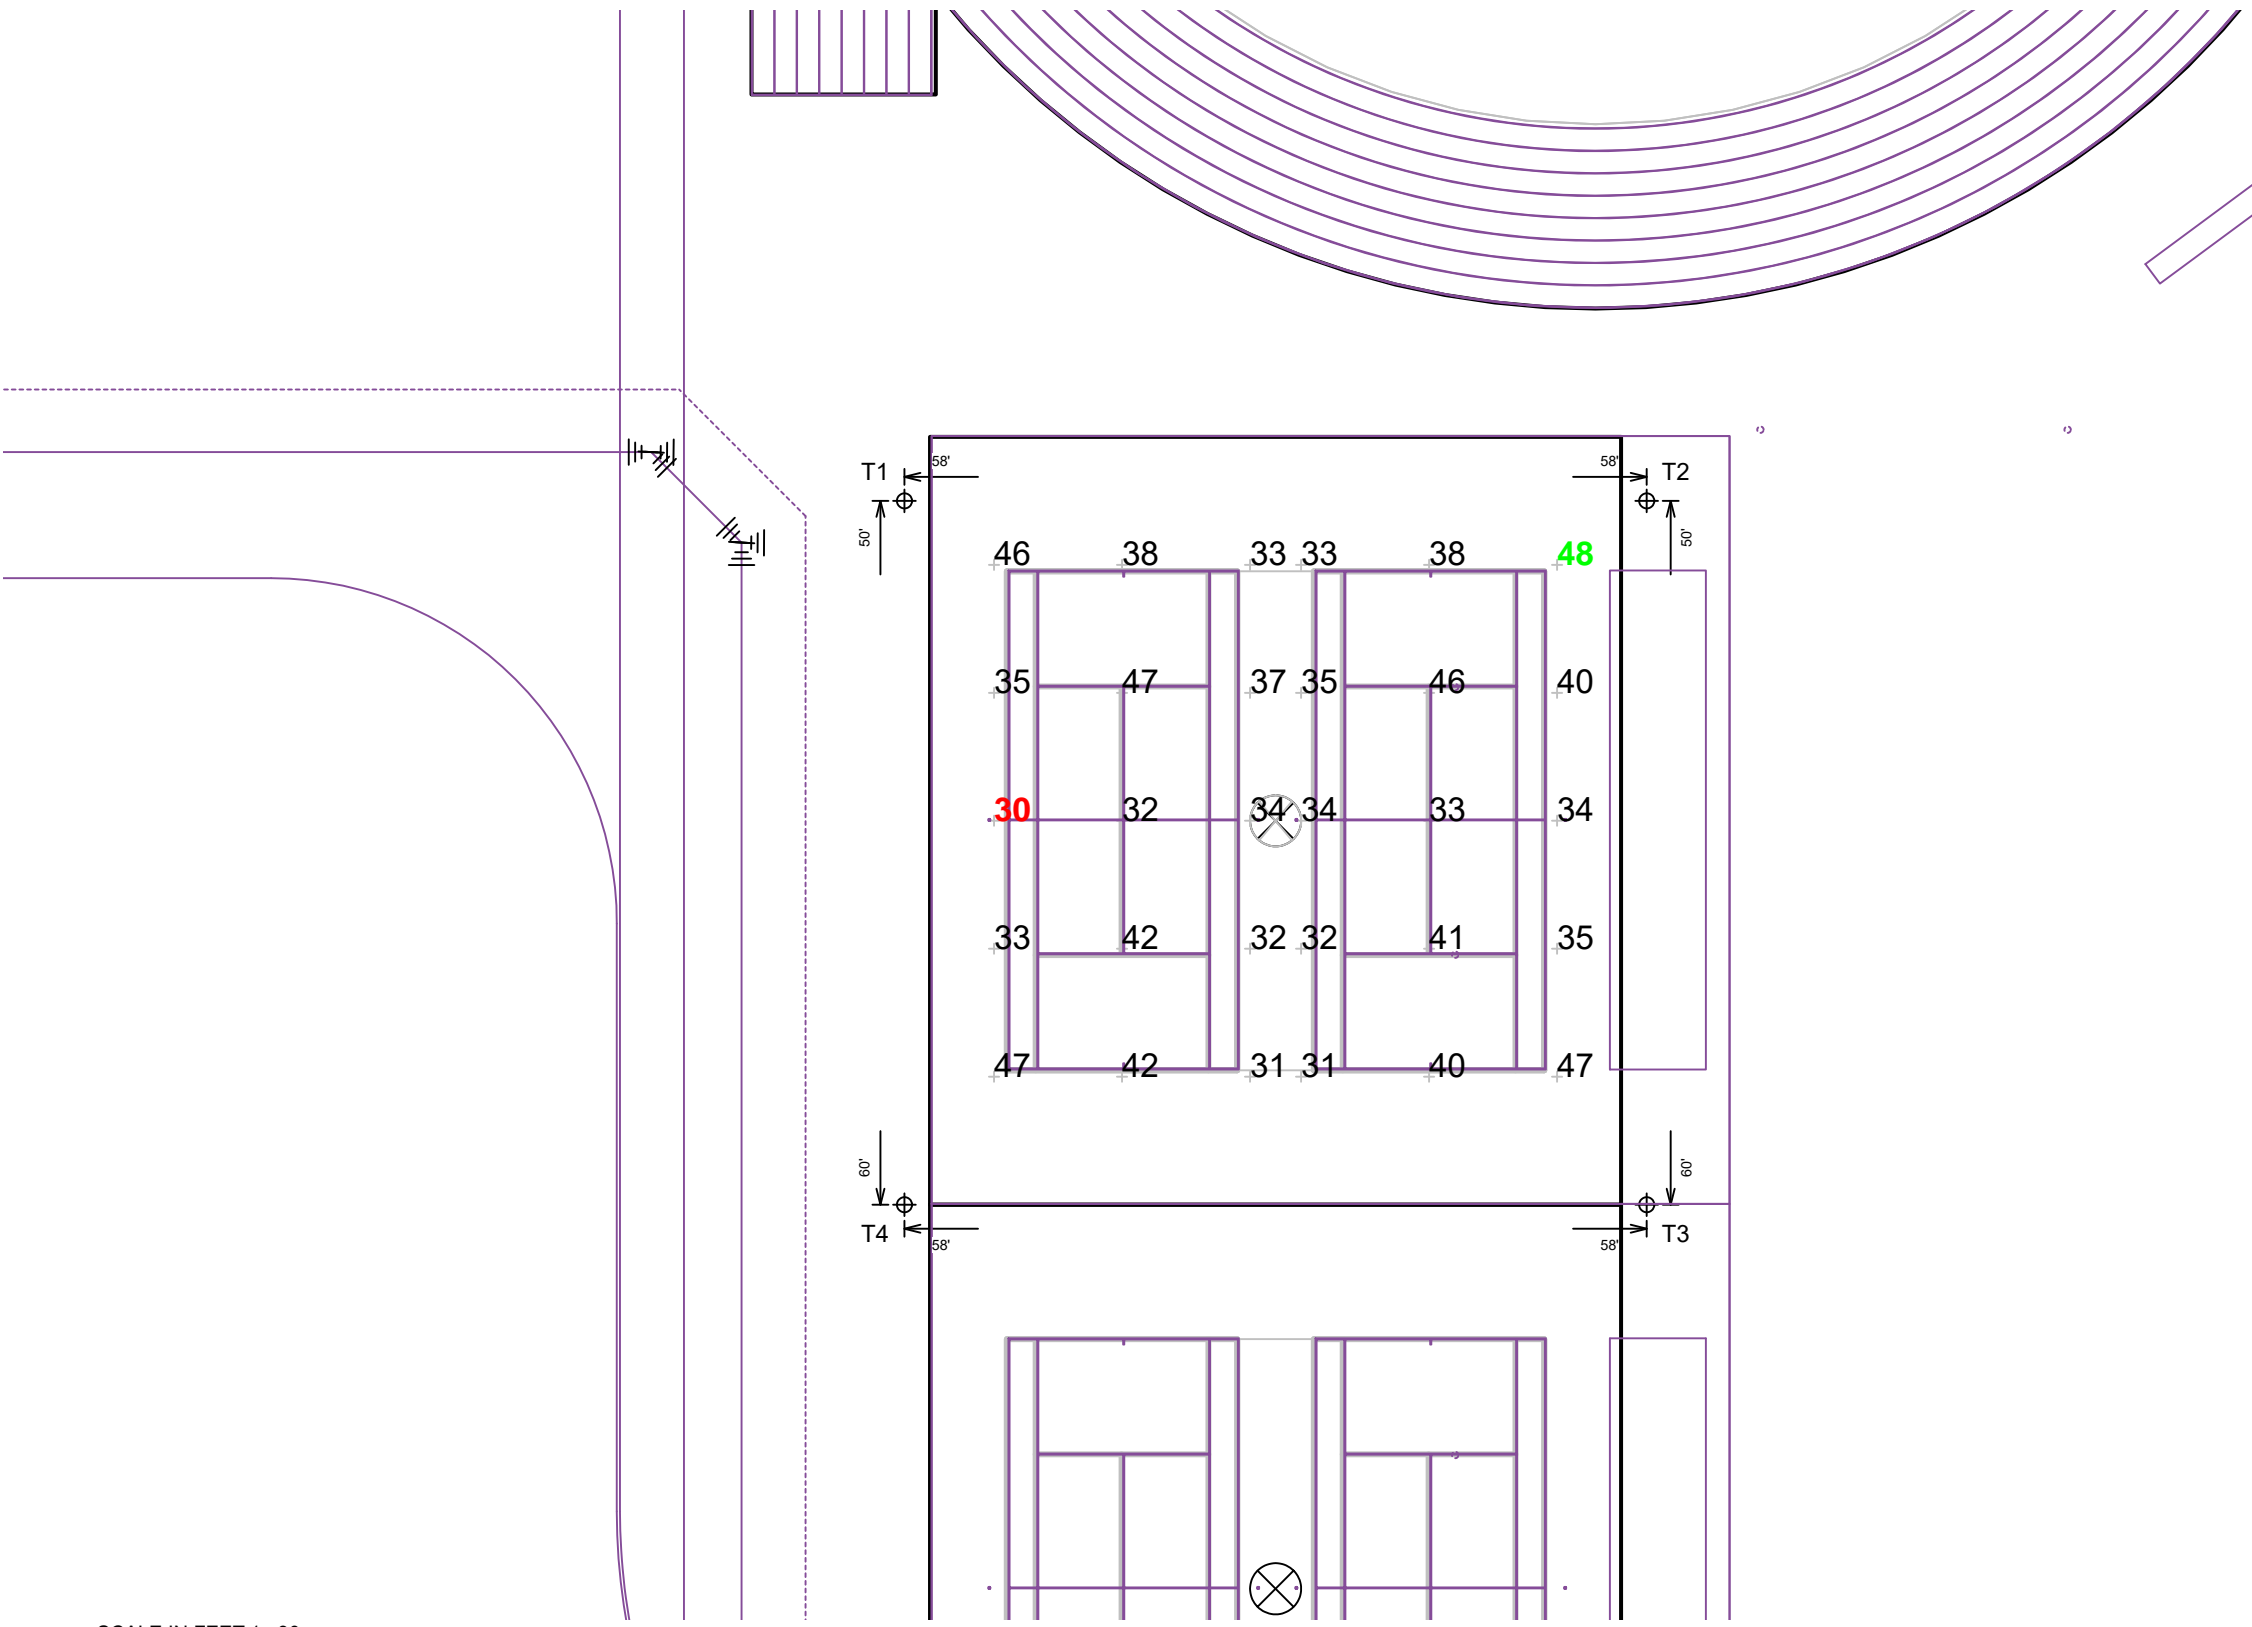

Pole location(s) Ⓢ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY


EQUIPMENT LIST FOR AREAS SHOWN							
Pole				Luminaires			
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID
2	T3-T4	40'	0'	40'	TLC-LED-600	4	2
2	T5-T6	40'	-	40'	TLC-LED-600	2	2
4	TOTALS					12	8

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Tennis 3-4
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.13
Maximum:	49
Minimum:	30
Avg / Min:	1.23
Guaranteed Max / Min:	2.5
Max / Min:	1.64
UG (adjacent pts):	0.00
CU:	0.88
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	C
No. of Luminaires:	8
Total Load:	4.64 kW

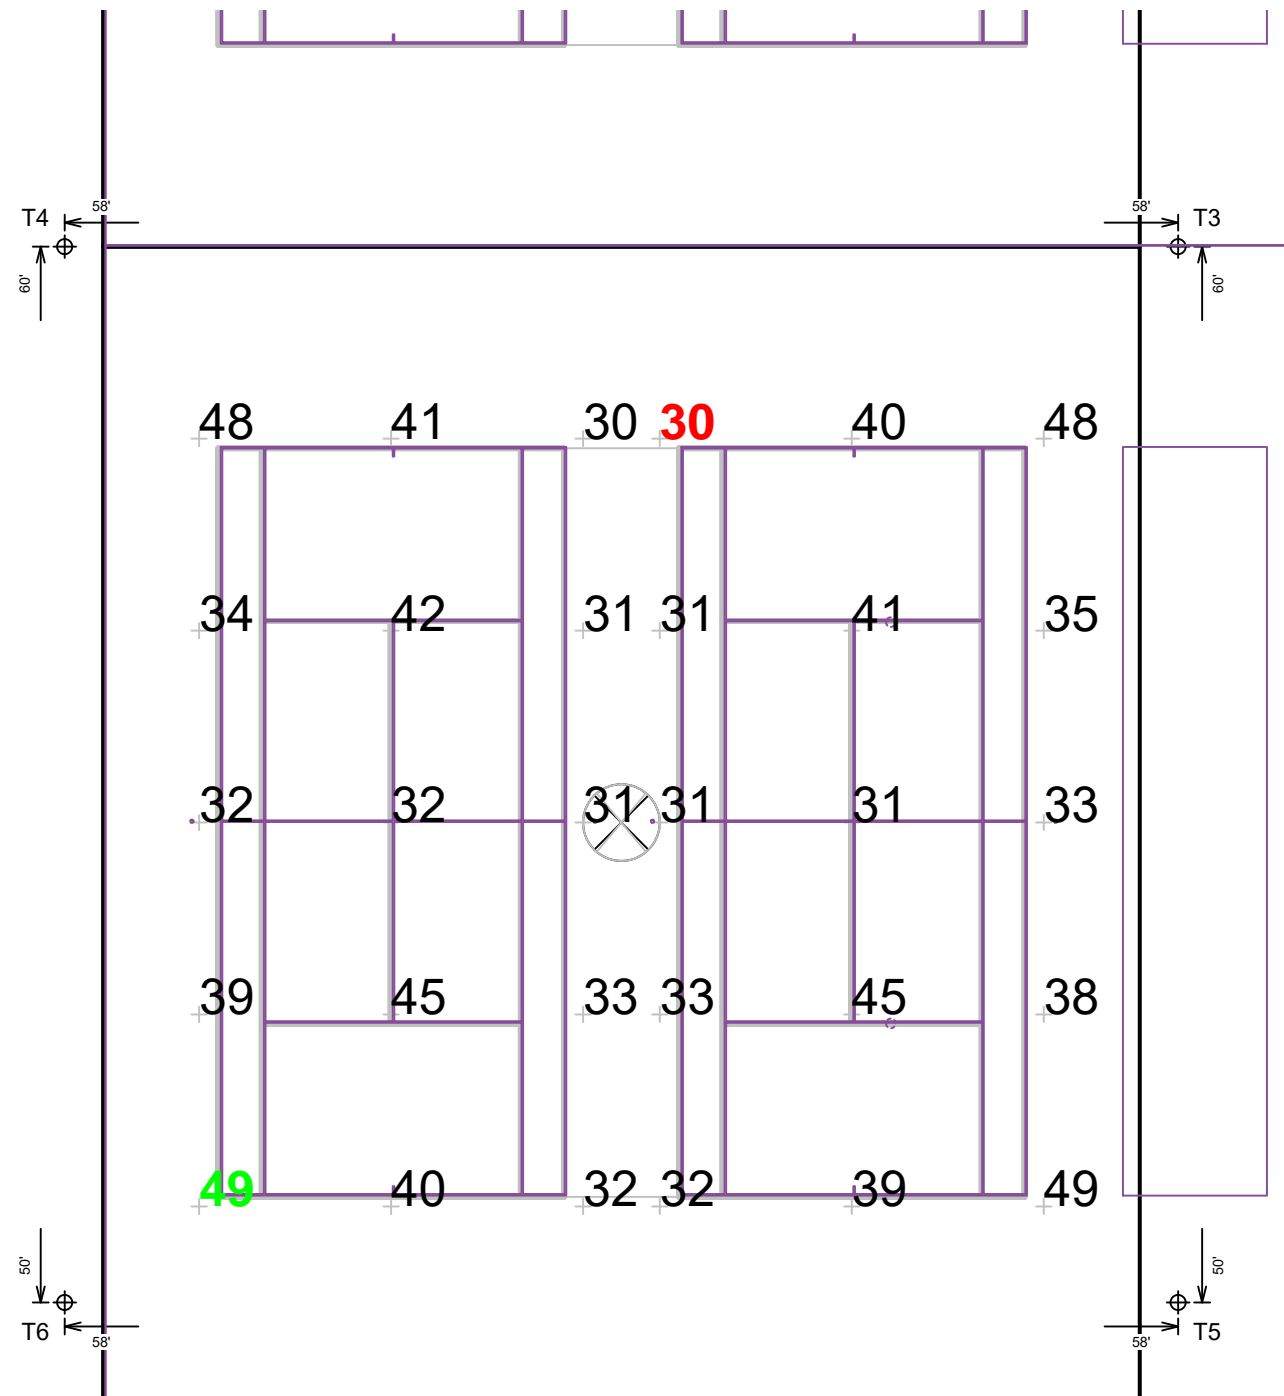

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.


Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

DO NOT ENTER

SCALE IN FEET 1 : 20



Pole location(s) ⓧ dimensions are relative to 0,0 reference point(s) ⊗



We Make It Happen.

Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

EQUIPMENT LIST FOR AREAS SHOWN								
Pole			Luminaires					
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	A1-A2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1500	4	4	0
2	B1-B2	80'	-	15.5'	TLC-BT-575	1	1	0
				80'	TLC-LED-1500	6	6	0
2	C1-C2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	3	3	0
2	D1-D2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	4	4	0
8	TOTALS					42	42	0

GRID SUMMARY	
Name:	Baseball
Size:	Irregular 315' / 390' / 315'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY		
MAINTAINED HORIZONTAL FOOTCANDLES		
	Infield	Outfield
Guaranteed Average:	50	30
Scan Average:	52.69	33.40
Maximum:	69	45
Minimum:	39	26
Avg / Min:	1.34	1.30
Guaranteed Max / Min:	2	2.5
Max / Min:	1.75	1.75
UG (adjacent pts):	1.21	1.34
CU:	0.73	
No. of Points:	25	93



LUMINAIRE INFORMATION	
Applied Circuits:	D
No. of Luminaires:	42
Total Load:	49.58 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.


Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

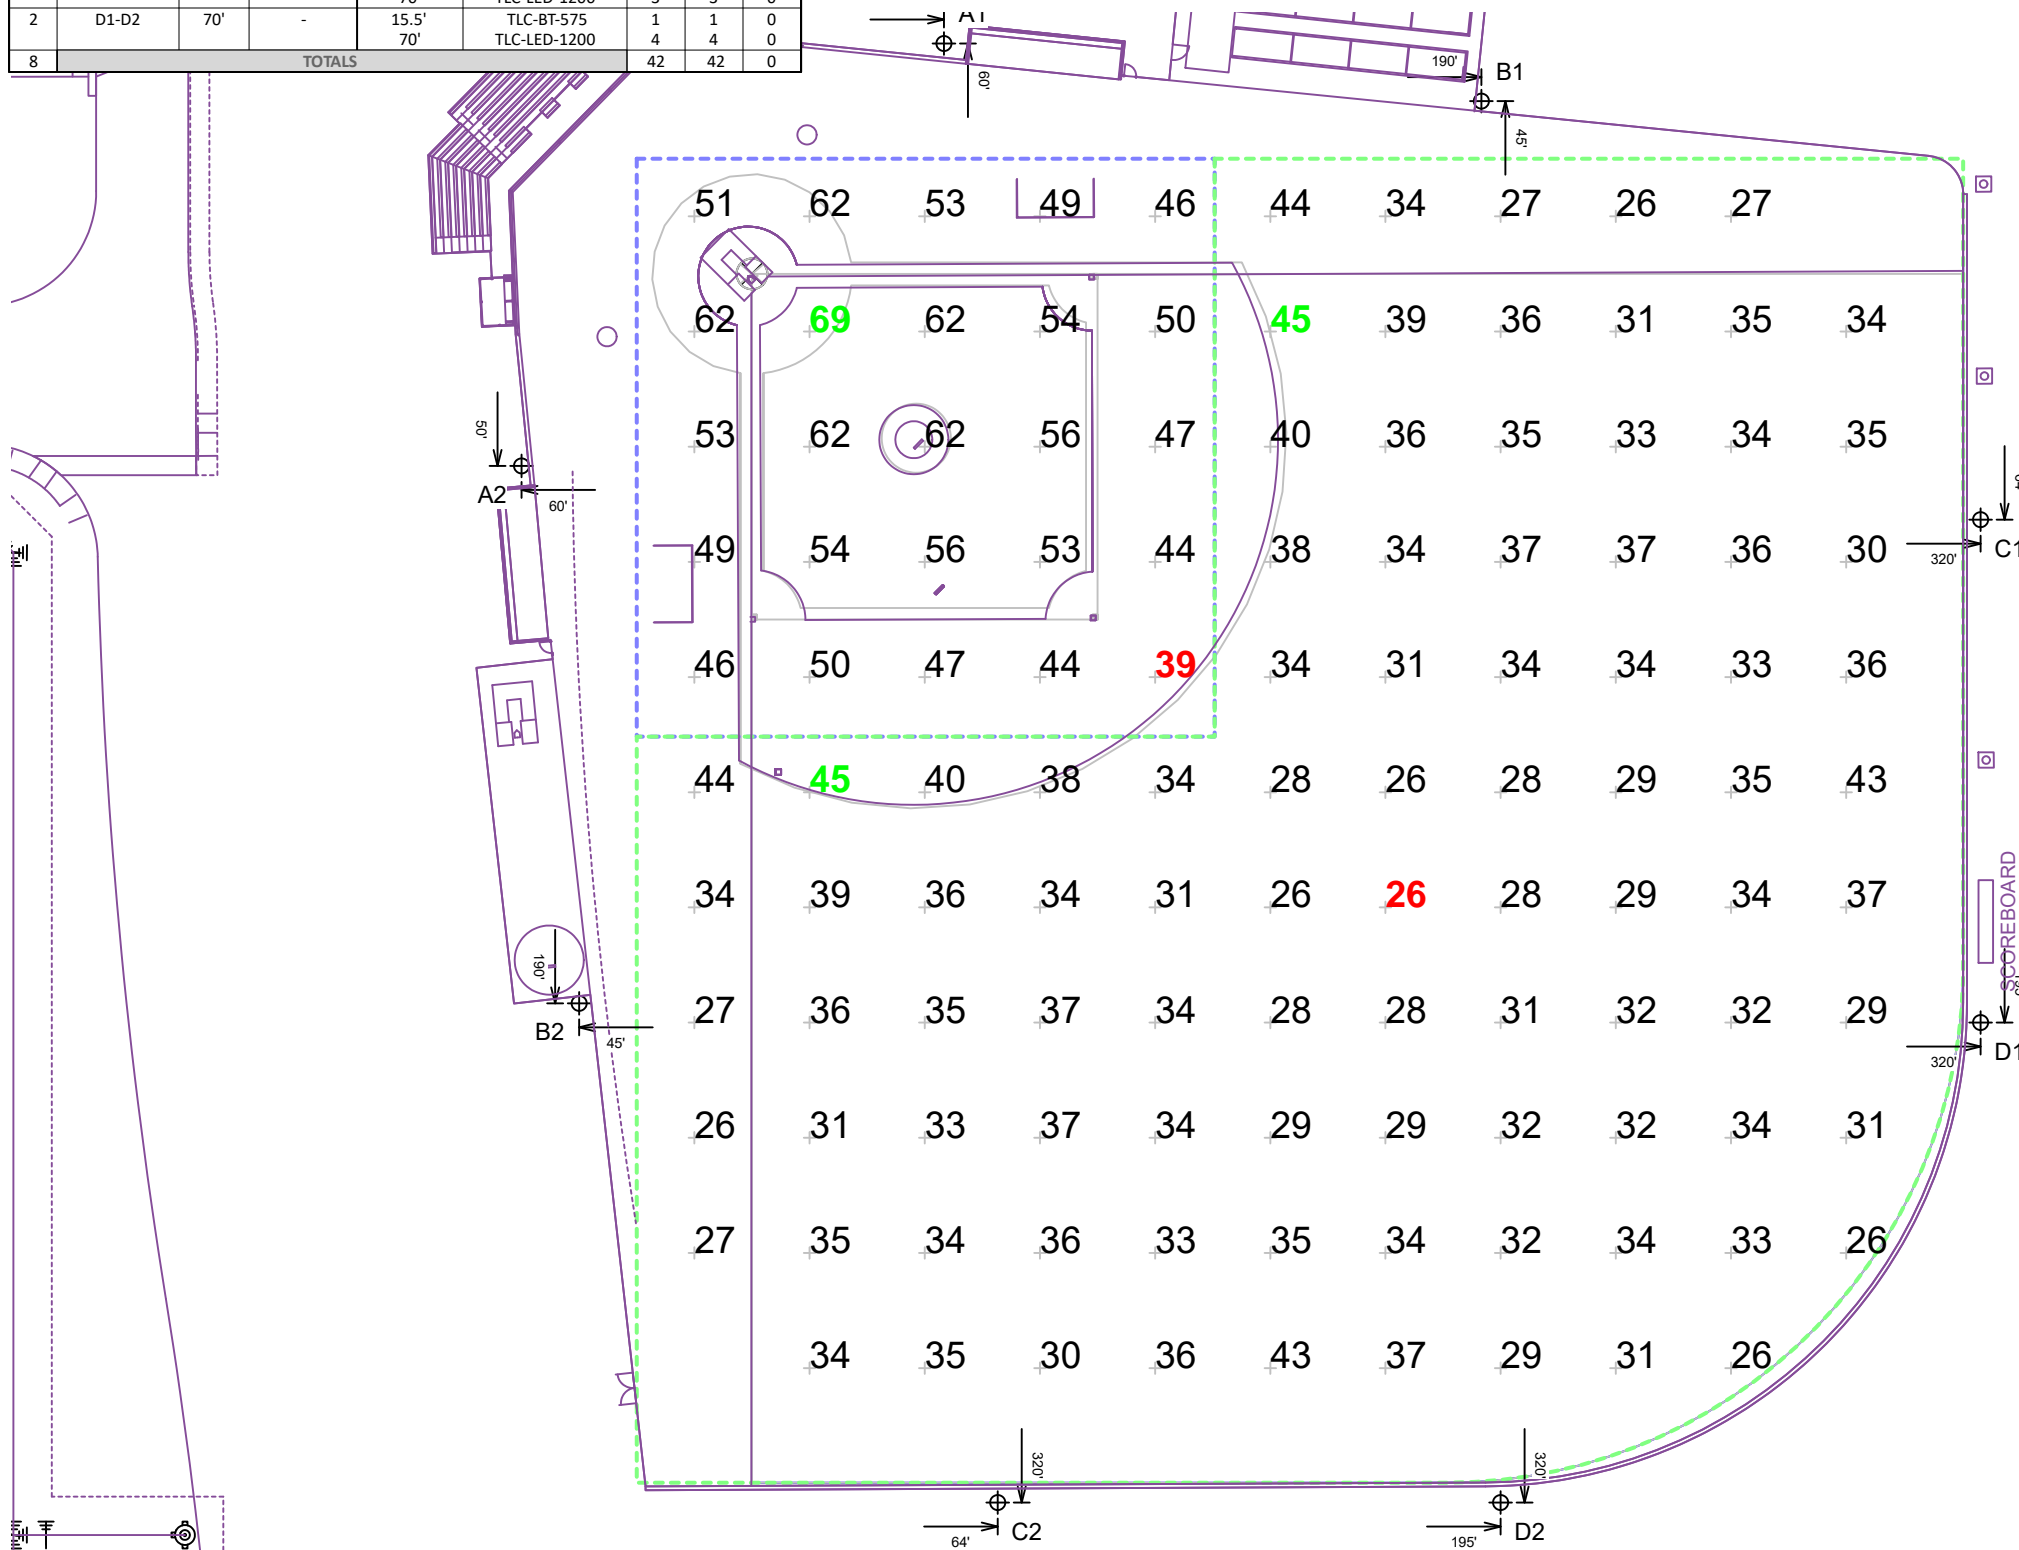

Pole location(s) Ⓧ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

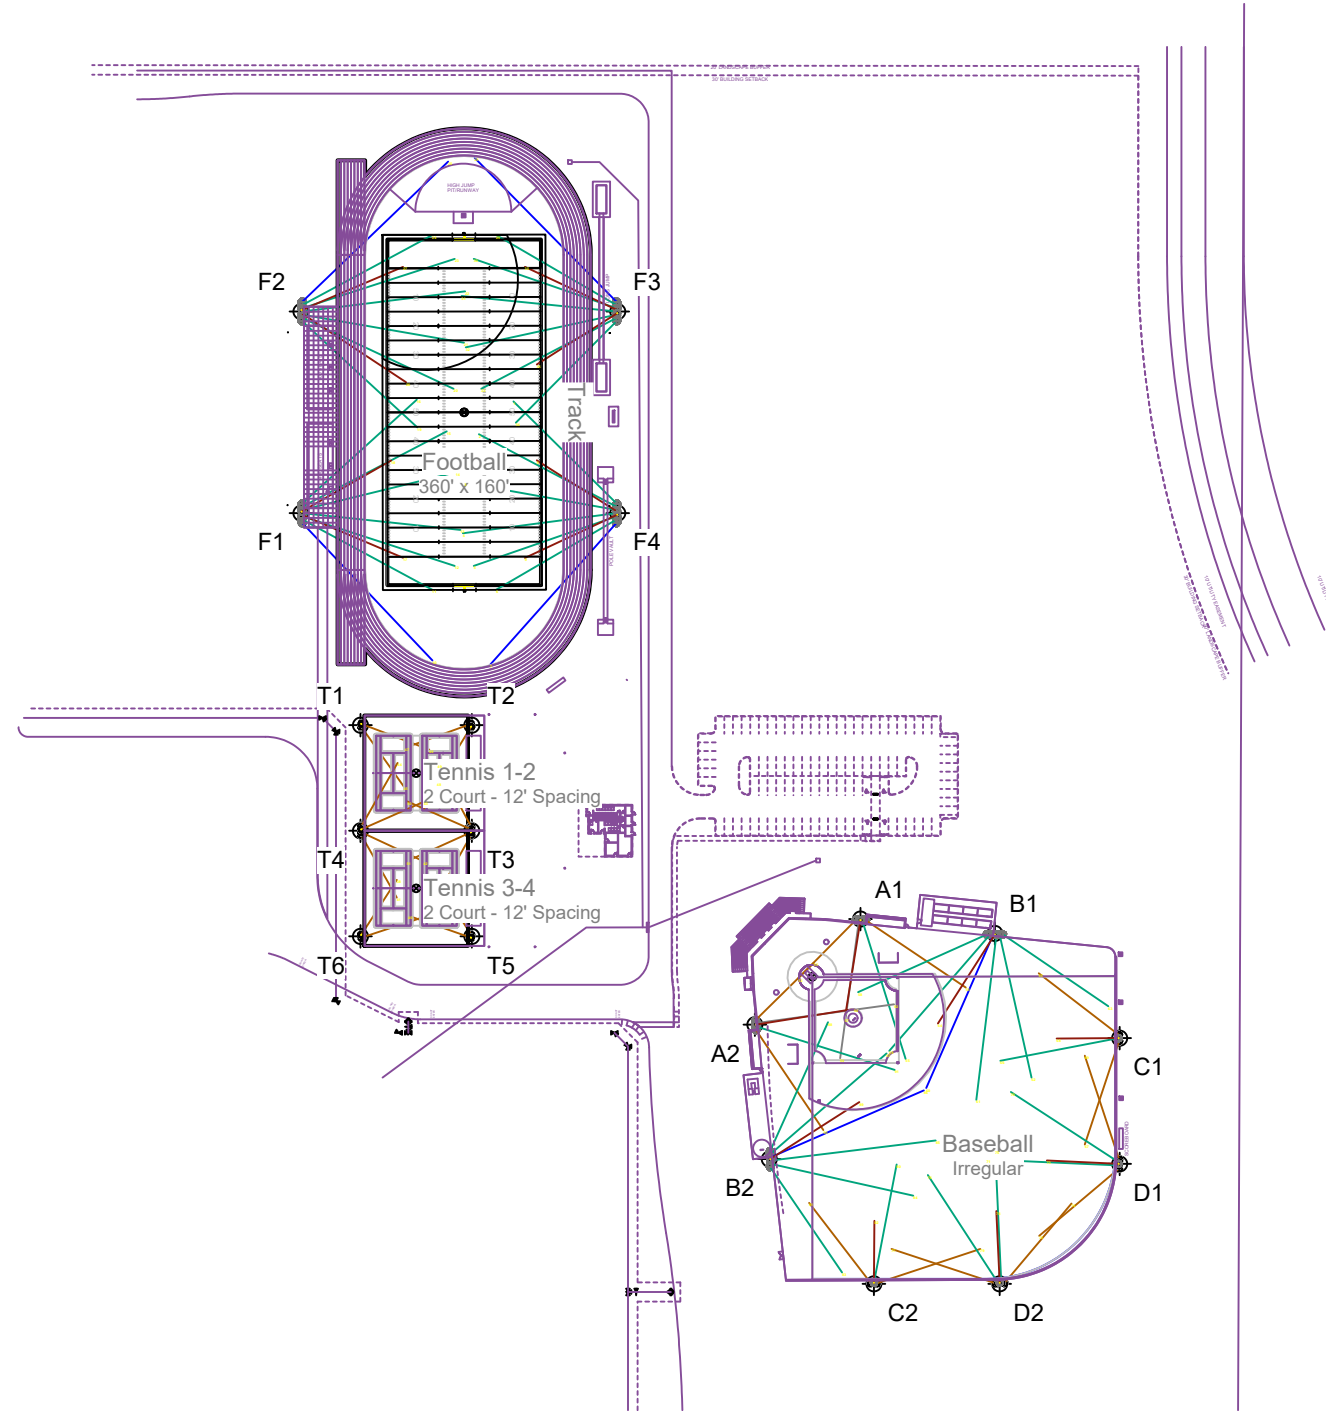

EQUIPMENT LAYOUT

INCLUDES:

- Baseball
- Football
- Tennis 1-2
- Tennis 3-4
- Track

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.


Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

EQUIPMENT LIST FOR AREAS SHOWN

QTY	Pole			Luminaires		QTY / POLE
	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	
2	A1-A2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1500	1 4
2	B1-B2	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	1 6
2	C1-C2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 3
2	D1-D2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 4
4	F1-F4	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	2 7
4	T1-T2 T5-T6	40'	-	40'	TLC-LED-600	2
2	T3-T4	40'	-	40'	TLC-LED-600	4
18	TOTALS					94

SINGLE LUMINAIRE AMPERAGE DRAW CHART




Ballast Specifications (.90 min power factor)	Line Amperage Per Luminaire (max draw)					
	208 (60)	220 (60)	240 (60)	277 (60)	347 (60)	480 (60)
Single Phase Voltage						
TLC-LED-1500	8.5	8.1	7.4	6.4	5.1	4.7
TLC-LED-1200	7.0	6.6	6.1	5.2	4.2	4.0
TLC-BT-575	3.4	3.2	2.9	2.5	2.0	1.8
TLC-LED-600	3.4	3.2	3.0	2.6	2.0	1.9



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

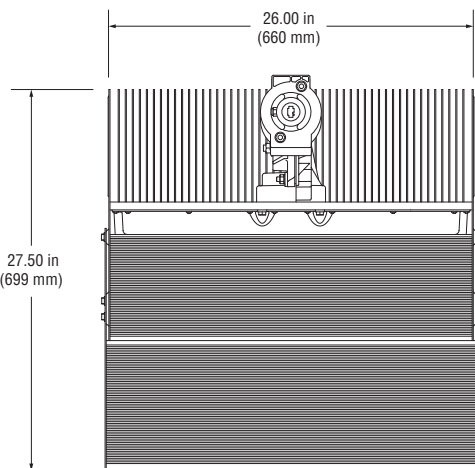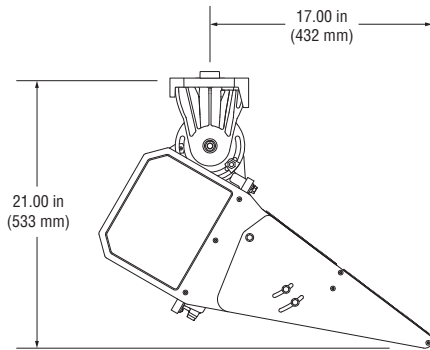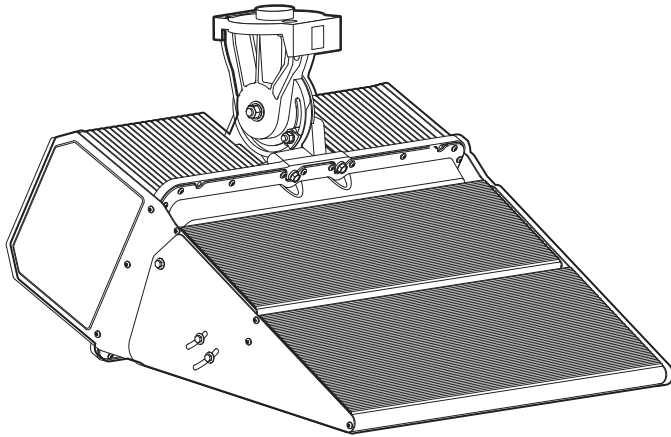

Luminaire Data

Weight (luminaire) 80 lb (36 kg)
 UL listing number..... E338094
 UL listed for USA / Canada..... UL1598 CSA-C22.2 No.250.0
 Ingress protection, luminaire, international IP65
 Ingress protection, luminaire, USA IP54
 Material and finish Aluminum, powder-coat painted
 Wind speed rating (aiming only)..... 150 mi/h (67 m/s)
 UL ambient temperature rating, luminaire 50°C (122°F)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11
 L90 (10.5k) >63,500 h
 L80 (10.5k) >63,500 h
 L70 (10.5k) >63,500 h
 CIE correlated color temperature 5700 K
 Color Rendering Index (CRI), typical..... 75
 Color Rendering Index (CRI), minimum 70
 Lumens¹ 121,000

Footnotes:

1) Lumen values at stabilized operation in 25°C ambient temperature environment. Incorporates appropriate dirt depreciation factor for life of luminaire.

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 1,150 W

Per luminaire..... 1,150 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 μs

Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure..... 50°C (122°F)

Ingress protection,
electrical components enclosure..... IP54


Efficiency..... 95%

Dimming mode..... optional

Range, energy consumption..... .20 – 100%

Range, light output..... .25 – 100%

Typical Wiring

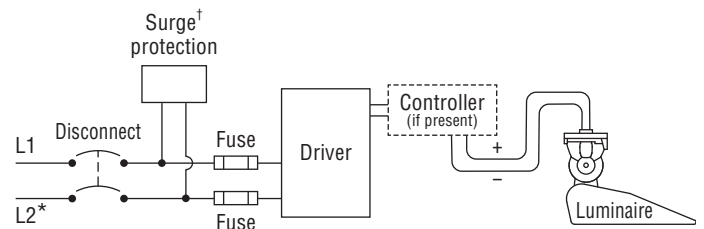

* If L2 (com) is neutral then not switched or fused.
† Not present if indoor installation.

	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	7.11 A	6.83 A	6.46 A	6.18 A	5.92 A	5.13 A	4.10 A	3.74 A	3.56 A	3.43 A	2.96 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.



Luminaire and Driver Components – TLC-BT-575

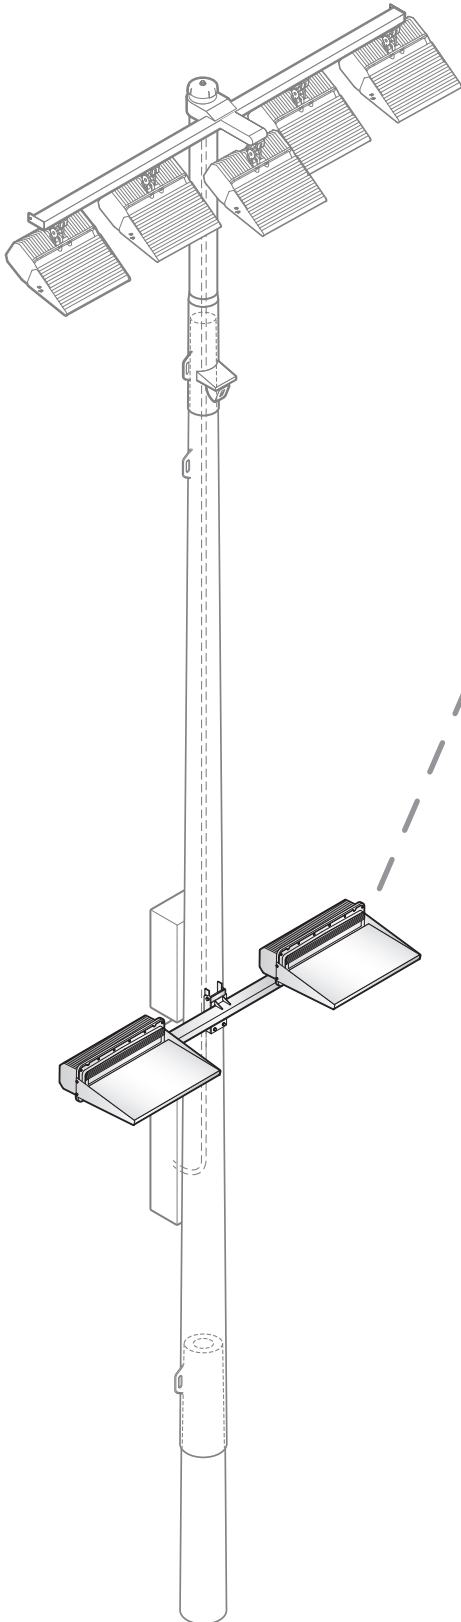

Luminaire Data

Weight (luminaire)	34 lb (15 kg)
UL listing number	E338094
UL Listed for USA / Canada	UL1598 CSA-C22.2 No.250.0
Ingress protection, luminaire, international	IP65
Ingress protection, luminaire, USA	IP54
Material and finish	Aluminum, powder-coat painted
Wind speed rating (aiming only)	150 mi/h (67 m/s)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11	
L90 (10.5k)	>63,500 h
L80 (10.5k)	>63,500 h
L70 (10.5k)	>63,500 h
CIE correlated color temperature	5700 K
Color Rendering Index (CRI), typical	75
Color Rendering Index (CRI), minimum	70
Lumens ¹	52,000

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

All components from foundation to poletop are designed to work together in Light-Structure System™ to ensure reliable, trouble-free operation.

Luminaire and Driver Components – TLC-BT-575

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 575 W

Per luminaire..... 575 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 μs


Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure 50°C (122°F)

Ingress protection,
electrical components enclosure IP54

Efficiency..... 95%

Typical Wiring

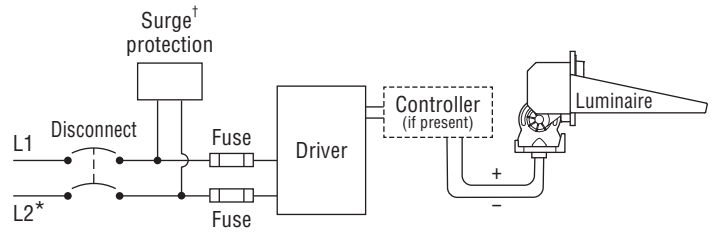

* If L2 (com) is neutral then not switched or fused.

† Not present if indoor installation.



	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	3.30 A	3.17 A	3.00 A	2.87 A	2.75 A	2.38 A	1.90 A	1.74 A	1.65 A	1.59 A	1.38 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.

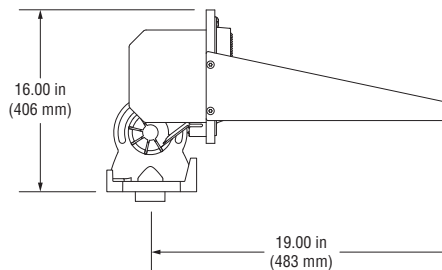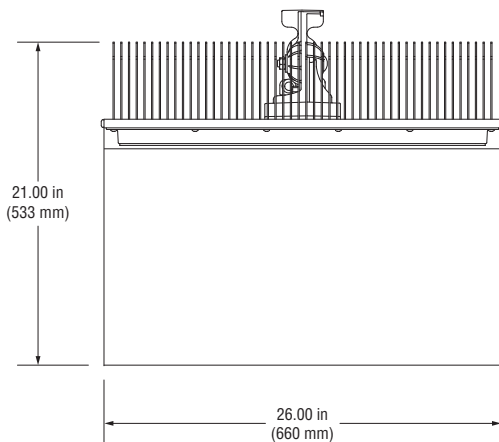

Datasheet: **TLC-LED-400 Luminaire and Driver**

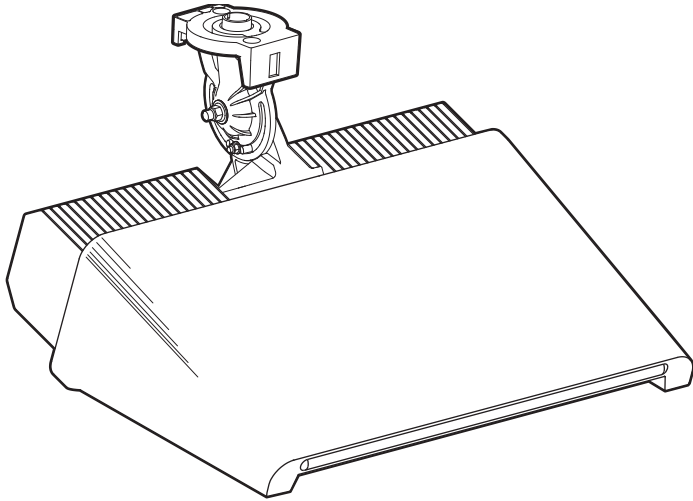

Luminaire Data



Weight (luminaire) 40 lb (18 kg)
 UL listing number E338094
 UL Listed for USA / Canada UL1598 CSA-C22.2 No.250.0
 Ingress protection, luminaire, international IP65
 Ingress protection, luminaire, USA IP54
 Material and finish Aluminum,
 powder-coat painted
 Wind speed rating (aiming only) 150 mi/h (67 m/s)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11
 L90(10.5k) >63,500 h
 L80(10.5k) >63,500 h
 L70(10.5k) >63,500 h
 CIE correlated color temperature 5700 K
 Color Rendering Index (CRI), typical 75
 Color Rendering Index (CRI), minimum 70
 Lumens¹ 46,500

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

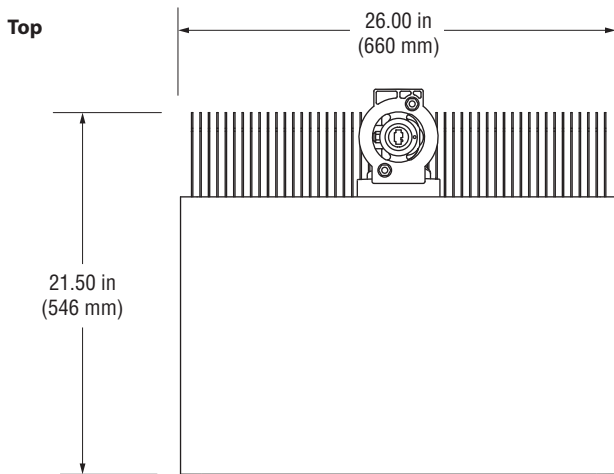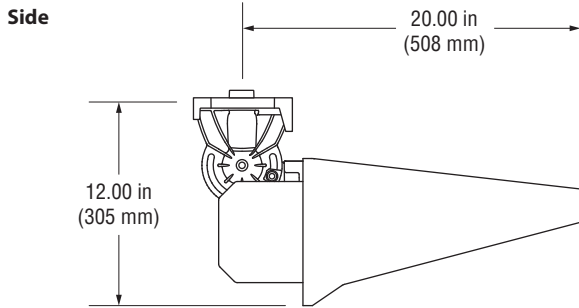



WST LED

Architectural Wall Sconce



Catalog Number
Notes
Type

Hit the Tab key or mouse over the page to see all interactive elements.

A+ Capable Luminaire

This item is an A+ capable luminaire, which has been designed and tested to provide consistent color appearance and system-level interoperability.

- All configurations of this luminaire meet the Acuity Brands' specification for chromatic consistency
- This luminaire is A+ Certified when ordered with DTL® controls marked by a **shaded background**. DTL DLL equipped luminaires meet the A+ specification for luminaire to photocontrol interoperability¹
- This luminaire is part of an A+ Certified solution for ROAM® or XPoint™ Wireless control networks, providing out-of-the-box control compatibility with simple commissioning, when ordered with drivers and control options marked by a **shaded background**¹

To learn more about A+, visit www.acuitybrands.com/aplus.


See ordering tree for details.

A+ Certified Solutions for ROAM require the order of one ROAM node per luminaire. Sold Separately: [Link to Roam](#); [Link to DTL DLL](#)

Specifications


Luminaire

- Height:** 8-1/2"
(21.59 cm)
- Width:** 17"
(43.18 cm)
- Depth:** 10-3/16"
(25.9 cm)
- Weight:** 20 lbs
(9.1 kg)

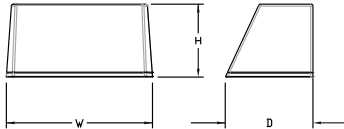


Optional Back Box (PBBW)

- Height:** 8.49"
(21.56 cm)
- Width:** 17.01"
(43.21 cm)
- Depth:** 1.70"
(4.32 cm)

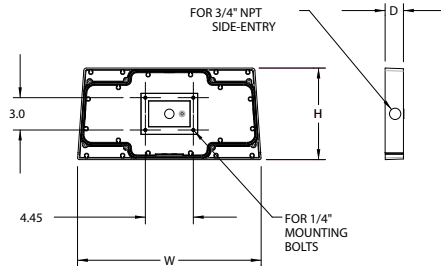

Optional Back Box (BBW)

- Height:** 4"
(10.2 cm)
- Width:** 5-1/2"
(14.0 cm)
- Depth:** 1-1/2"
(3.8 cm)

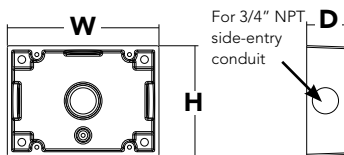

Performance Data

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-40°C (32-104°F).

Ambient		Lumen Multiplier
0°C	32°F	1.03
10°C	50°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
40°C	104°F	0.98

Electrical Load

Performance package	System Watts	Current (A)					
		120	208	240	277	347	480
P1	11	0.1	0.06	0.05	0.04	---	---
	14	---	---	---	---	0.04	0.03
P1 DS	14	0.12	0.07	0.06	0.06	---	---
P2	25	0.21	0.13	0.11	0.1	---	---
	30	---	---	---	---	0.09	0.06
P2 DS	25	0.21	0.13	0.11	0.1	---	---
P3	50	0.42	0.24	0.21	0.19	---	---
	56	---	---	---	---	0.16	0.12
P3 DS	52	0.43	0.26	0.23	0.21	---	---

Projected LED Lumen Maintenance

Values calculated according to IESNA TM-21-11 methodology and valid up to 40°C.

Operating Hours	0	25,000	50,000	100,000
Lumen Maintenance Factor	1.0	>0.95	>0.92	>0.87

Motion Sensor Default Settings

Option	Dimmed State	High Level (when triggered)	Photocell Operation	Ramp-up Time	Dwell Time	Ramp-down Time
*PIR or PIRH	3V (37%) Output	10V (100%) Output	Enabled @ 5FC	3 sec	5 min	5 min
PIR1FC3V or PIRH1FC3V	3V (37%) Output	10V (100%) Output	Enabled @ 1FC	3 sec	5 min	5 min

*for use with site wide Dusk to Dawn control

PER Table

Control	PER (3 wire)	PER5 (5 wire)			PER7 (7 wire)		
			Wire 4/Wire5		Wire 4/Wire5	Wire 6/Wire7	
Photocontrol Only (On/Off)	✓	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM	⊘	✓	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM with Motion	⊘	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof*	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof* with Motion	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	

✓ Recommended

⊘ Will not work

⚠ Alternate

*Futureproof means: Ability to change controls in the future.



Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts.


Performance Package	System Watts (MVOLT*)	Dist. Type	27K (2700K, 70 CRI)					30K (3000K, 70 CRI)					40K (4000K, 70 CRI)					50K (5000K, 70 CRI)				
			Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW
P1	12W	VF	1,494	0	0	0	125	1,529	0	0	0	127	1,639	0	0	0	137	1,639	0	0	0	137
			VW	1,513	0	0	0	126	1,548	0	0	0	129	1,659	0	0	0	138	1,660	0	0	0
P2	25W	VF	3,163	1	0	1	127	3,237	1	0	1	129	3,469	1	0	1	139	3,468	1	0	1	139
			VW	3,201	1	0	0	128	3,276	1	0	0	131	3,512	1	0	0	140	3,512	1	0	0
P3	50W	VF	6,025	1	0	1	121	6,165	1	0	1	123	6,609	1	0	1	132	6,607	1	0	1	132
			VW	6,098	1	0	1	122	6,240	1	0	1	125	6,689	1	0	1	134	6,691	1	0	1



Isofootcandle plots for the WST LED P3 40K VF and VW. Distances are in units of mounting height (10').

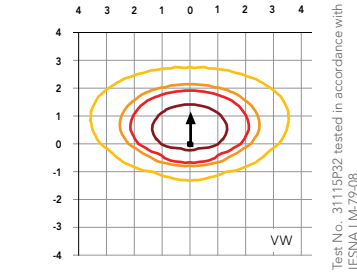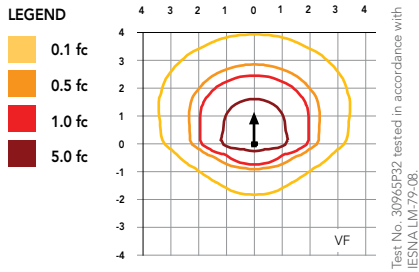

Distribution overlay comparison to 175W metal halide.

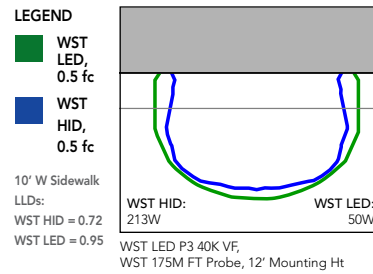

FEATURES & SPECIFICATIONS

INTENDED USE

The classic architectural shape of the WST LED was designed for applications such as hospitals, schools, malls, restaurants, and commercial buildings. The long life LEDs and driver make this luminaire nearly maintenance-free.

CONSTRUCTION

The single-piece die-cast aluminum housing integrates secondary heat sinks to optimize thermal transfer from the internal light engine heat sinks and promote long life. The driver is mounted in direct contact with the casting for a low operating temperature and long life. The die-cast door frame is fully gasketed with a one-piece solid silicone gasket to keep out moisture and dust, providing an IP65 rating for the luminaire.

FINISH

Exterior parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a minimum 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Standard Super Durable colors include dark bronze, black, natural aluminum, sandstone and white. Available in textured and non-textured finishes.

OPTICS

Well crafted reflector optics allow the light engine to be recessed within the luminaire, providing visual comfort, superior distribution, uniformity, and spacing in wall-mount applications. The WST LED has zero uplight and qualifies as a Nighttime Friendly™ product, meaning it is consistent with the LEED® and Green Globes™ criteria for eliminating wasteful uplight.

ELECTRICAL

Light engine(s) consist of 98 high-efficacy LEDs mounted to a metal core circuit board and integral aluminum heat sinks to maximize heat dissipation and promote long life (100,000 hrs at 40°C, L87). Class 2 electronic driver has a power factor >90%, THD <20%. Easily-serviceable surge protection device meets a minimum Category B (per ANSI/IEEE C62.41.2).

INSTALLATION

A universal mounting plate with integral mounting support arms allows the fixture to hinge down for easy access while making wiring connections.

LISTINGS

CSA certified to U.S. and Canadian standards. Luminaire is IP65 rated. PIR and back box options are rated for wet location. Rated for -30°C to 40°C ambient.

DesignLights Consortium® (DLC) Premium qualified product. Not all versions of this product may be DLC Premium qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.

BUY AMERICAN

Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT. Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY

5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.





DEVELOPMENT APPLICATION

City of Rockwall
Planning and Zoning Department
385 S. Goliad Street
Rockwall, Texas 75087

STAFF USE ONLY

PLANNING & ZONING CASE NO.

NOTE: THE APPLICATION IS NOT CONSIDERED ACCEPTED BY THE CITY UNTIL THE PLANNING DIRECTOR AND CITY ENGINEER HAVE SIGNED BELOW.

DIRECTOR OF PLANNING:

CITY ENGINEER:

PLEASE CHECK THE APPROPRIATE BOX BELOW TO INDICATE THE TYPE OF DEVELOPMENT REQUEST [SELECT ONLY ONE BOX]:

PLATTING APPLICATION FEES:

- MASTER PLAT (\$100.00 + \$15.00 ACRE) ¹
- PRELIMINARY PLAT (\$200.00 + \$15.00 ACRE) ¹
- FINAL PLAT (\$300.00 + \$20.00 ACRE) ¹
- REPLAT (\$300.00 + \$20.00 ACRE) ¹
- AMENDING OR MINOR PLAT (\$150.00)
- PLAT REINSTATEMENT REQUEST (\$100.00)

SITE PLAN APPLICATION FEES:

- SITE PLAN (\$250.00 + \$20.00 ACRE) ¹
- AMENDED SITE PLAN/ELEVATIONS/LANDSCAPING PLAN (\$100.00)

ZONING APPLICATION FEES:

- ZONING CHANGE (\$200.00 + \$15.00 ACRE) ¹
- SPECIFIC USE PERMIT (\$200.00 + \$15.00 ACRE) ^{1 & 2}
- PD DEVELOPMENT PLANS (\$200.00 + \$15.00 ACRE) ¹

OTHER APPLICATION FEES:

- TREE REMOVAL (\$75.00)
- VARIANCE REQUEST/SPECIAL EXCEPTIONS (\$100.00) ²

NOTES:

¹: IN DETERMINING THE FEE, PLEASE USE THE EXACT ACREAGE WHEN MULTIPLYING BY THE PER ACRE AMOUNT. FOR REQUESTS ON LESS THAN ONE ACRE, ROUND UP TO ONE (1) ACRE.
²: A \$1,000.00 FEE WILL BE ADDED TO THE APPLICATION FEE FOR ANY REQUEST THAT INVOLVES CONSTRUCTION WITHOUT OR NOT IN COMPLIANCE TO AN APPROVED BUILDING PERMIT.

PROPERTY INFORMATION [PLEASE PRINT]

ADDRESS 2727 S. John King Blvd, Rockwall, TX 75032

SUBDIVISION Rockwall Heath High School 9th Grade Center

LOT 1 BLOCK A

GENERAL LOCATION Rockwall 9th Grade Center - South site - at the Gene Burton Academy

ZONING, SITE PLAN AND PLATTING INFORMATION [PLEASE PRINT]

CURRENT ZONING AG CURRENT USE PUBLIC SCHOOL

PROPOSED ZONING NEIGHBORHOOD SERVICES PROPOSED USE PUBLIC SCHOOL

ACREAGE 27.446 LOTS [CURRENT] 1 LOTS [PROPOSED] 1

- SITE PLANS AND PLATS:** BY CHECKING THIS BOX YOU ACKNOWLEDGE THAT DUE TO THE PASSAGE OF HB3167 THE CITY NO LONGER HAS FLEXIBILITY WITH REGARD TO ITS APPROVAL PROCESS, AND FAILURE TO ADDRESS ANY OF STAFF'S COMMENTS BY THE DATE PROVIDED ON THE DEVELOPMENT CALENDAR WILL RESULT IN THE DENIAL OF YOUR CASE.

OWNER/APPLICANT/AGENT INFORMATION [PLEASE PRINT/CHECK THE PRIMARY CONTACT/ORIGINAL SIGNATURES ARE REQUIRED]

OWNER Rockwall Independent School District APPLICANT Glenn Engineering Corp.

CONTACT PERSON William Salee - Executive Director of Operations

CONTACT PERSON Robert Howman

ADDRESS 1191 T.L. Townsend Drive

ADDRESS 4500 Fuller Drive

Suite 220

CITY, STATE & ZIP Rockwall, Texas 75087

CITY, STATE & ZIP Irving, Texas 75038

PHONE 469-698-7031

PHONE 972-989-2174 cell

E-MAIL will.salee@rockwallisd.org

E-MAIL rahowman@glennengineering.com

NOTARY VERIFICATION [REQUIRED]

BEFORE ME, THE UNDERSIGNED AUTHORITY, ON THIS DAY PERSONALLY APPEARED Will Salee [OWNER] THE UNDERSIGNED, WHO STATED THE INFORMATION ON THIS APPLICATION TO BE TRUE AND CERTIFIED THE FOLLOWING:


I HEREBY CERTIFY THAT I AM THE OWNER FOR THE PURPOSE OF THIS APPLICATION; ALL INFORMATION SUBMITTED HEREIN IS TRUE AND CORRECT; AND THE APPLICATION FEE OF \$ 100.00 TO COVER THE COST OF THIS APPLICATION, HAS BEEN PAID TO THE CITY OF ROCKWALL ON THIS THE 19th DAY OF August, 2022. BY SIGNING THIS APPLICATION, I AGREE THAT THE CITY OF ROCKWALL (I.E. "CITY") IS AUTHORIZED AND PERMITTED TO PROVIDE INFORMATION CONTAINED WITHIN THIS APPLICATION TO THE PUBLIC. THE CITY IS ALSO AUTHORIZED AND PERMITTED TO REPRODUCE ANY COPYRIGHTED INFORMATION SUBMITTED IN CONJUNCTION WITH THIS APPLICATION, IF SUCH REPRODUCTION IS ASSOCIATED OR IN RESPONSE TO A REQUEST FOR PUBLIC INFORMATION."


GIVEN UNDER MY HAND AND SEAL OF OFFICE ON THIS THE 19th DAY OF August, 2022

OWNER'S SIGNATURE

NOTARY PUBLIC IN AND FOR THE STATE OF TEXAS

[Signature]
Diana Chapman

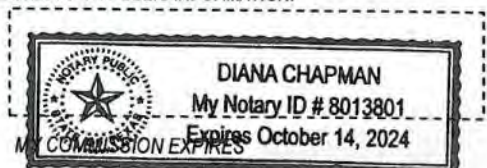

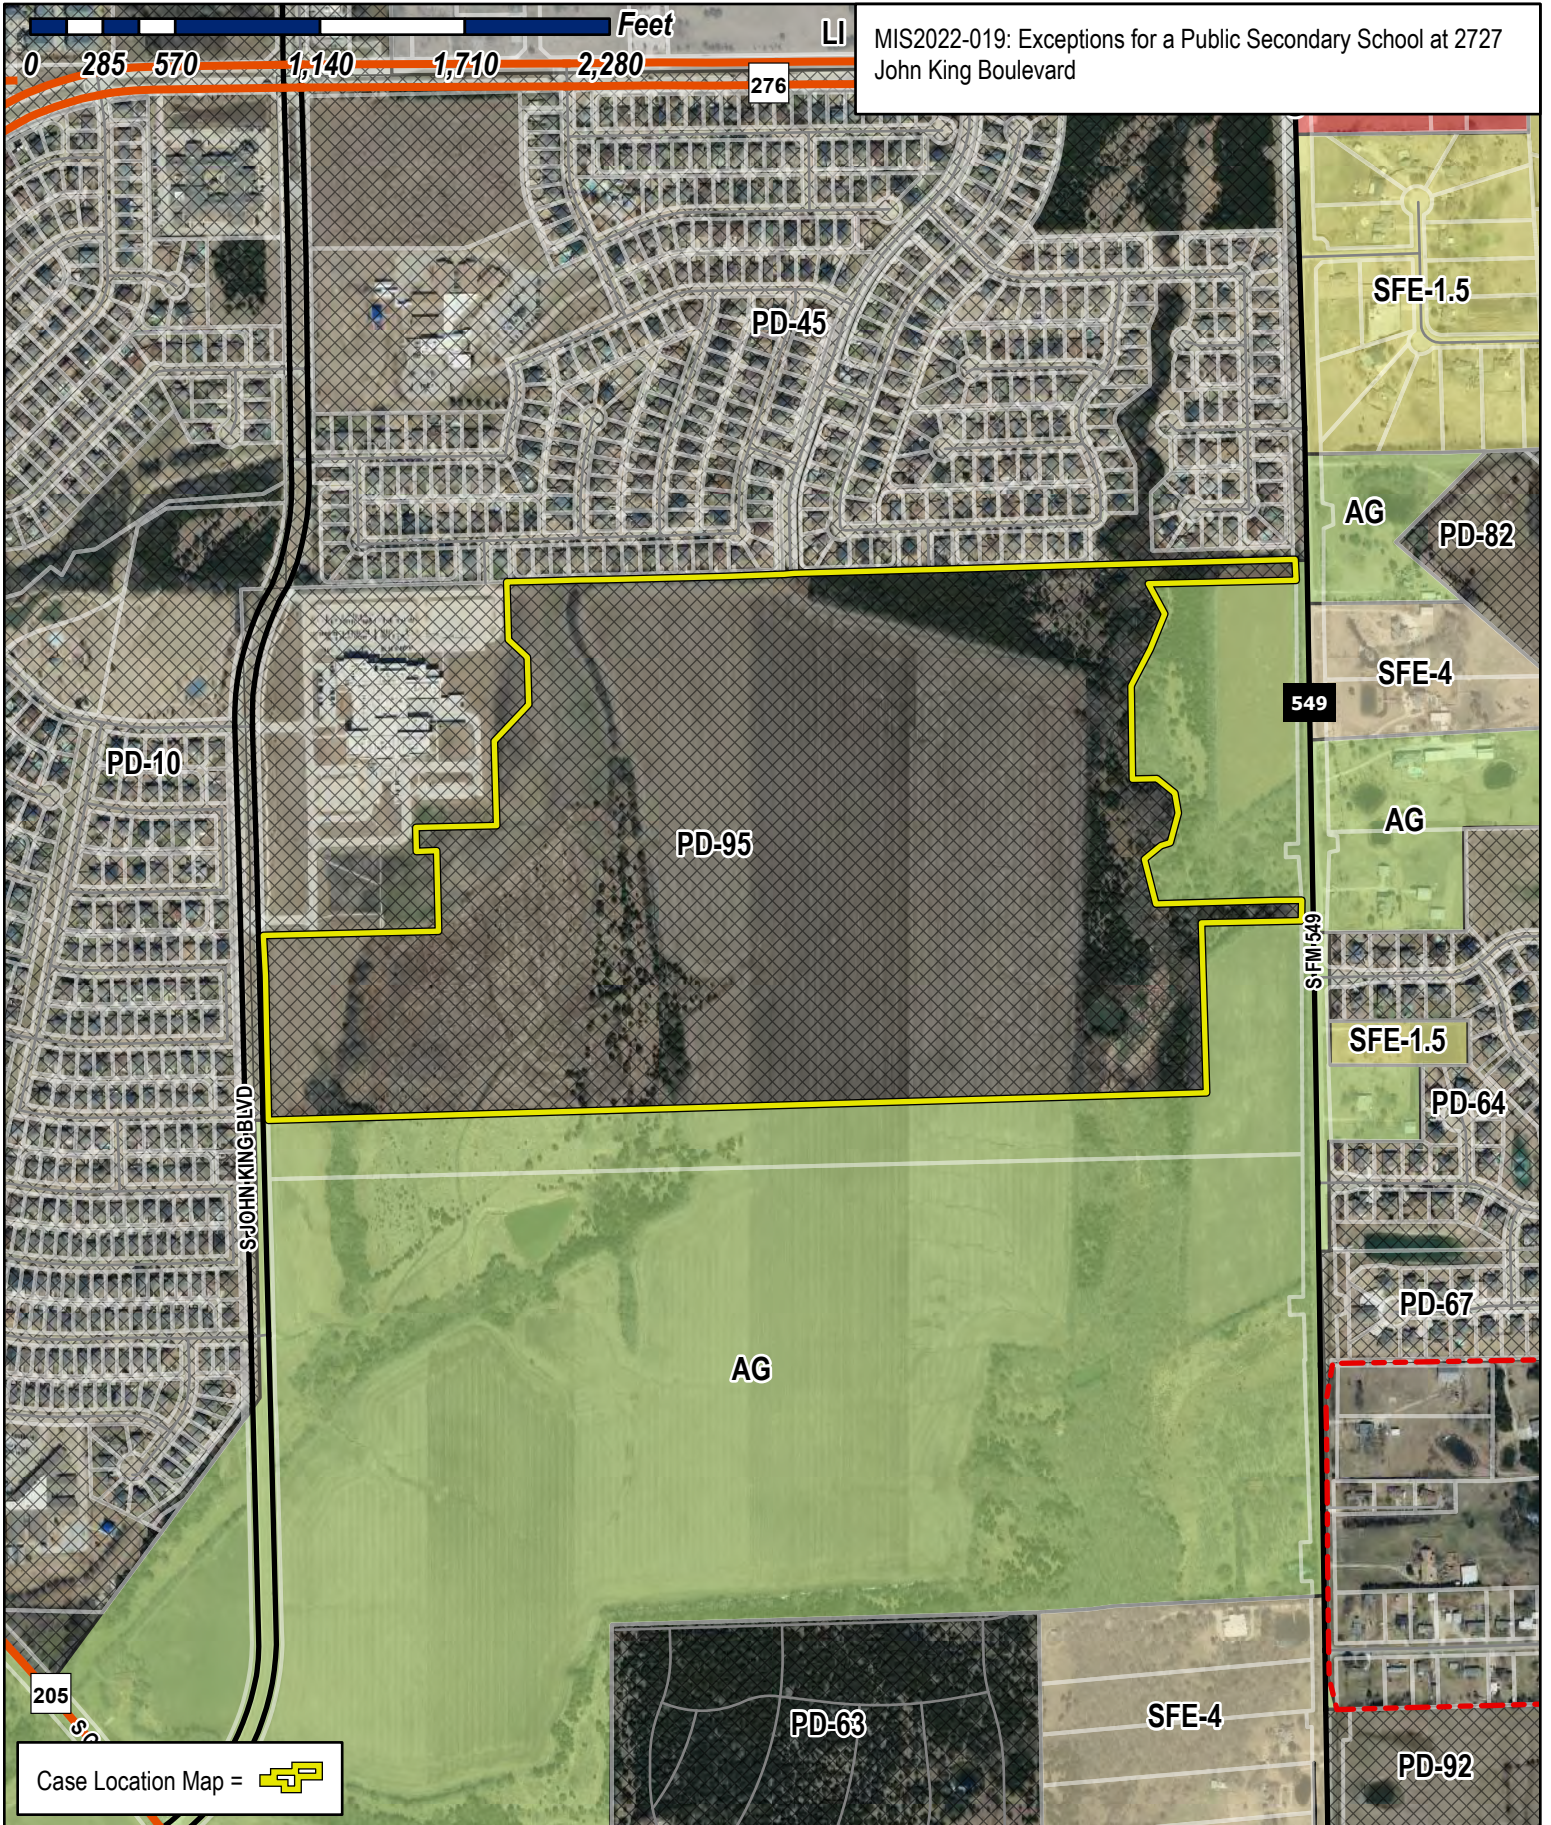

City of Rockwall

Planning & Zoning Department
 385 S. Goliad Street
 Rockwall, Texas 75032
 (P): (972) 771-7745
 (W): www.rockwall.com

The City of Rockwall GIS maps are continually under development and therefore subject to change without notice. While we endeavor to provide timely and accurate information, we make no guarantees. The City of Rockwall makes no warranty, express or implied, including warranties of merchantability and fitness for a particular purpose. Use of the information is the sole responsibility of the user.





August 19, 2022

Ryan Miller
Director of Planning
City of Rockwall
385 South Goliad
Rockwall, TX 75087

**Rockwall ISD – Updated Site Plans for Ninth Grade Center Projects:
SP 2022-17 (FM1141& Quail Run) & SP2022-18 (John King Blvd at GBCCA)**

Mr. Miller,

Per recent site plan approval for the above referenced projects on July 12, 2022 by the Planning & Zoning Commission, there were the following conditional approval items noted by the city staff that are to be addressed related to landscape plan requirements and sports field/court lighting:

North Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing landscaping along the right-of-way of Panhandle Drive (i.e. berms and shrubbery with a minimum of one [1] canopy tree and one [1] accent tree per 50-feet of linear frontage). In addition, the Landscape Plan should show one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

South Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

Rockwall ISD is submitting updated landscape plans showing the number and location of proposed trees to include in regards to the detention areas. The North plan submitted with this letter includes the required landscaping along the Panhandle Drive right of way as required.

Landscape Plan – Detention Areas

Rockwall ISD is requesting a partial variance for consideration by the Planning & Zoning Commission. The space available around the perimeter of the detention pond is limited due to the required location on the site for these detention areas. At both sites, 3-tiered screening elements are adjacent to the detention areas limiting the amount of trees that can feasibly fit around and near the detention basin. Forcing trees in this area will create a scenario where tree canopy growth will inhibit any ground cover, reduce tree health, and increase the likelihood of erosion due to the lack of groundcover. All other required trees for the 3-tier screening and required parking lot trees are shown to be provided and we will be in compliance. As a result, the district is asking for the following variance:

Approval to disperse throughout the site as many of the required detention canopy and accent trees in open areas possible that are not reserved for future potential building expansions and in a manner that will not create a hazard, nuisance or erosion issue. Once those spaces are exhausted we propose to then omit the following numbers of trees per site:



North Site:

Number of Required Detention Trees: (155) Number of trees proposed to be planted: (101)
Omit (36) Canopy Trees & (18) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (162) Canopy Trees & (245) Accent Trees: (407) Total for Screening
- Required Trees at Parking Areas: (39) Canopy Trees

Total Number of Trees to be planted if variance is approved: (547) Total North Site Trees

South Site:

Number of Required Detention Trees: (198) Number of trees proposed to be planted: (132)
Omit (43) Canopy Trees & (23) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (234) Canopy Trees & (70) Accent Trees: (304) Total for Screening
- Required Trees at Parking Areas: (53) Canopy Trees

Total Number of Trees to be planted if variance is approved: (489) Total South Site Trees

In lieu of investing resources in dispersed trees that do not serve the purpose of beautifying the detention area and would have to be removed in the future, the district would like to direct those resources to beautifying and creating community accessible amenities for the detention areas in the following ways as an alternate compliance method for consideration:

1. Create a Wet Pond - In lieu of a dry detention basin, the district would propose to make these a constant level wet retention pond while still functioning to detain runoff as required.
 - a. The pond would include an aeration fountain element
 - b. The pond would include circulation plumbing to minimize algae growth
 - c. The pond will have an organic shape and have a flagstone border
 - d. The district would utilize HVAC condensate collection to fill the pond in hot, humid summer & spring seasons where pond evaporation is the greatest.
2. Create Park Amenities -The district would create a park area that is accessible to the community off the adjacent thoroughfare (John King – South & Quail Run Road – North) from the required 10-foot wide walk pathways at both locations.
 - a. Please refer the provided rendered images of park areas for proposed aesthetics
 - b. Park area will include 10' meandering pathways to pond overlook areas
 - c. Park area will include multiple park bench seating areas off of walkways
 - d. Park area will include landscape boulders within park area as an enhanced landscape feature to reinforce a more natural park setting.

This alternative method proposed to beautify the pond would transform an otherwise unattractive drainage area on both sites to a park amenity that can be utilized by both the school district and the community and will ensure resources expended provide permanent beautification elements to the site. Rockwall ISD requests acceptance of this variance and the alternate compliance method in lieu of planting the partial amount of trees requested to be omitted at each site.



Sports Field Lighting – Exception Request

Per the above referenced comment, Rockwall ISD is requesting the following exceptions to install sports field lighting as necessary for utilization by the campus when daylight levels are not adequate for practice and game events:

1. Tennis Court Lighting – 40' above tennis court surface
2. Baseball Field Lighting – 70' above baseball field surface
3. Football/Soccer Field Lighting – 80' above field surface

Sports field lighting product data and photometric data are included in this request for review. All parking lot lighting at both site locations will be 25' above adjacent parking surfaces and be in compliance. The need for this exception request is to ensure light levels are adequate for these sports fields/courts for playability and safety.

The following mitigation items are proposed to be implemented:

1. Implementation of 3-tier landscape screening as required by City of Rockwall.
2. Intentional site location of fields on the property to minimize adjacency to the densest residential areas as possible as discussed in previous P&Z meetings.
3. Use of current LED sports field technology that allows LED lamps to be screened and focused on the play fields with minimal light spread beyond the field area.
4. Sports field/court lighting will be controlled by the district's energy management system. This will require users to make reservations to turn lights on and create the ability to have lockout times when lights cannot be used and the ability to turn off the fixtures remotely if required.

Rockwall ISD requests acceptance of the requested light pole height exceptions as proposed to ensure adequate playability of and safety of the field use.

I look forward to attending the Planning & Zoning Commission in person on August 30th to provide a presentation and address any questions the commission may have in regards to the districts proposed requests.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Will Salee', is written over a light blue horizontal line.

Will Salee
Executive Director of Operations

N89°00'23"E
34.15'
(DEED CALL
N89°49'51"E
36.45')

N88°21'21" E 3926.93'

PART OF 58
N.L. L6
VOL. 38,

L6



L2

L3

L5

L4

SITE DATA SUMMARY	
EXISTING ZONING	AG
PROPOSED ZONING	PD FOR NS USES (2002-015)
USE	PUBLIC SCHOOL
LOT AREA	3,464,762 S.F. OR 75.54 AC.
BUILDING AREA (FLOOR AREA)	
PROPOSED FIRST FLOOR	150,170 S.F.
PROPOSED SECOND FLOOR	41,019 S.F.
TOTAL BUILDING AREA	191,189 S.F.
TOTAL FLOOR AREA (FIRST FLOOR)	150,170 S.F.
LOT COVERAGE	150,170 S.F./3,464,762 S.F. = 4.33%
FLOOR AREA RATE	0.051
TOTAL IMPERVIOUS AREA	813,028.31 S.F. OR 18.66 AC.
BUILDING HEIGHT	137'-10" (2 STORY)
TOTAL REQUIRED PARKING (1 PER 5 STUDENTS)	203 SPACES
PARKING PROVIDED	
PARKING SURFACE	
9.0x18.0'	304 SPACES
9.0x20.0'	209 SPACES
15.0x30.0'	19 SPACES
TOTAL PARKING PROVIDED	532 SPACES

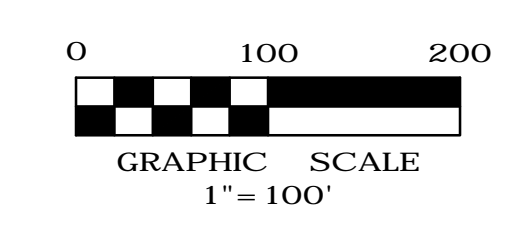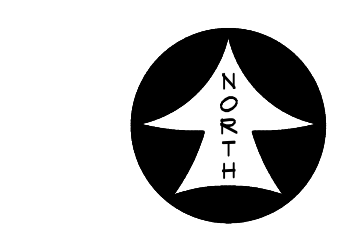

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMUO

CITY OF ROCKWALL CASE NO. SP2022-018

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS
RELEASED FOR PERMIT
REVIEW UNDER THE
AUTHORITY OF:
MICHAEL RAMSEY
REGISTERED LANDSCAPE
ARCHITECT #1901
IT IS NOT TO BE USED
FOR CONSTRUCTION
PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET


NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

**OVERALL
LANDSCAPE PLAN**


JOB 21572.0000
DATE 08/16/22
SHEET

L 1

MATCHLINE SEE SHEET L2

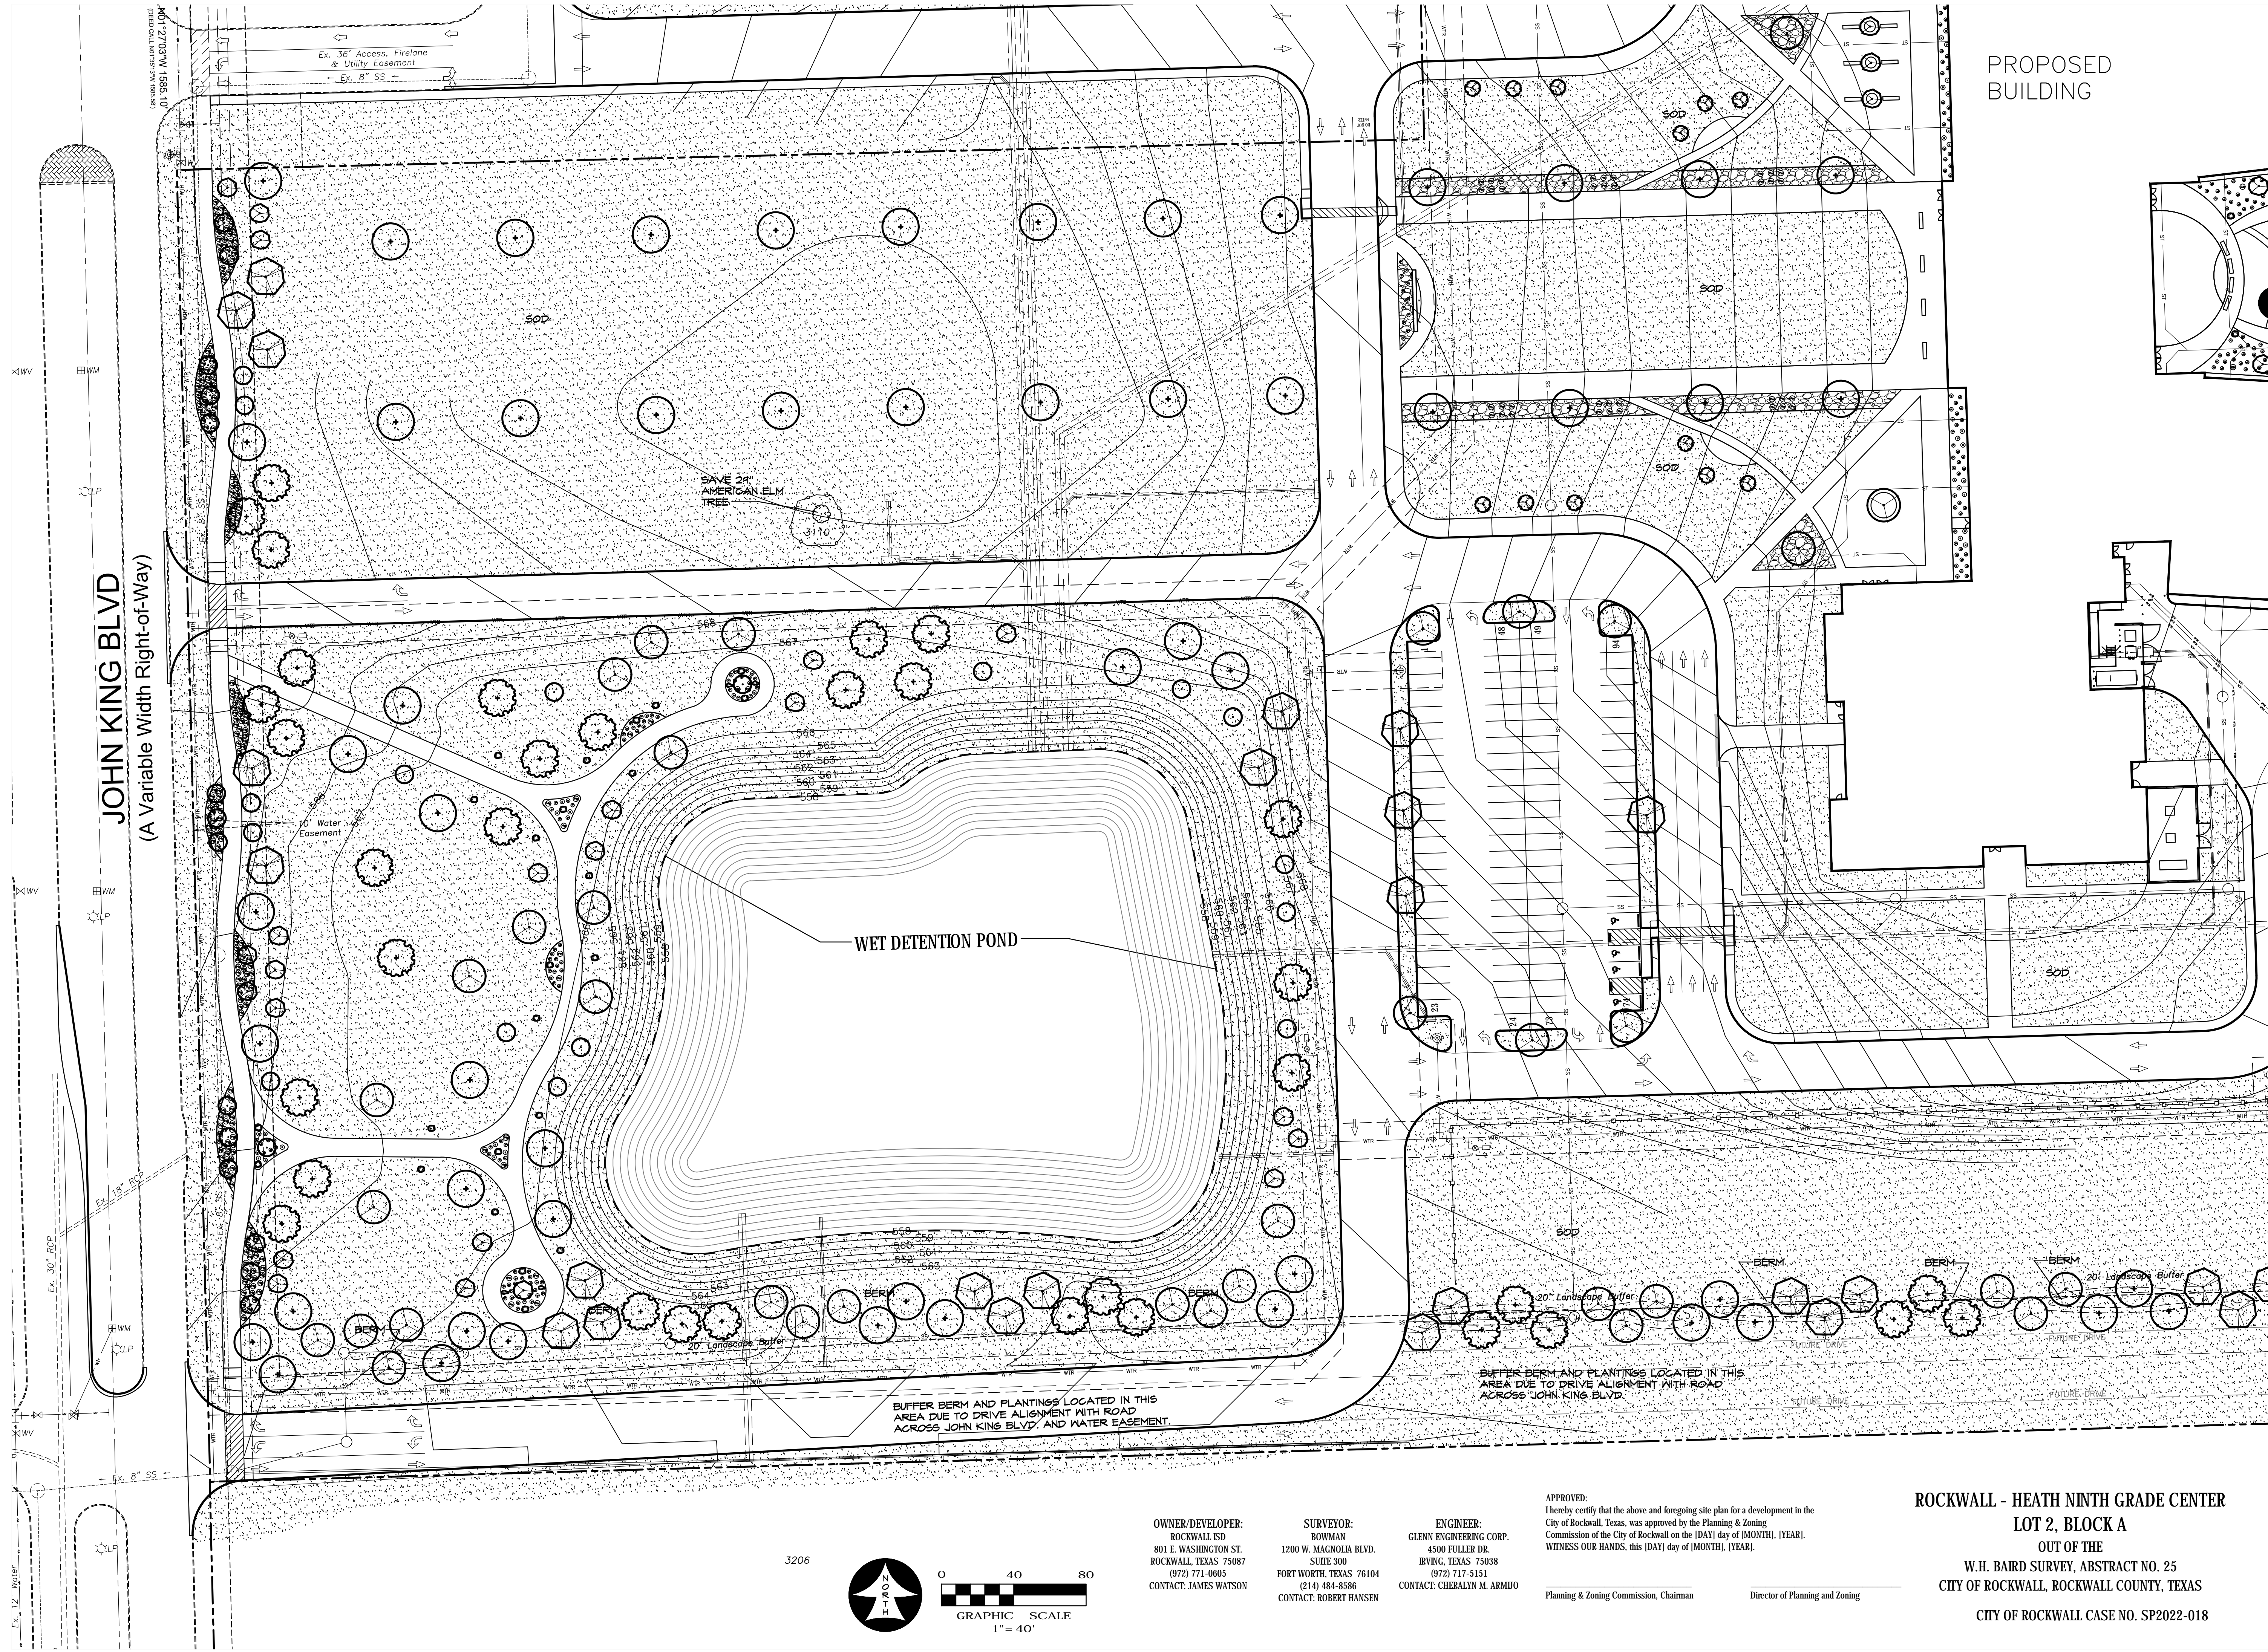

PROPOSED BUILDING

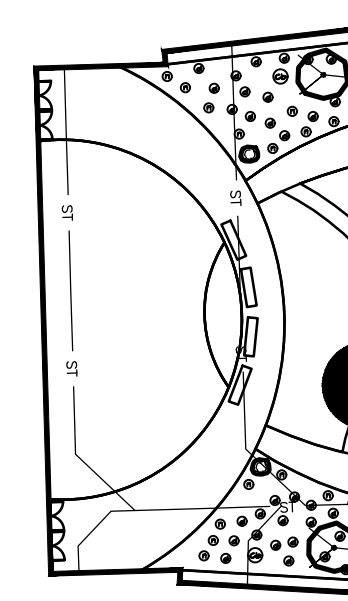

MATCHLINE SEE SHEET L4

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

LANDSCAPE PLAN
AREA B

JOB 21572.0000
DATE 08/16/22
SHEET

L 3

JOHN KING BLVD
(A Variable Width Right-of-Way)

WET DETENTION POND

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD. AND WATER EASEMENT.

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD.

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN


ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO


APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman
Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

3206

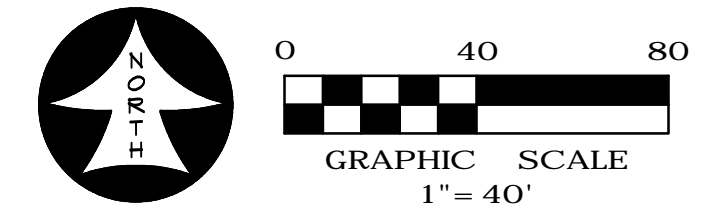

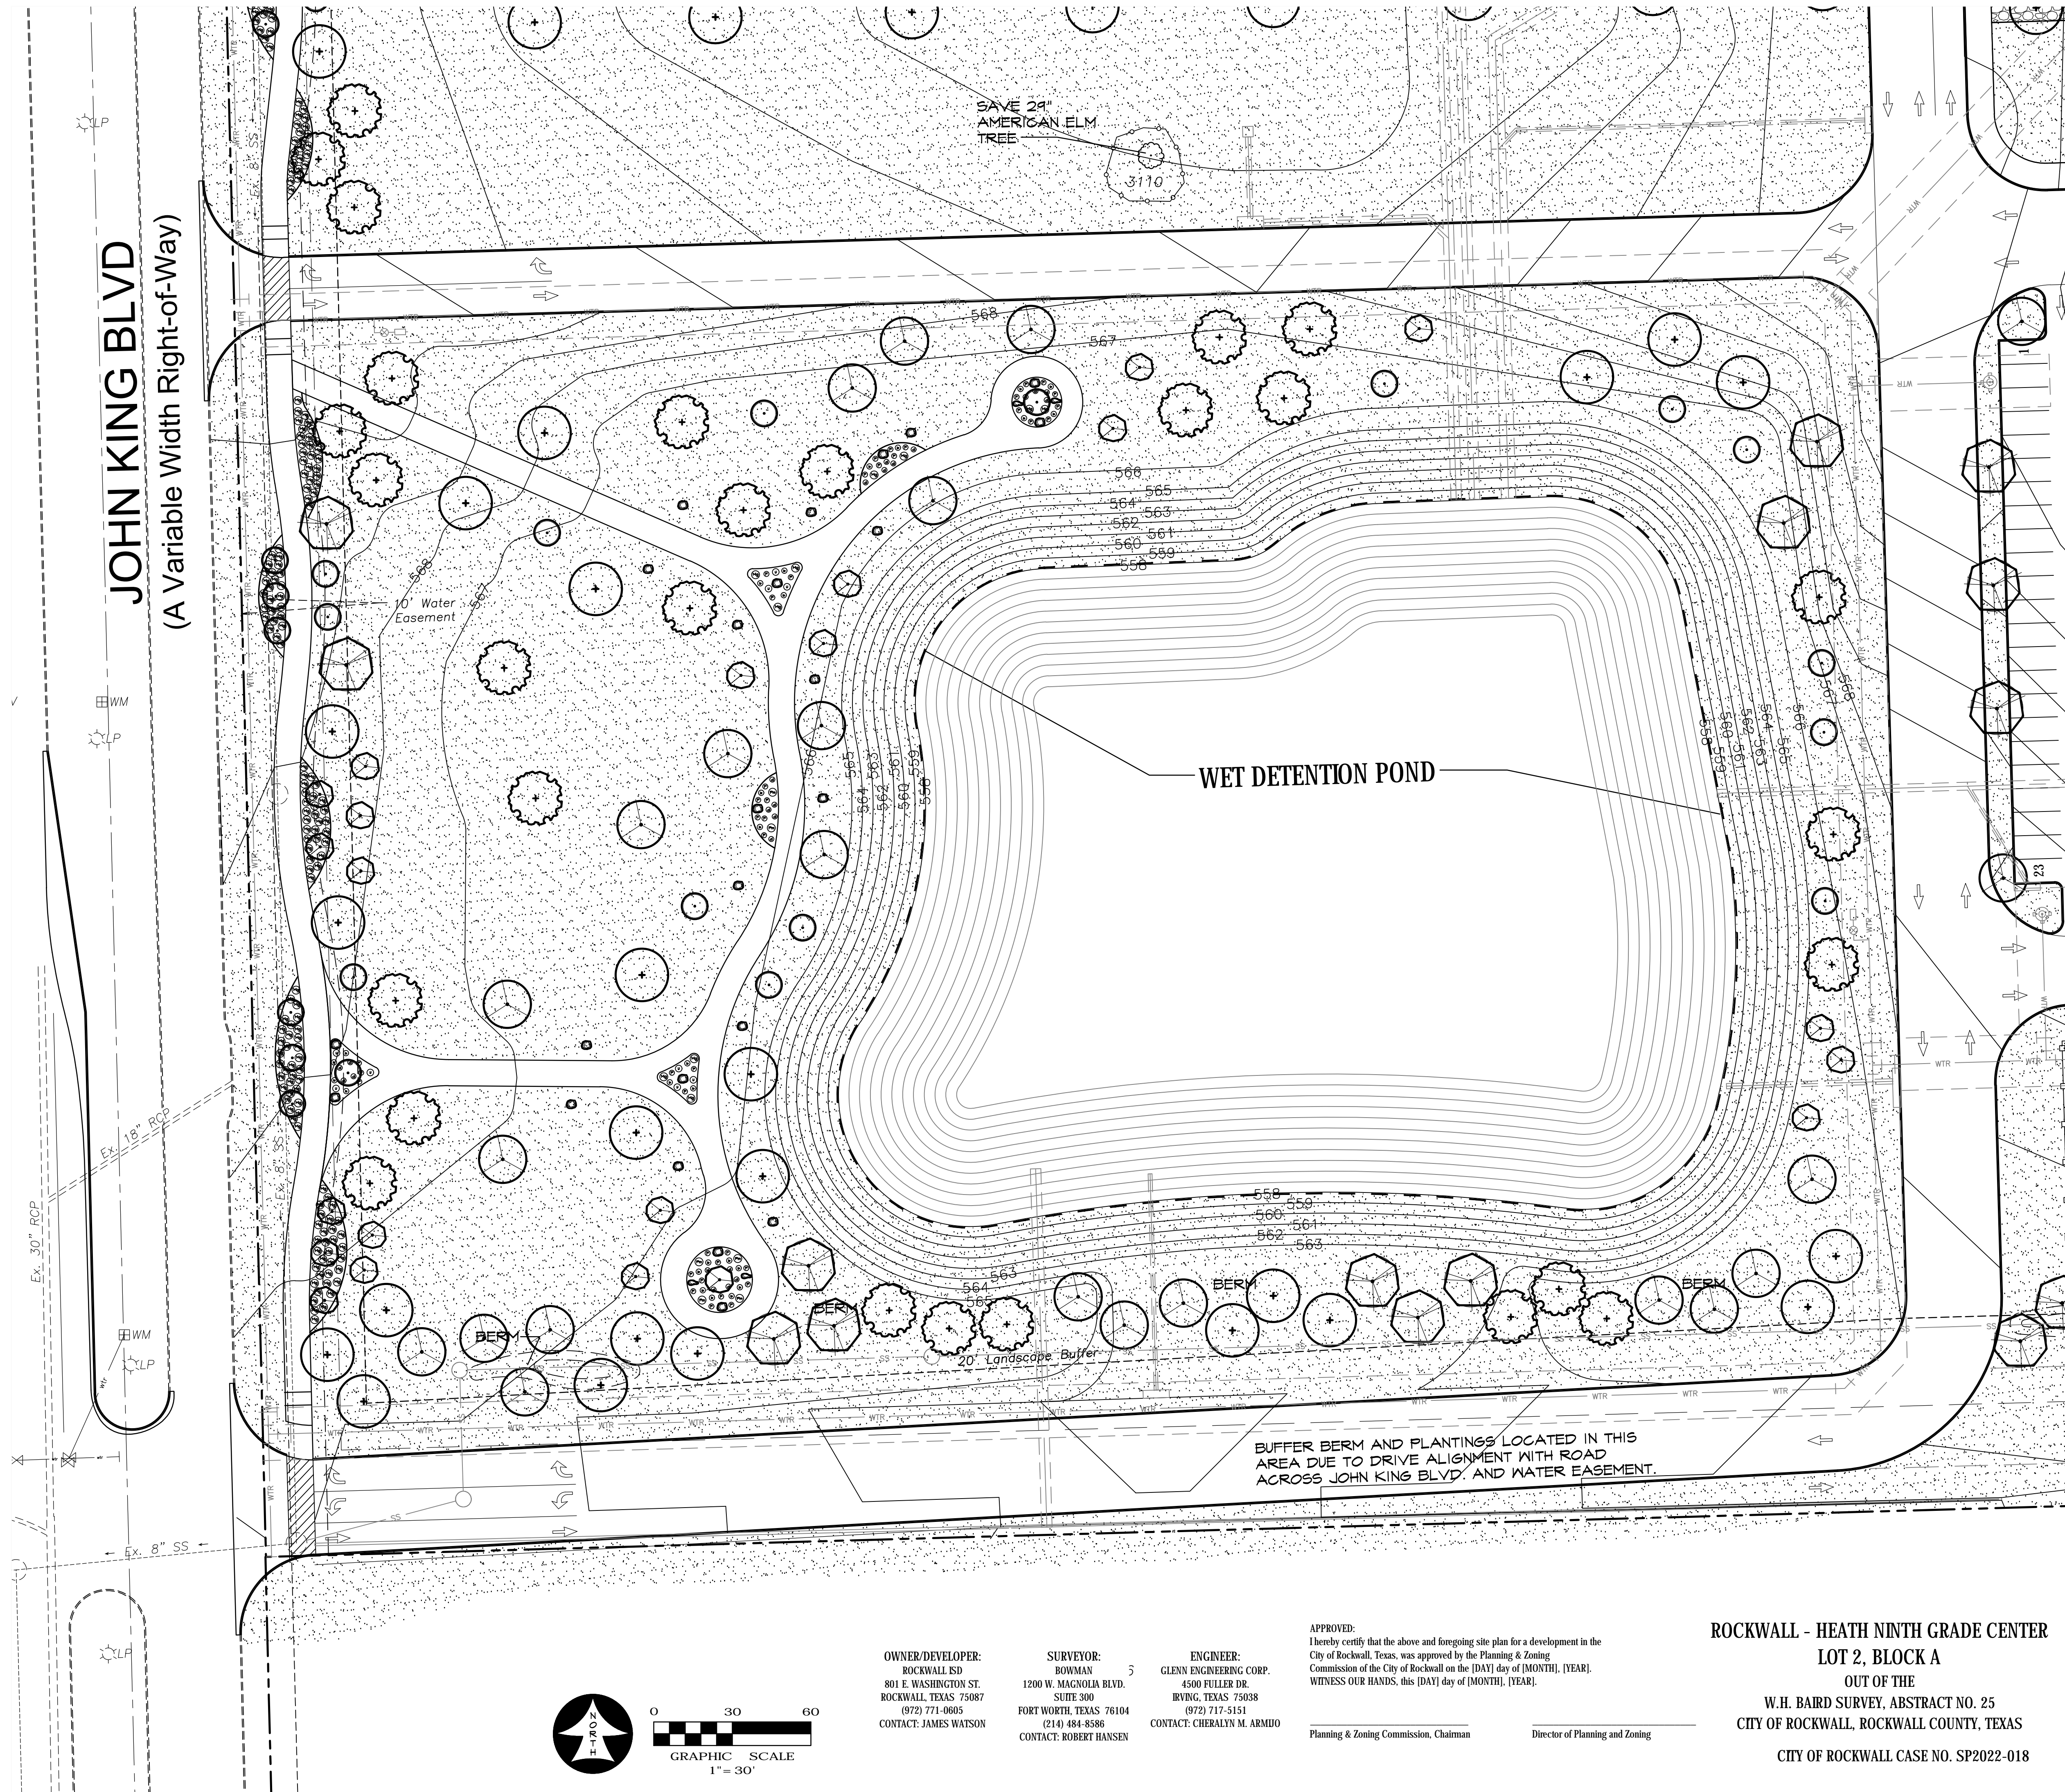

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES	
1	05/11/22 30% PROGRESS SET
2	07/06/22 60% PROGRESS SET
3	08/04/22 90% PROGRESS SET
4	08/16/22 95% PROGRESS SET
5	
6	

REVISIONS	

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S.John King Blvd, Rockwall, TX 75032

DETENTION ENLARGEMENT

JOB 21572.0000
DATE 08/16/22
SHEET

L 3B

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN


ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman

Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

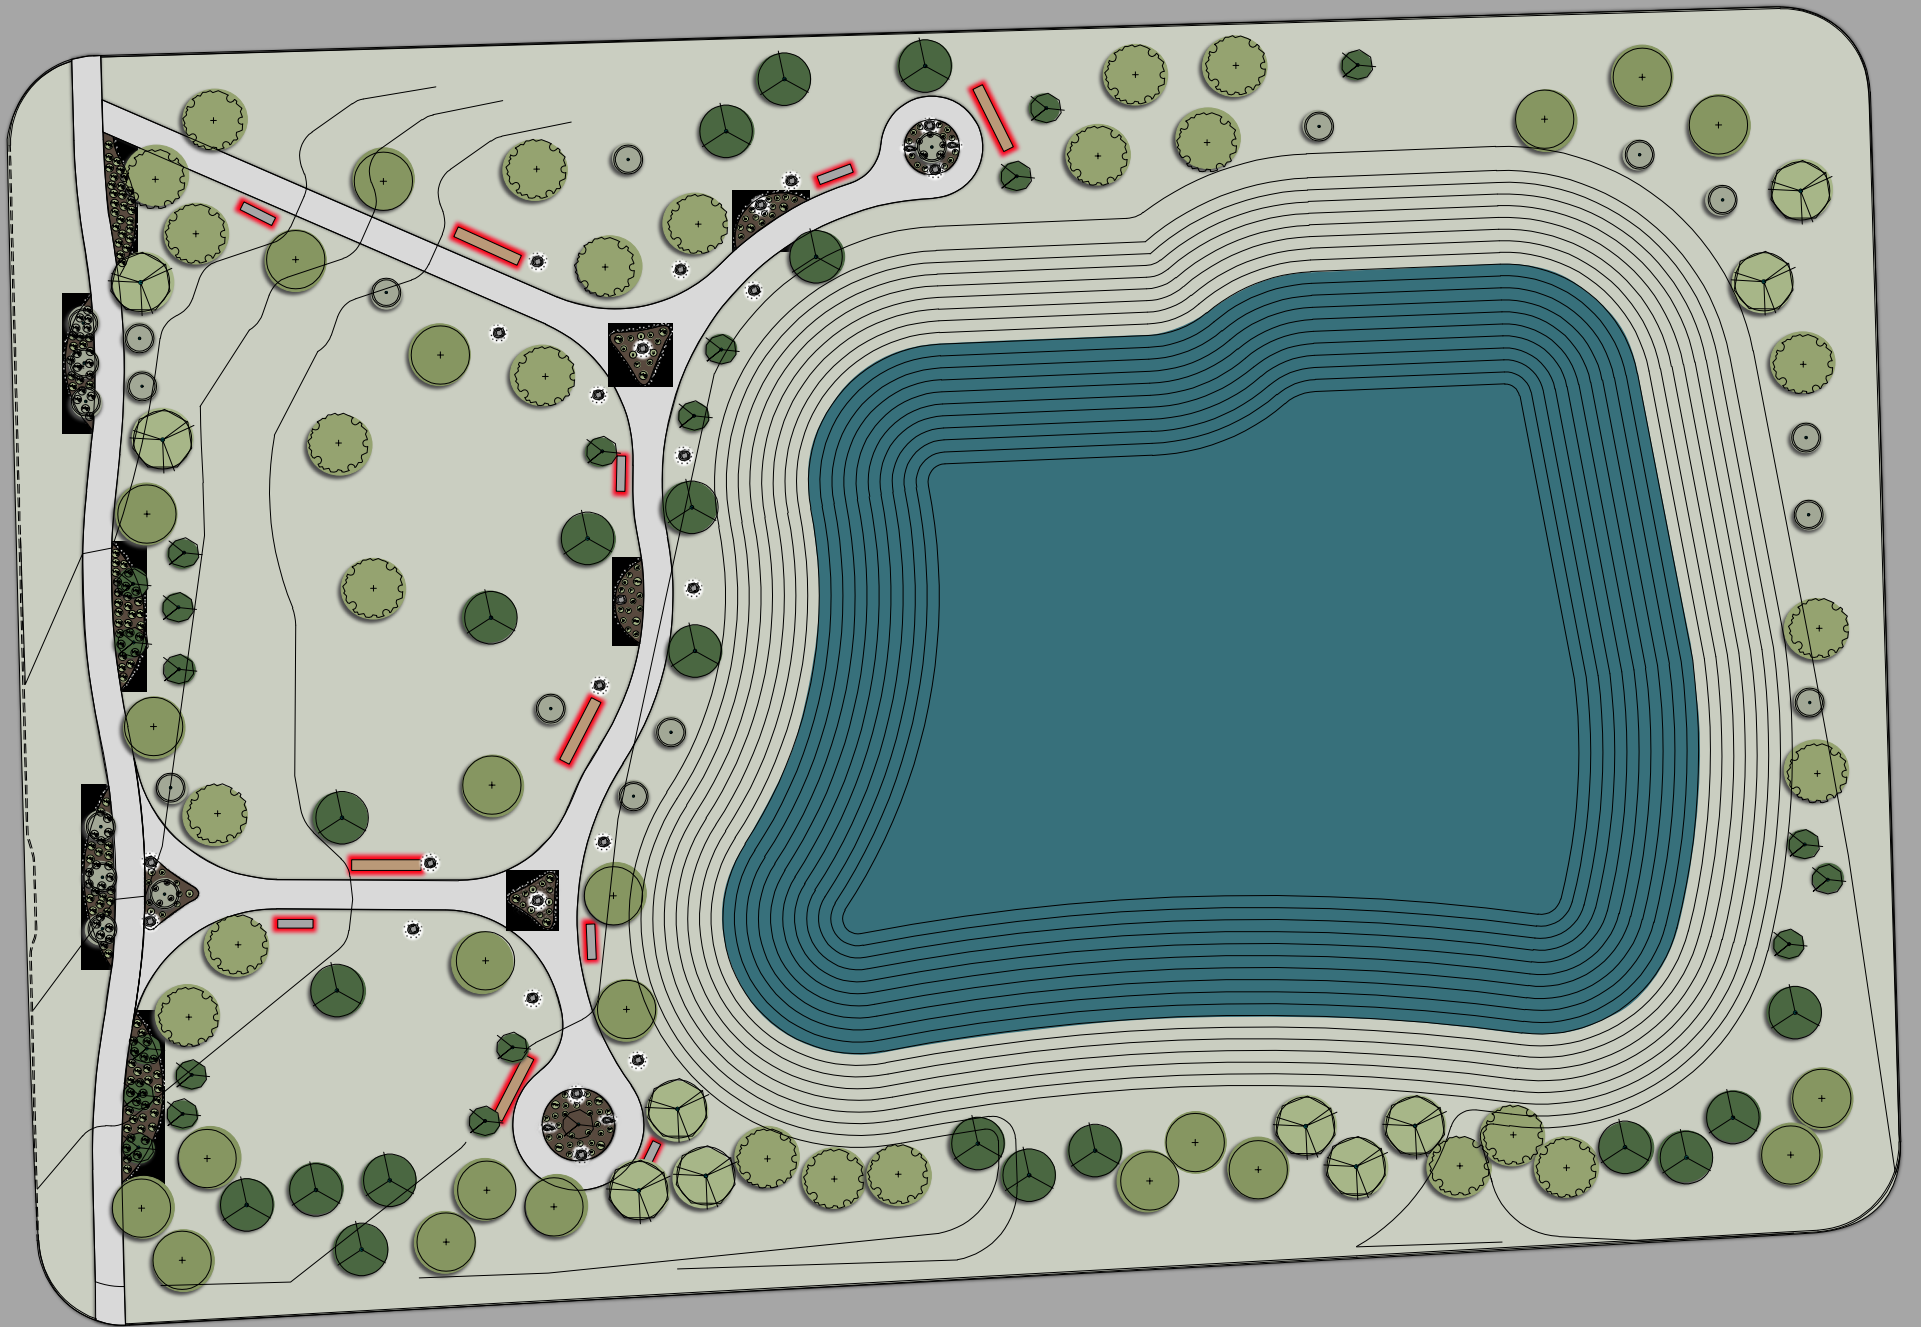





Rockwall ISD 9th Grade Center South

Rockwall, TX

Lighting System

Pole / Fixture Summary						
Pole ID	Pole Height	Mtg Height	Fixture Qty	Luminaire Type	Load	Circuit
A1-A2	70'	70'	4	TLC-LED-1500	5.72 kW	D
B1-B2	80'	16'	1	TLC-BT-575	0.58 kW	D
		80'	6	TLC-LED-1500	8.58 kW	D
C1-C2	70'	70'	3	TLC-LED-1200	3.51 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
D1-D2	70'	70'	4	TLC-LED-1200	4.68 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
F1-F4	80'	80'	7	TLC-LED-1500	10.01 kW	A
		16'	2	TLC-BT-575	1.15 kW	A
T1-T2	40'	40'	2	TLC-LED-600	1.16 kW	B
T3	40'	40'	2	TLC-LED-600	1.16 kW	B
		40'	2	TLC-LED-600	1.16 kW	C
T4	40'	40'	2	TLC-LED-600	1.16 kW	C
		40'	2	TLC-LED-600	1.16 kW	B
T5-T6	40'	40'	2	TLC-LED-600	1.16 kW	C
18			94		103.50 kW	

Circuit Summary			
Circuit	Description	Load	Fixture Qty
A	Football	44.64 kW	36
B	Tennis 1-2	4.64 kW	8
C	Tennis 3-4	4.64 kW	8
D	Baseball	49.58 kW	42

Fixture Type Summary							
Type	Source	Wattage	Lumens	L90	L80	L70	Quantity
TLC-LED-1500	LED 5700K - 75 CRI	1430W	160,000	>120,000	>120,000	>120,000	48
TLC-LED-1200	LED 5700K - 75 CRI	1170W	136,000	>120,000	>120,000	>120,000	14
TLC-BT-575	LED 5700K - 75 CRI	575W	52,000	>120,000	>120,000	>120,000	16
TLC-LED-600	LED 5700K - 75 CRI	580W	65,600	>120,000	>120,000	>120,000	16

Light Level Summary

Calculation Grid Summary								
Grid Name	Calculation Metric	Illumination					Circuits	Fixture Qty
		Ave	Min	Max	Max/Min	Ave/Min		
Baseball (Infield)	Horizontal Illuminance	52.7	39	69	1.75	1.35	D	42
Baseball (Outfield)	Horizontal Illuminance	33.4	26	45	1.75	1.28	D	42
Football	Horizontal Illuminance	36	31	43	1.40	1.16	A	36
Tennis 1-2	Horizontal Illuminance	37.5	30	48	1.61	1.25	B	8
Tennis 3-4	Horizontal Illuminance	37.1	30	49	1.64	1.24	C	8
Track	Horizontal Illuminance	18.7	3	38	11.34	6.22	A	36

From Hometown to Professional




EQUIPMENT LIST FOR AREAS SHOWN							
Pole				Luminaires			
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID / OTHER GRIDS
4	F1-F4	80'	-	15.5'	TLC-BT-575	2	2 0
				80'	TLC-LED-1500	7	7 0
4	TOTALS					36	36 0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Football
Size:	360' x 160'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
	Entire Grid
Guaranteed Average:	30
Scan Average:	35.95
Maximum:	43
Minimum:	31
Avg / Min:	1.17
Guaranteed Max / Min:	2.5
Max / Min:	1.40
UG (adjacent pts):	1.17
CU:	0.47
No. of Points:	72
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

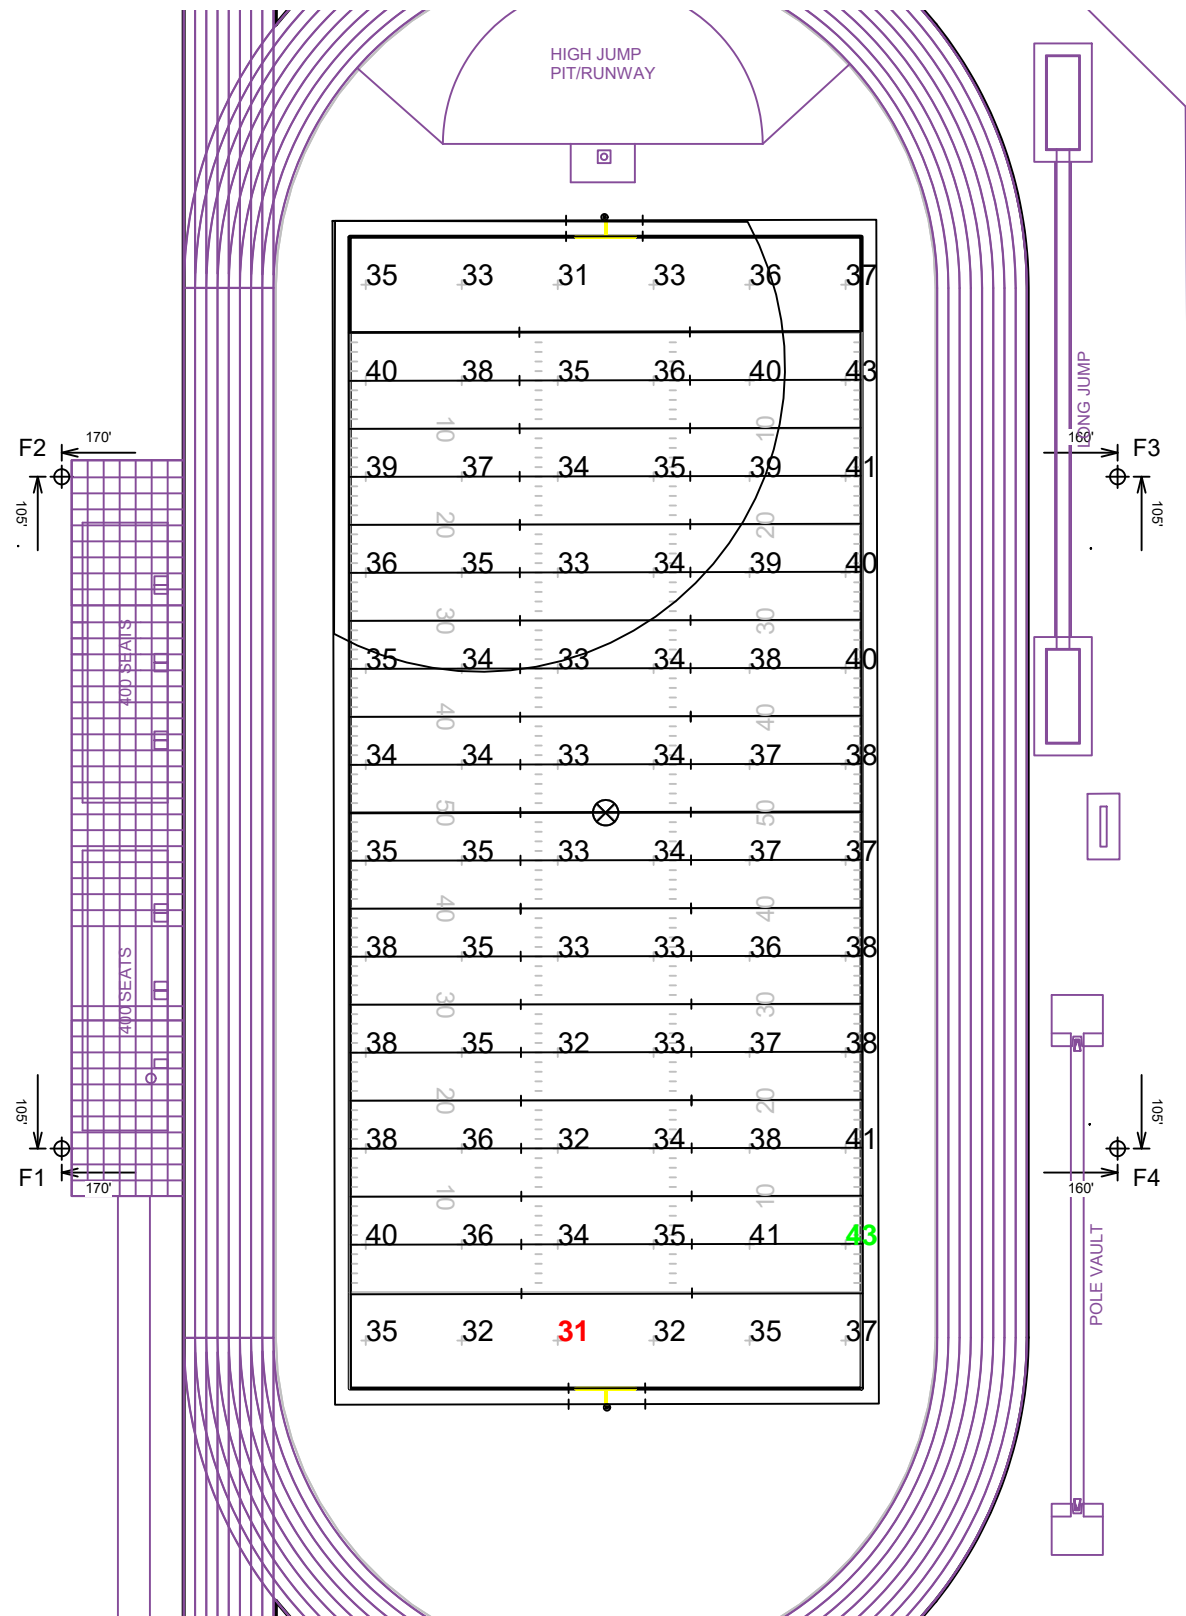


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY


EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
4	F1-F4	80'	0'	15.52'	TLC-BT-575	2	2	0
				80'	TLC-LED-1500	7	7	0
4	TOTALS					36	36	0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Track
Size:	Irregular
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Scan Average:	18.66
Maximum:	38
Minimum:	3
Avg / Min:	5.56
Max / Min:	11.34
UG (adjacent pts):	0.00
CU:	0.16
No. of Points:	48
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

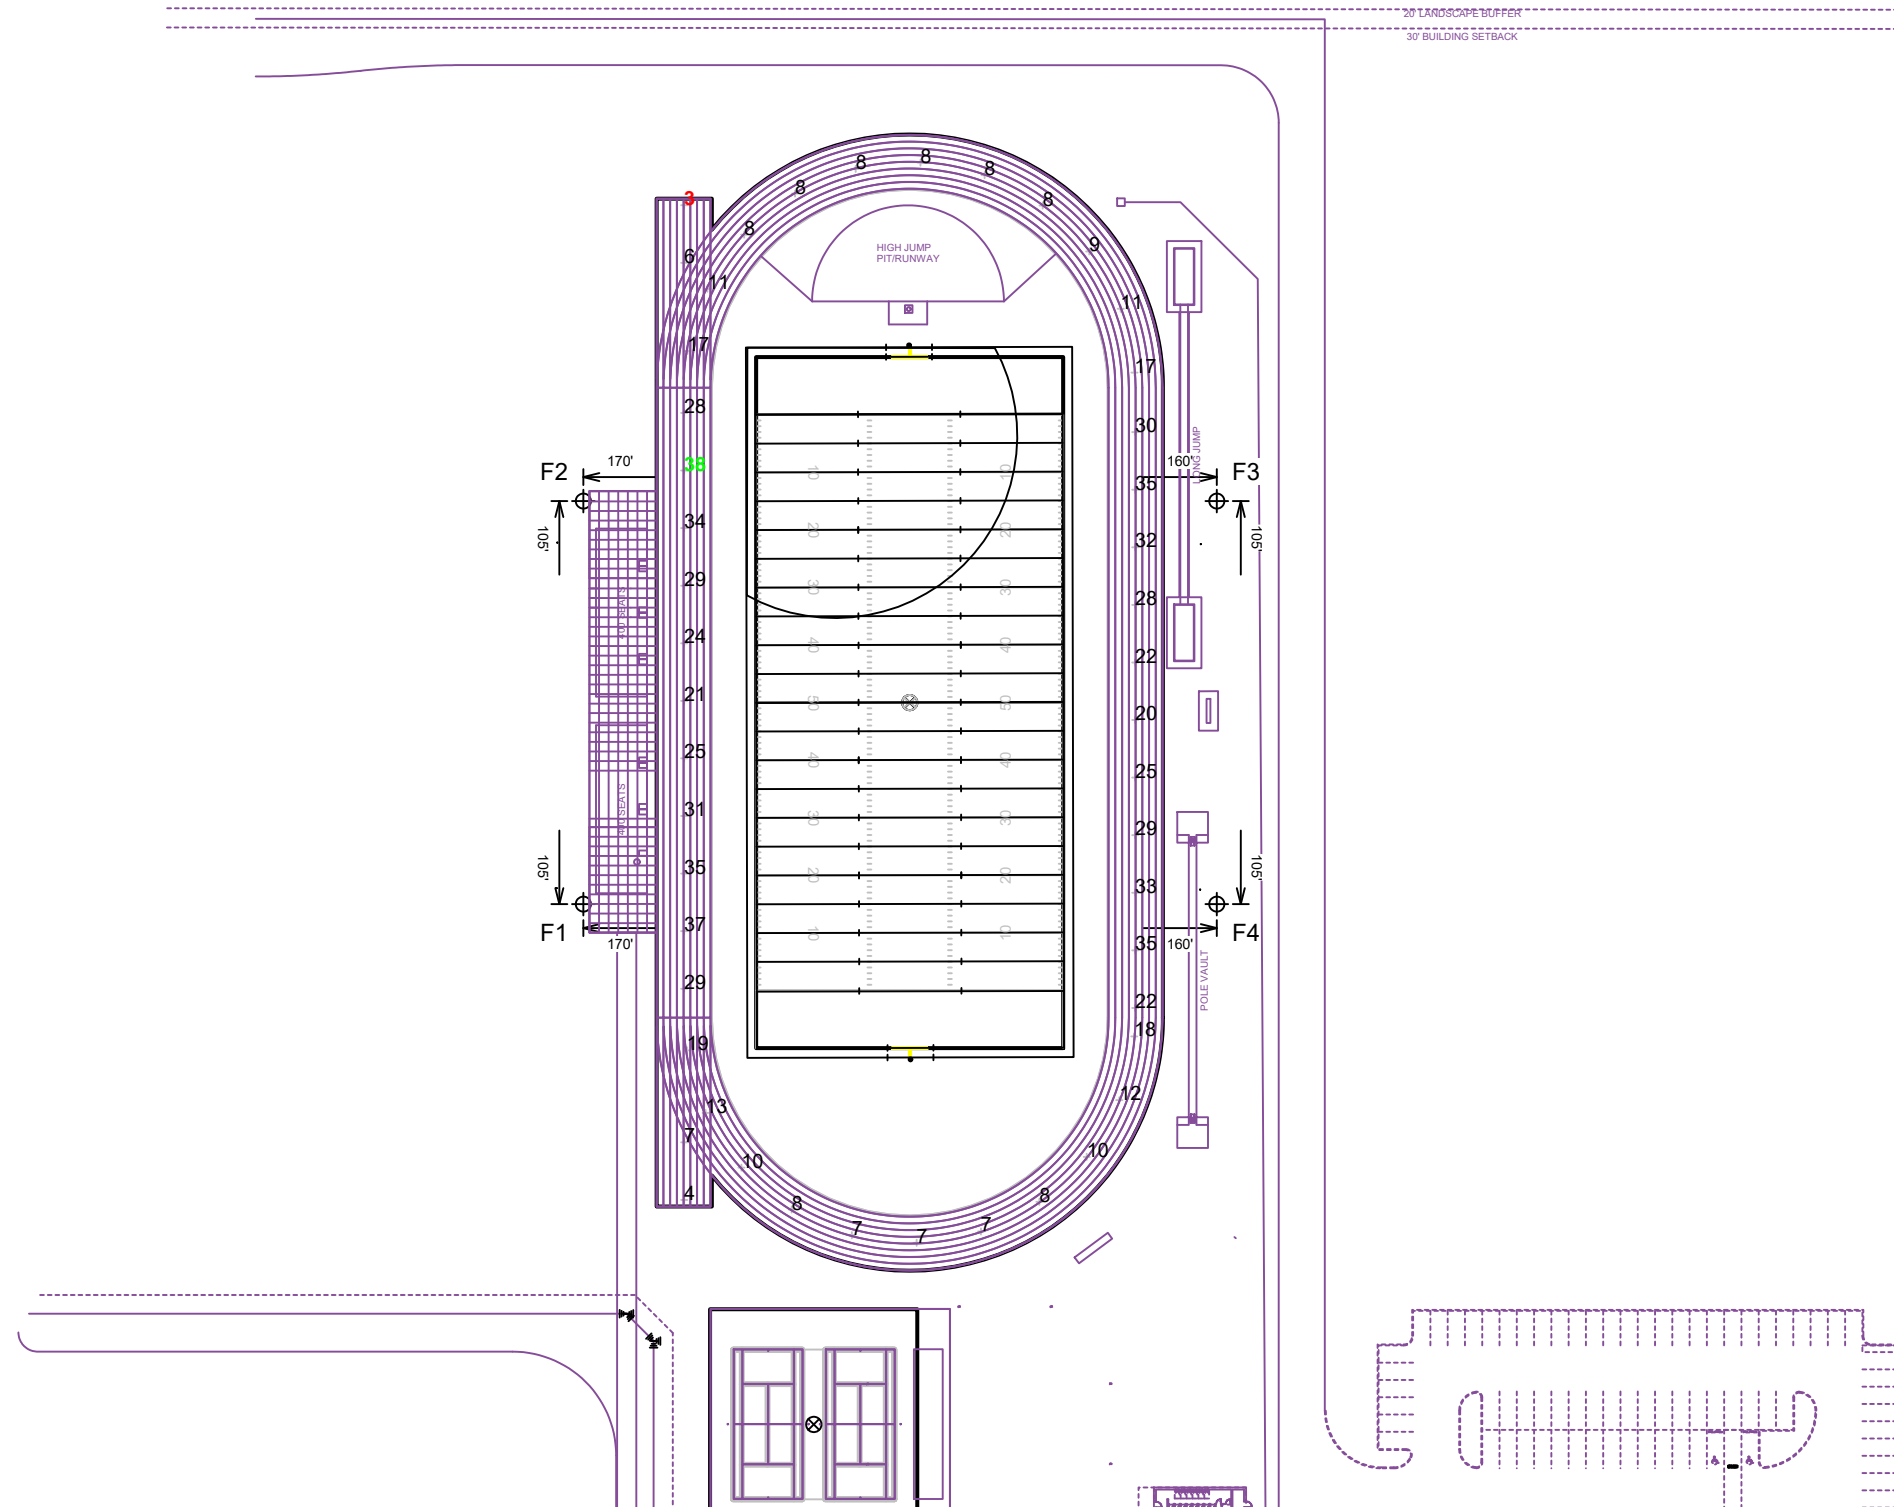


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume $\pm 3\%$ nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) \oplus dimensions are relative to 0,0 reference point(s) \otimes



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY

Rockwall ISD 9th Grade Center South
Rockwall, TX

EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T1-T2	40'	-	40'	TLC-LED-600	2	2	0
2	T3-T4	40'	-	40'	TLC-LED-600	4	2	2
4	TOTALS					12	8	4

GRID SUMMARY	
Name:	Tennis 1-2
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade




ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.52
Maximum:	48
Minimum:	30
Avg / Min:	1.26
Guaranteed Max / Min:	2.5
Max / Min:	1.61
UG (adjacent pts):	0.00
CU:	0.89
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	B
No. of Luminaires:	8
Total Load:	4.64 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

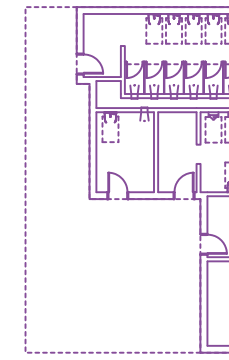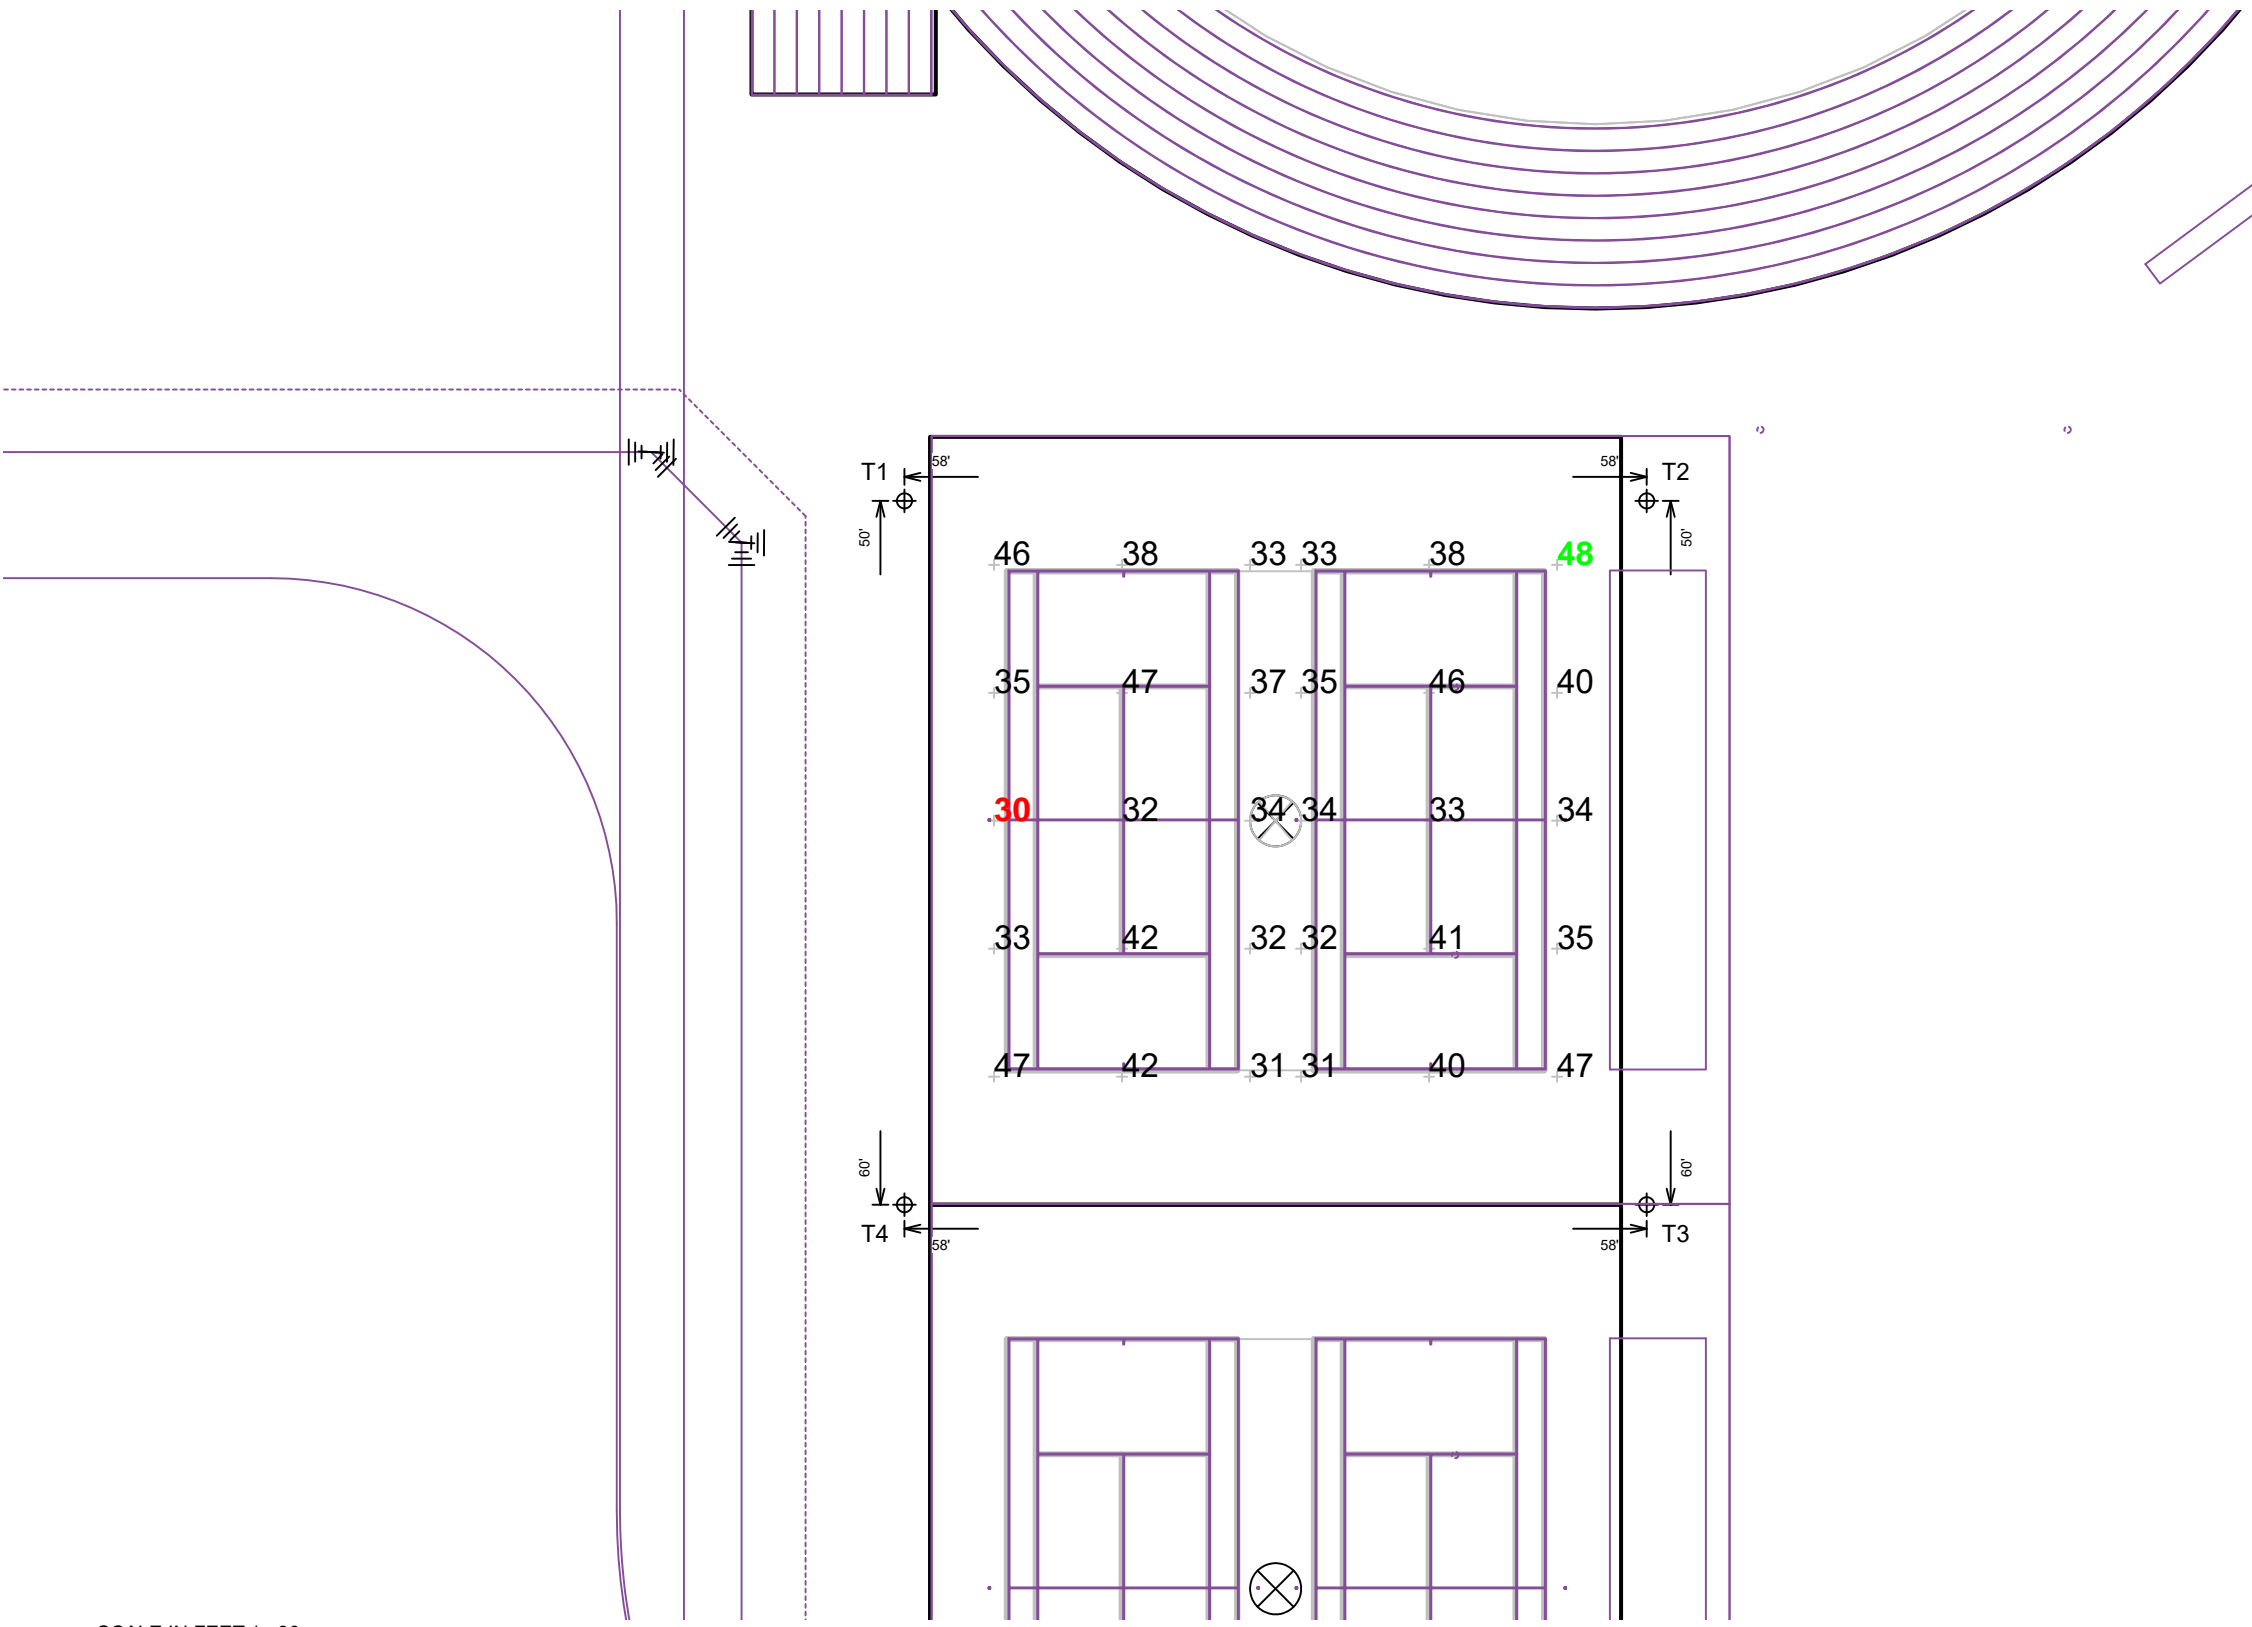

Pole location(s) Ⓢ dimensions are relative to 0,0 reference point(s) ⊗




EQUIPMENT LIST FOR AREAS SHOWN

Pole		Luminaires							
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS	
2	T3-T4	40'	0'	40'	TLC-LED-600	4	2	2	
2	T5-T6	40'	-	40'	TLC-LED-600	2	2	0	
4	TOTALS						12	8	4

Rockwall ISD 9th Grade Center South
Rockwall, TX

GRID SUMMARY	
Name:	Tennis 3-4
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.13
Maximum:	49
Minimum:	30
Avg / Min:	1.23
Guaranteed Max / Min:	2.5
Max / Min:	1.64
UG (adjacent pts):	0.00
CU:	0.88
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	C
No. of Luminaires:	8
Total Load:	4.64 kW

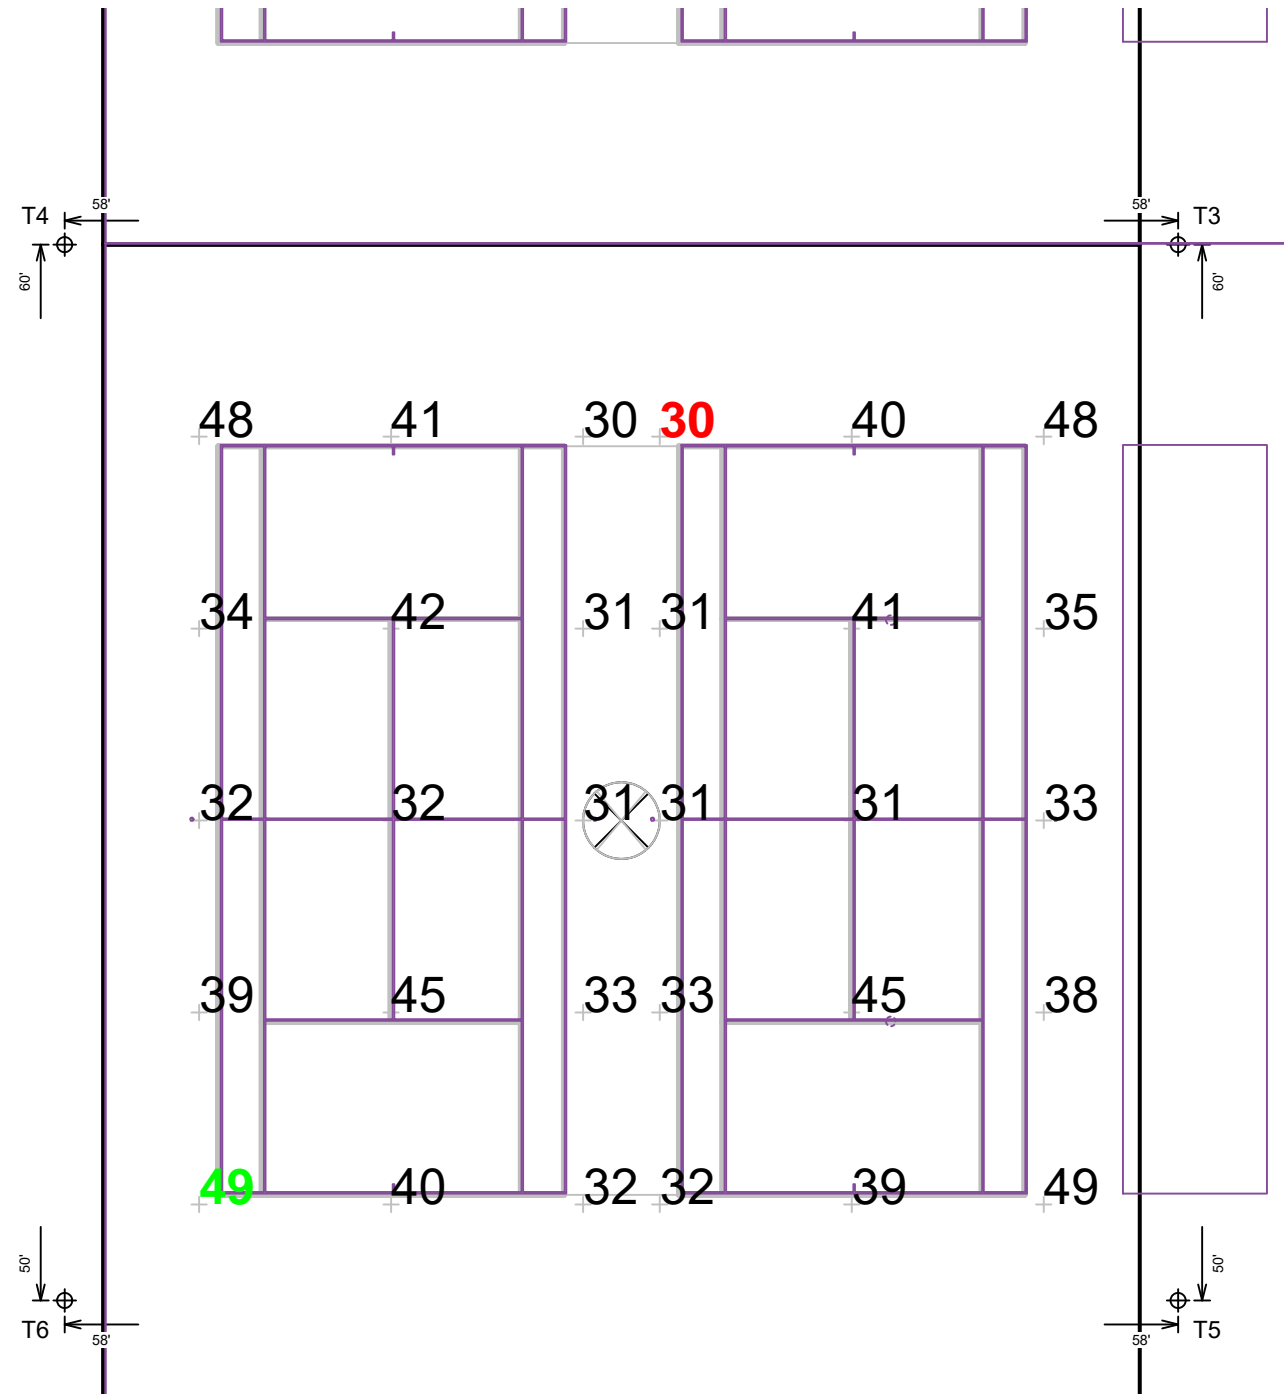

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.


Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

DO NOT ENTER

SCALE IN FEET 1 : 20



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



We Make It Happen.

Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.


Rockwall ISD 9th Grade Center South

Rockwall, TX

EQUIPMENT LIST FOR AREAS SHOWN								
Pole			Luminaires					
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	A1-A2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1500	4	4	0
2	B1-B2	80'	-	15.5'	TLC-BT-575	1	1	0
				80'	TLC-LED-1500	6	6	0
2	C1-C2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	3	3	0
2	D1-D2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	4	4	0
8	TOTALS					42	42	0

GRID SUMMARY	
Name:	Baseball
Size:	Irregular 315' / 390' / 315'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY		
MAINTAINED HORIZONTAL FOOTCANDLES		
	Infield	Outfield
Guaranteed Average:	50	30
Scan Average:	52.69	33.40
Maximum:	69	45
Minimum:	39	26
Avg / Min:	1.34	1.30
Guaranteed Max / Min:	2	2.5
Max / Min:	1.75	1.75
UG (adjacent pts):	1.21	1.34
CU:	0.73	
No. of Points:	25	93
LUMINAIRE INFORMATION		
Applied Circuits:	D	
No. of Luminaires:	42	
Total Load:	49.58 kW	

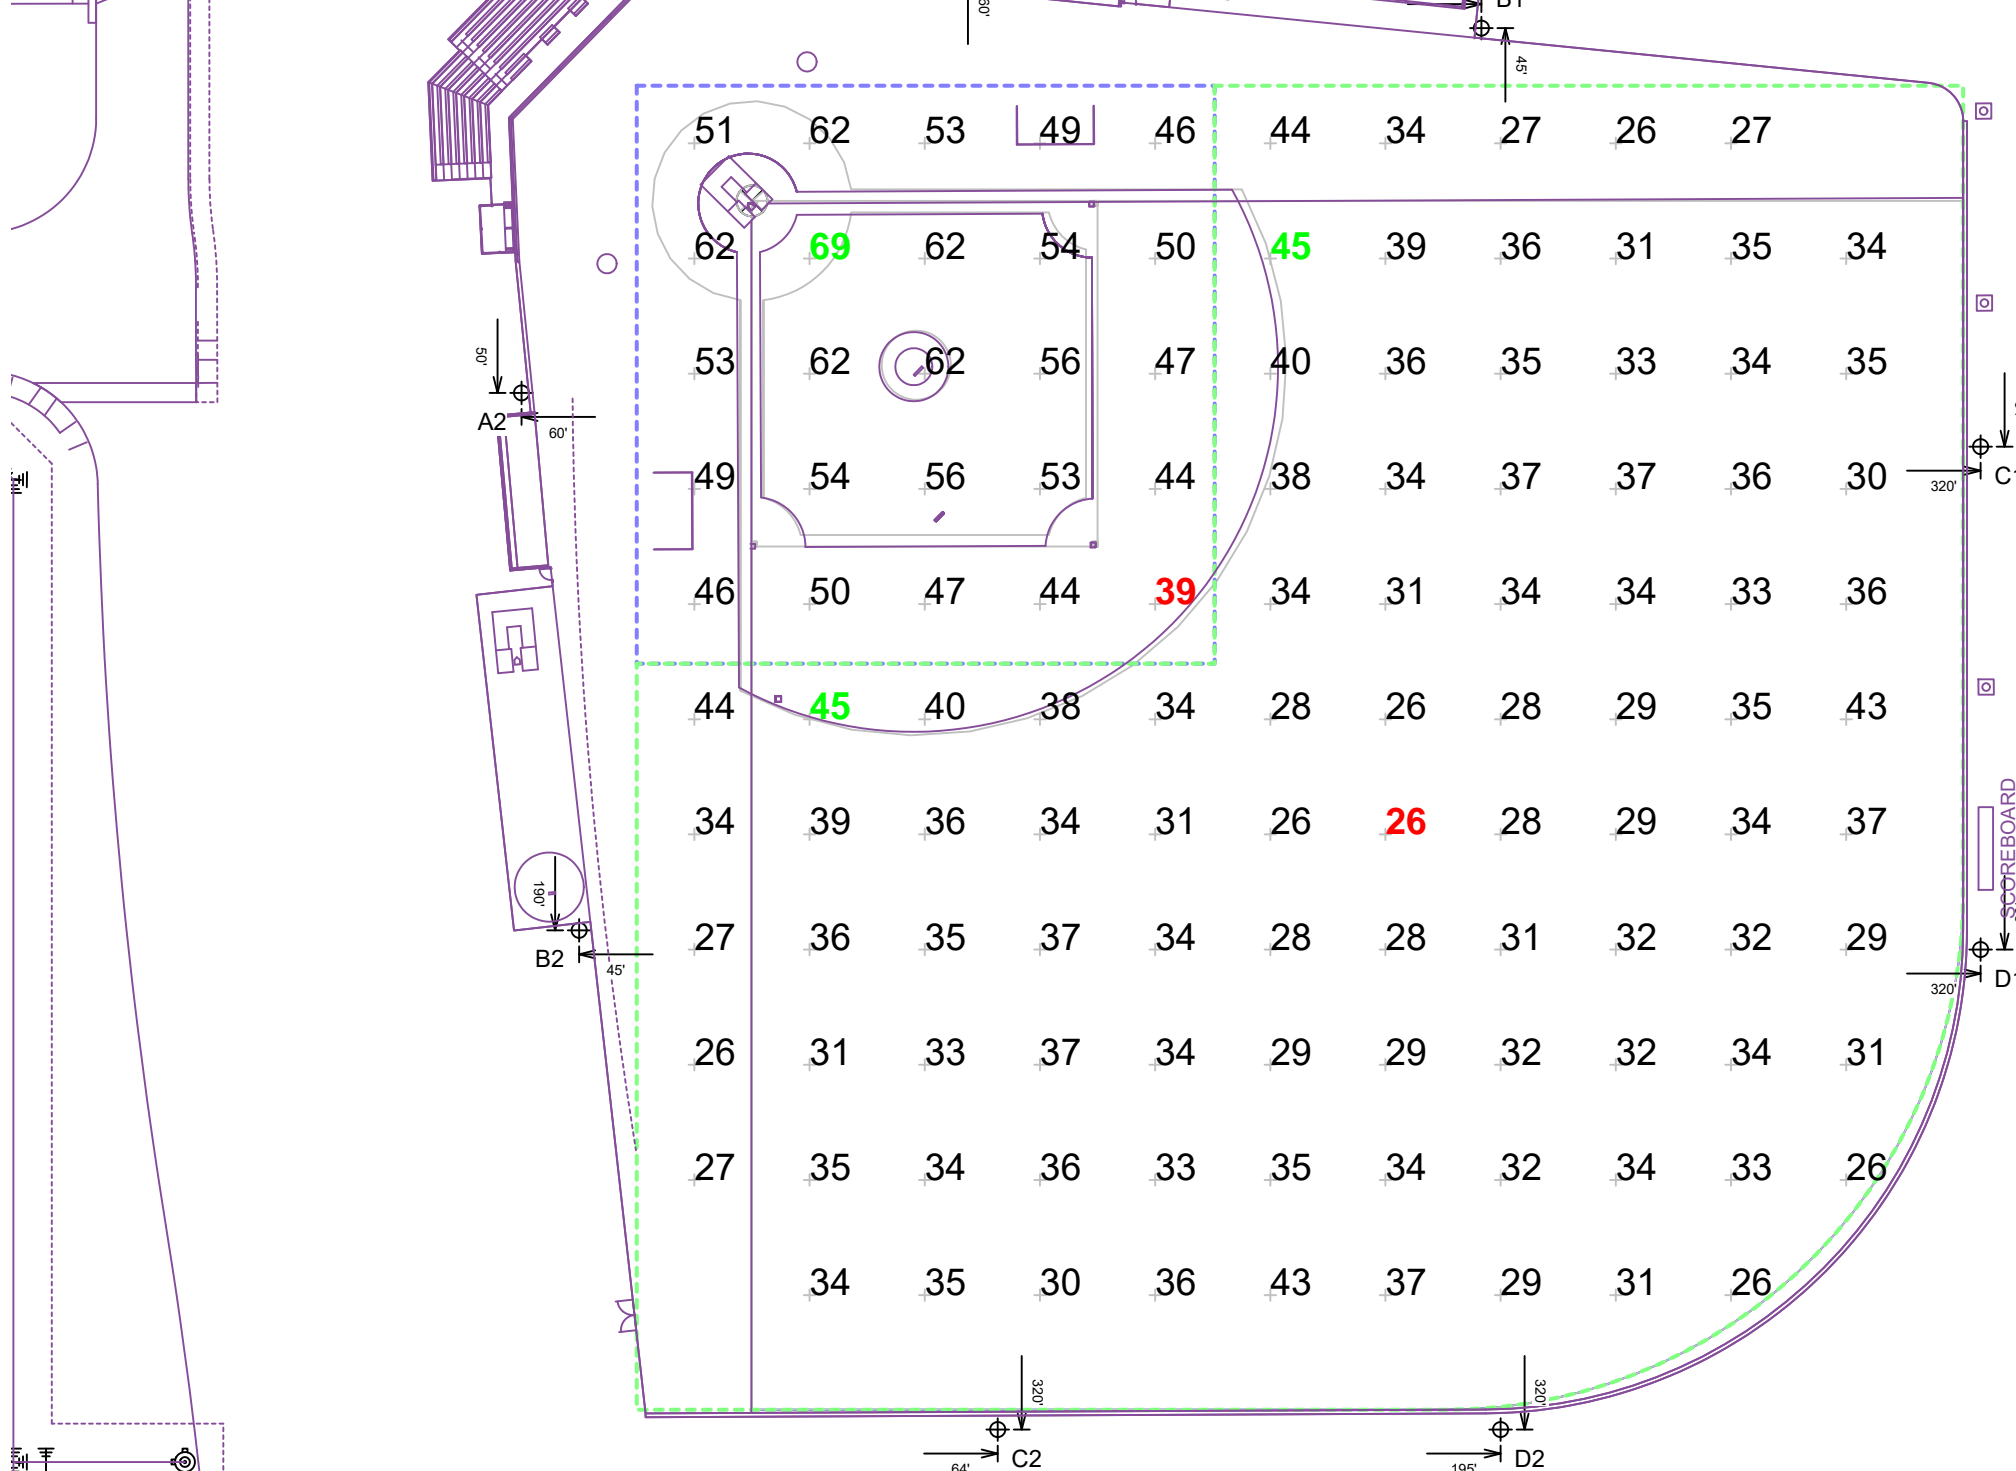


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.


Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) Ⓧ dimensions are relative to 0,0 reference point(s) ⊗



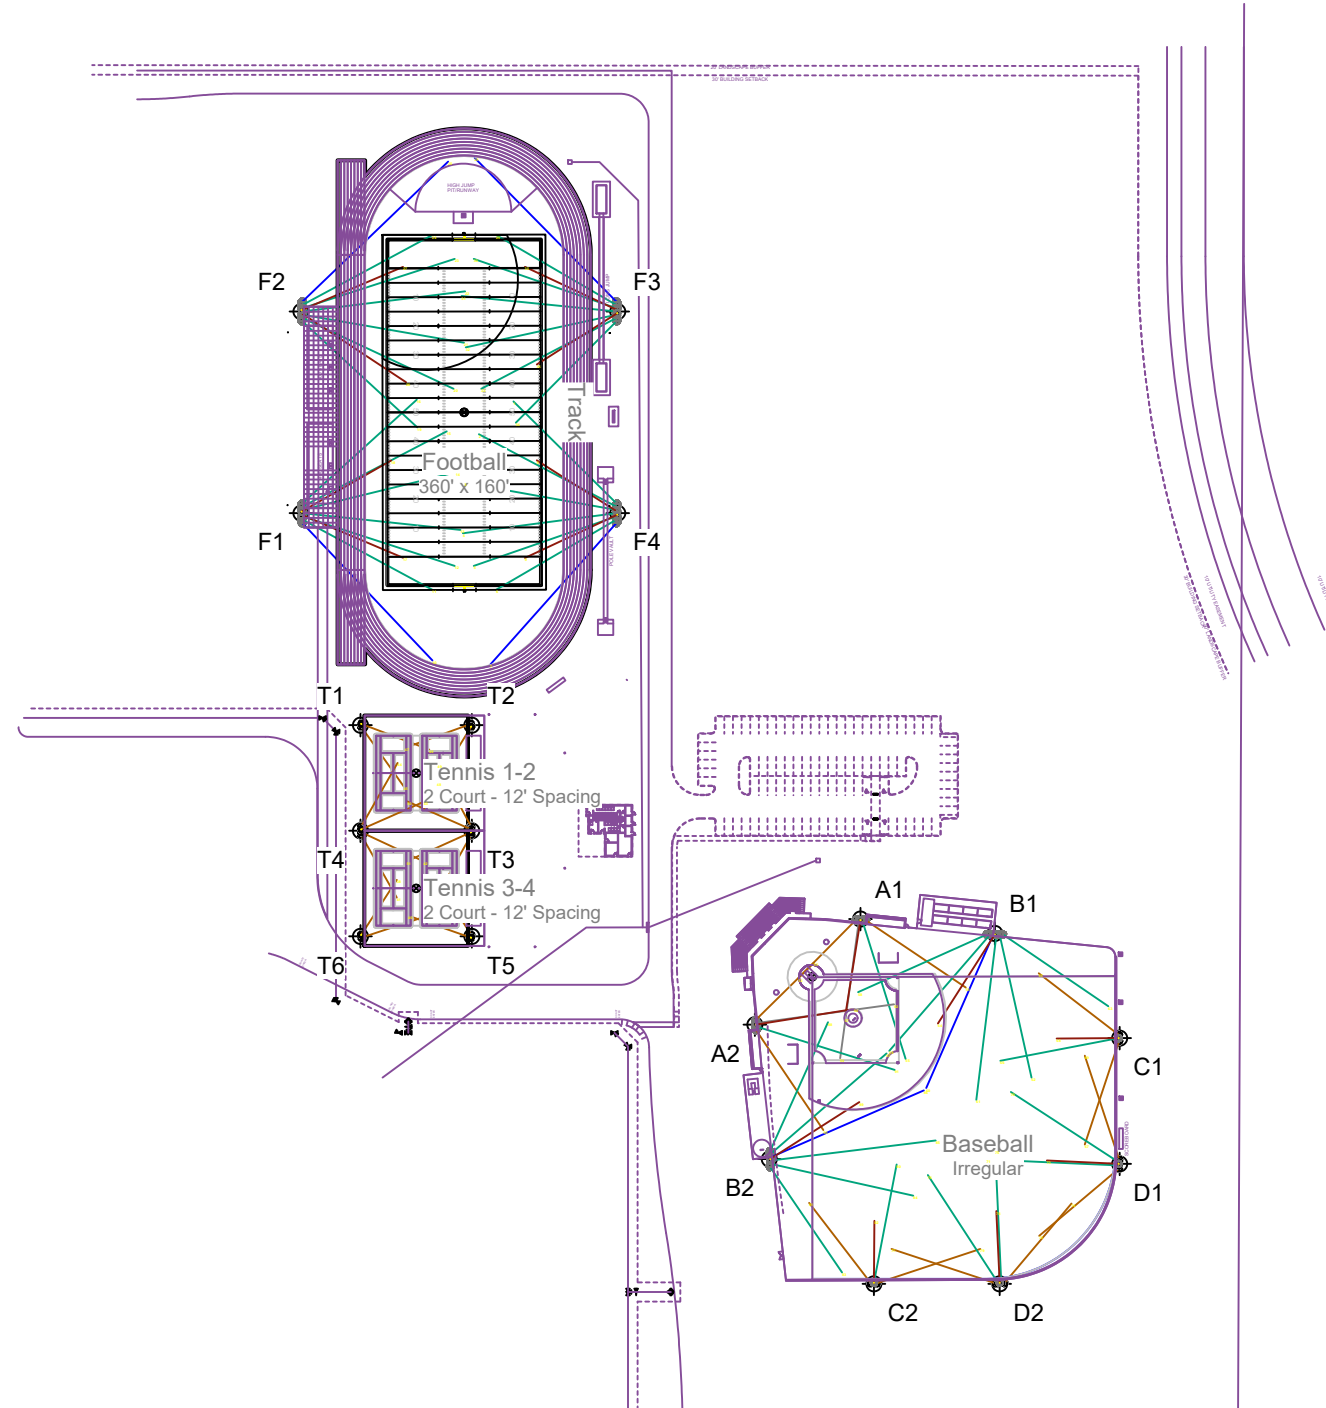

EQUIPMENT LAYOUT

INCLUDES:

- Baseball
- Football
- Tennis 1-2
- Tennis 3-4
- Track

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.


Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

EQUIPMENT LIST FOR AREAS SHOWN

QTY	Pole			Luminaires		QTY / POLE
	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	
2	A1-A2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1500	1 4
2	B1-B2	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	1 6
2	C1-C2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 3
2	D1-D2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 4
4	F1-F4	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	2 7
4	T1-T2 T5-T6	40'	-	40'	TLC-LED-600	2
2	T3-T4	40'	-	40'	TLC-LED-600	4
18	TOTALS					94

SINGLE LUMINAIRE AMPERAGE DRAW CHART




Ballast Specifications (.90 min power factor)	Line Amperage Per Luminaire (max draw)					
	208 (60)	220 (60)	240 (60)	277 (60)	347 (60)	480 (60)
Single Phase Voltage						
TLC-LED-1500	8.5	8.1	7.4	6.4	5.1	4.7
TLC-LED-1200	7.0	6.6	6.1	5.2	4.2	4.0
TLC-BT-575	3.4	3.2	2.9	2.5	2.0	1.8
TLC-LED-600	3.4	3.2	3.0	2.6	2.0	1.9



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

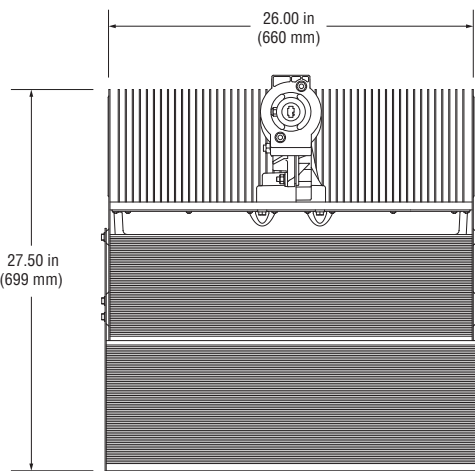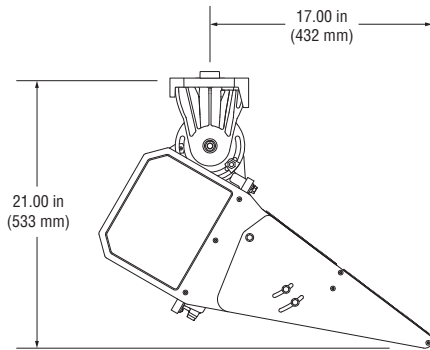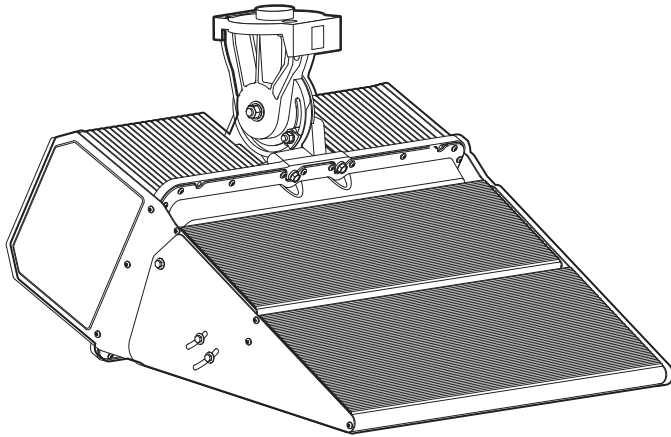

Luminaire Data

Weight (luminaire) 80 lb (36 kg)
 UL listing number..... E338094
 UL listed for USA / Canada..... UL1598 CSA-C22.2 No.250.0
 Ingress protection, luminaire, international IP65
 Ingress protection, luminaire, USA IP54
 Material and finish Aluminum, powder-coat painted
 Wind speed rating (aiming only)..... 150 mi/h (67 m/s)
 UL ambient temperature rating, luminaire 50°C (122°F)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11
 L90 (10.5k) >63,500 h
 L80 (10.5k) >63,500 h
 L70 (10.5k) >63,500 h
 CIE correlated color temperature 5700 K
 Color Rendering Index (CRI), typical..... 75
 Color Rendering Index (CRI), minimum 70
 Lumens¹ 121,000

Footnotes:

1) Lumen values at stabilized operation in 25°C ambient temperature environment. Incorporates appropriate dirt depreciation factor for life of luminaire.

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 1,150 W

Per luminaire..... 1,150 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 μs

Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure..... 50°C (122°F)

Ingress protection,
electrical components enclosure..... IP54


Efficiency..... 95%

Dimming mode..... optional

Range, energy consumption..... .20 – 100%

Range, light output..... .25 – 100%

Typical Wiring

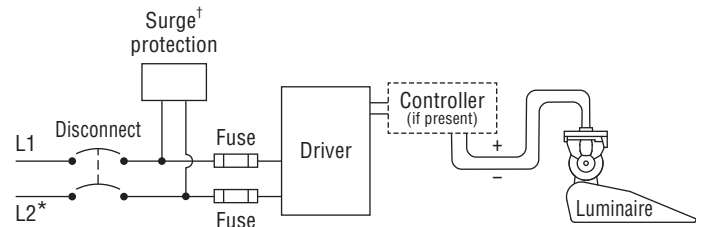

* If L2 (com) is neutral then not switched or fused.

† Not present if indoor installation.

	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	7.11 A	6.83 A	6.46 A	6.18 A	5.92 A	5.13 A	4.10 A	3.74 A	3.56 A	3.43 A	2.96 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.



Luminaire and Driver Components – TLC-BT-575

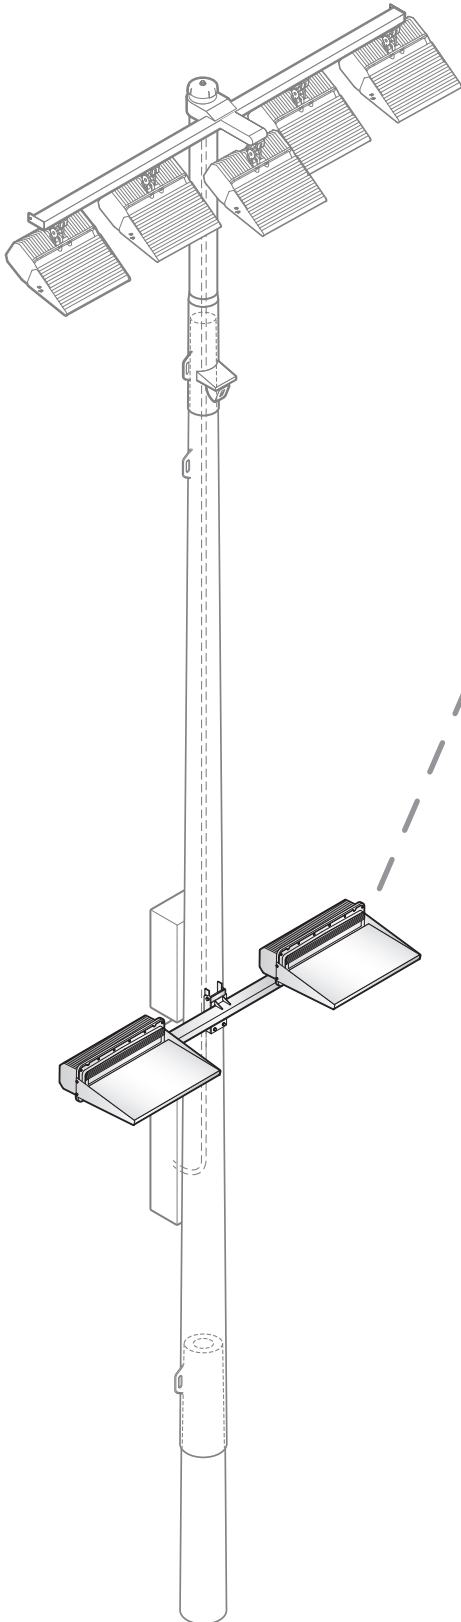

Luminaire Data

Weight (luminaire)	34 lb (15 kg)
UL listing number	E338094
UL Listed for USA / Canada	UL1598 CSA-C22.2 No.250.0
Ingress protection, luminaire, international	IP65
Ingress protection, luminaire, USA	IP54
Material and finish	Aluminum, powder-coat painted
Wind speed rating (aiming only)	150 mi/h (67 m/s)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11	
L90 (10.5k)	>63,500 h
L80 (10.5k)	>63,500 h
L70 (10.5k)	>63,500 h
CIE correlated color temperature	5700 K
Color Rendering Index (CRI), typical	75
Color Rendering Index (CRI), minimum	70
Lumens ¹	52,000

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

All components from foundation to poletop are designed to work together in Light-Structure System™ to ensure reliable, trouble-free operation.

Luminaire and Driver Components – TLC-BT-575

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 575 W

Per luminaire..... 575 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 μs


Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure 50°C (122°F)

Ingress protection,
electrical components enclosure IP54

Efficiency..... 95%

Typical Wiring

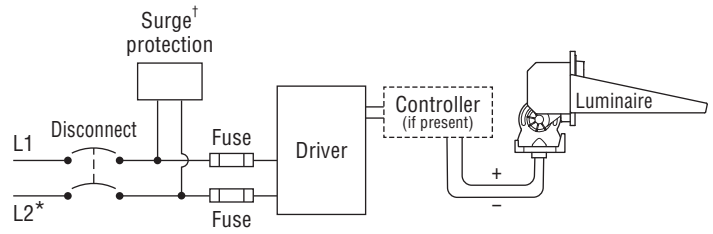

* If L2 (com) is neutral then not switched or fused.

† Not present if indoor installation.



	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	3.30 A	3.17 A	3.00 A	2.87 A	2.75 A	2.38 A	1.90 A	1.74 A	1.65 A	1.59 A	1.38 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.

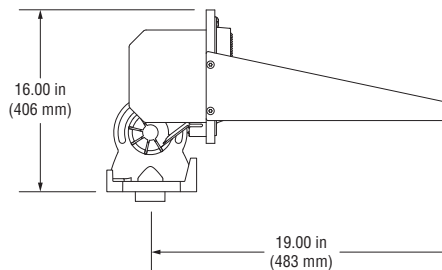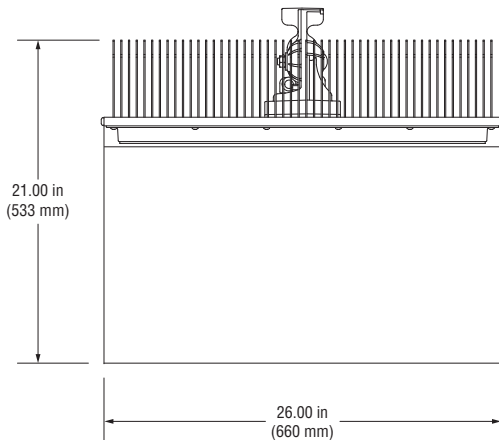

Datasheet: **TLC-LED-400 Luminaire and Driver**

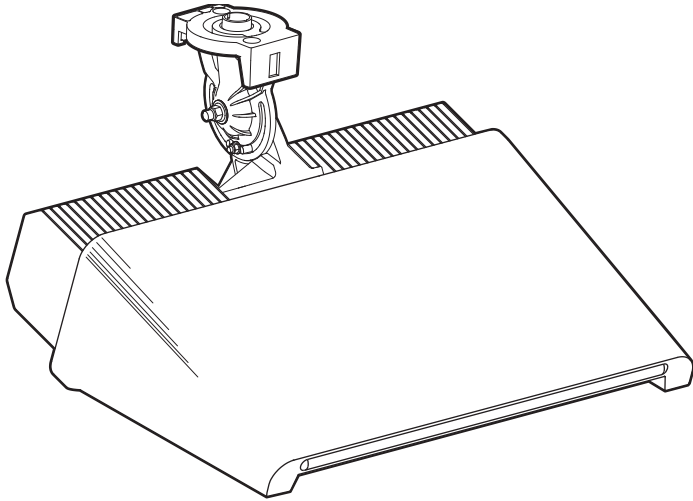

Luminaire Data

Weight (luminaire)	40 lb (18 kg)
UL listing number	E338094
UL Listed for USA / Canada	UL1598 CSA-C22.2 No.250.0
Ingress protection, luminaire, international	IP65
Ingress protection, luminaire, USA	IP54
Material and finish	Aluminum, powder-coat painted
Wind speed rating (aiming only)	150 mi/h (67 m/s)



Photometric Characteristics

Projected lumen maintenance per IES TM-21-11

L90(10.5k)	>63,500 h
L80(10.5k)	>63,500 h
L70(10.5k)	>63,500 h
CIE correlated color temperature	5700 K
Color Rendering Index (CRI), typical	75
Color Rendering Index (CRI), minimum	70
Lumens ¹	46,500

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

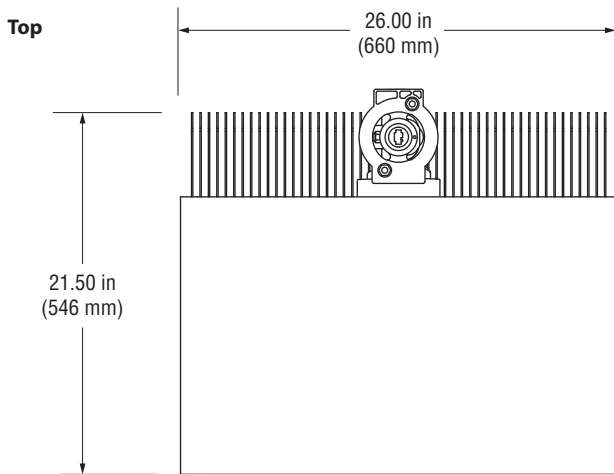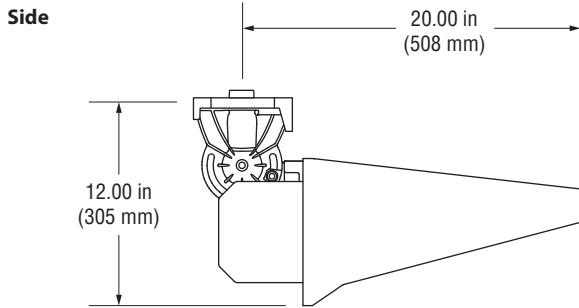



WST LED

Architectural Wall Sconce



Catalog Number
Notes
Type

Hit the Tab key or mouse over the page to see all interactive elements.

A+ Capable Luminaire

This item is an A+ capable luminaire, which has been designed and tested to provide consistent color appearance and system-level interoperability.

- All configurations of this luminaire meet the Acuity Brands' specification for chromatic consistency
- This luminaire is A+ Certified when ordered with DTL® controls marked by a **shaded background**. DTL DLL equipped luminaires meet the A+ specification for luminaire to photocontrol interoperability¹
- This luminaire is part of an A+ Certified solution for ROAM® or XPoint™ Wireless control networks, providing out-of-the-box control compatibility with simple commissioning, when ordered with drivers and control options marked by a **shaded background**¹

To learn more about A+, visit www.acuitybrands.com/aplus.


See ordering tree for details.

A+ Certified Solutions for ROAM require the order of one ROAM node per luminaire. Sold Separately: [Link to Roam](#); [Link to DTL DLL](#)

Specifications


Luminaire

- Height:** 8-1/2"
(21.59 cm)
- Width:** 17"
(43.18 cm)
- Depth:** 10-3/16"
(25.9 cm)
- Weight:** 20 lbs
(9.1 kg)

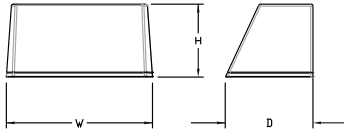


Optional Back Box (PBBW)

- Height:** 8.49"
(21.56 cm)
- Width:** 17.01"
(43.21 cm)
- Depth:** 1.70"
(4.32 cm)

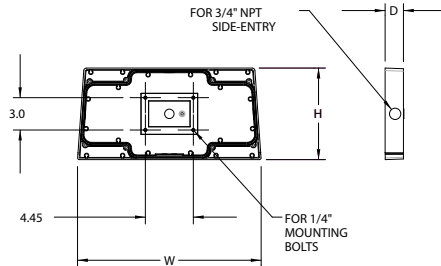

Optional Back Box (BBW)

- Height:** 4"
(10.2 cm)
- Width:** 5-1/2"
(14.0 cm)
- Depth:** 1-1/2"
(3.8 cm)

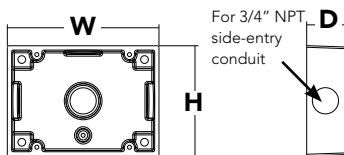

Performance Data

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-40°C (32-104°F).

Ambient		Lumen Multiplier
0°C	32°F	1.03
10°C	50°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
40°C	104°F	0.98

Electrical Load

Performance package	System Watts	Current (A)					
		120	208	240	277	347	480
P1	11	0.1	0.06	0.05	0.04	---	---
	14	---	---	---	---	0.04	0.03
P1 DS	14	0.12	0.07	0.06	0.06	---	---
P2	25	0.21	0.13	0.11	0.1	---	---
	30	---	---	---	---	0.09	0.06
P2 DS	25	0.21	0.13	0.11	0.1	---	---
P3	50	0.42	0.24	0.21	0.19	---	---
	56	---	---	---	---	0.16	0.12
P3 DS	52	0.43	0.26	0.23	0.21	---	---

Projected LED Lumen Maintenance

Values calculated according to IESNA TM-21-11 methodology and valid up to 40°C.

Operating Hours	0	25,000	50,000	100,000
Lumen Maintenance Factor	1.0	>0.95	>0.92	>0.87

Motion Sensor Default Settings

Option	Dimmed State	High Level (when triggered)	Photocell Operation	Ramp-up Time	Dwell Time	Ramp-down Time
*PIR or PIRH	3V (37%) Output	10V (100%) Output	Enabled @ 5FC	3 sec	5 min	5 min
PIR1FC3V or PIRH1FC3V	3V (37%) Output	10V (100%) Output	Enabled @ 1FC	3 sec	5 min	5 min

*for use with site wide Dusk to Dawn control

PER Table

Control	PER (3 wire)	PER5 (5 wire)			PER7 (7 wire)		
			Wire 4/Wire5		Wire 4/Wire5	Wire 6/Wire7	
Photocontrol Only (On/Off)	✓	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM	⊘	✓	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM with Motion	⊘	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof*	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof* with Motion	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	

✓ Recommended

⊘ Will not work

⚠ Alternate

*Futureproof means: Ability to change controls in the future.



Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts.


Performance Package	System Watts (MVOLT*)	Dist. Type	27K (2700K, 70 CRI)					30K (3000K, 70 CRI)					40K (4000K, 70 CRI)					50K (5000K, 70 CRI)				
			Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW
P1	12W	VF	1,494	0	0	0	125	1,529	0	0	0	127	1,639	0	0	0	137	1,639	0	0	0	137
		VW	1,513	0	0	0	126	1,548	0	0	0	129	1,659	0	0	0	138	1,660	0	0	0	138
P2	25W	VF	3,163	1	0	1	127	3,237	1	0	1	129	3,469	1	0	1	139	3,468	1	0	1	139
		VW	3,201	1	0	0	128	3,276	1	0	0	131	3,512	1	0	0	140	3,512	1	0	0	140
P3	50W	VF	6,025	1	0	1	121	6,165	1	0	1	123	6,609	1	0	1	132	6,607	1	0	1	132
		VW	6,098	1	0	1	122	6,240	1	0	1	125	6,689	1	0	1	134	6,691	1	0	1	134



Isofootcandle plots for the WST LED P3 40K VF and VW. Distances are in units of mounting height (10').

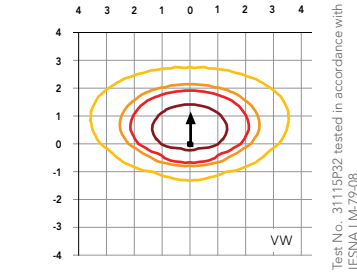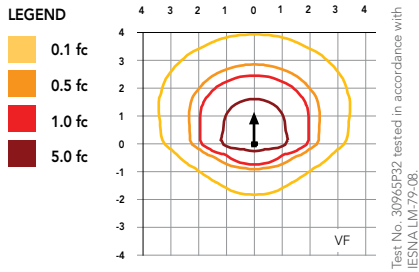

Distribution overlay comparison to 175W metal halide.

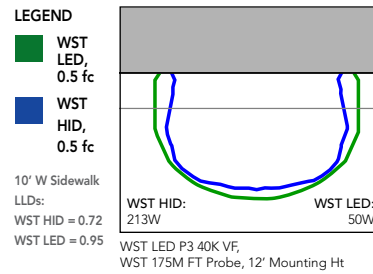

FEATURES & SPECIFICATIONS

INTENDED USE

The classic architectural shape of the WST LED was designed for applications such as hospitals, schools, malls, restaurants, and commercial buildings. The long life LEDs and driver make this luminaire nearly maintenance-free.

CONSTRUCTION

The single-piece die-cast aluminum housing integrates secondary heat sinks to optimize thermal transfer from the internal light engine heat sinks and promote long life. The driver is mounted in direct contact with the casting for a low operating temperature and long life. The die-cast door frame is fully gasketed with a one-piece solid silicone gasket to keep out moisture and dust, providing an IP65 rating for the luminaire.

FINISH

Exterior parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a minimum 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Standard Super Durable colors include dark bronze, black, natural aluminum, sandstone and white. Available in textured and non-textured finishes.

OPTICS

Well crafted reflector optics allow the light engine to be recessed within the luminaire, providing visual comfort, superior distribution, uniformity, and spacing in wall-mount applications. The WST LED has zero uplight and qualifies as a Nighttime Friendly™ product, meaning it is consistent with the LEED® and Green Globes™ criteria for eliminating wasteful uplight.

ELECTRICAL

Light engine(s) consist of 98 high-efficacy LEDs mounted to a metal core circuit board and integral aluminum heat sinks to maximize heat dissipation and promote long life (100,000 hrs at 40°C, L87). Class 2 electronic driver has a power factor >90%, THD <20%. Easily-serviceable surge protection device meets a minimum Category B (per ANSI/IEEE C62.41.2).

INSTALLATION

A universal mounting plate with integral mounting support arms allows the fixture to hinge down for easy access while making wiring connections.

LISTINGS

CSA certified to U.S. and Canadian standards. Luminaire is IP65 rated. PIR and back box options are rated for wet location. Rated for -30°C to 40°C ambient.

DesignLights Consortium® (DLC) Premium qualified product. Not all versions of this product may be DLC Premium qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.

BUY AMERICAN

Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT. Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY

5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.





CITY OF ROCKWALL

PLANNING AND ZONING COMMISSION MEMORANDUM

PLANNING AND ZONING DEPARTMENT

385 S. GOLIAD STREET • ROCKWALL, TX 75087

PHONE: (972) 771-7745 • EMAIL: PLANNING@ROCKWALL.COM

TO: Planning and Zoning Commission

FROM: Bethany Ross; Planner

DATE: August 30, 2022

SUBJECT: MIS2022-019; *Exceptions and a Variance Related to a Public Secondary School at 2727 John King Boulevard*

On July 12, 2022, the Planning and Zoning Commission approved a site plan for a *Public Secondary School* for Rockwall Independent School District (RISD) on a 173.00-acre tract of land located at 2301 John King Boulevard. As part of this approval, the Planning and Zoning Commission granted an exception to the Building Articulation requirements on both the primary and secondary facades. As part of this request, the applicant offered compensatory measures in the form of additional landscaping (*i.e. a landscaped plaza consisting of trees and native plantings at the entry and rear of the school, a landscaped plaza consisting of trees and native plantings at the entry and rear of the school, and an increased landscape buffer along S John King Boulevard*), increased architectural elements (*i.e. canopies, outdoor patio/plaza space, and varied roof heights*), and public amenities (*i.e. tennis courts and athletic fields*). Following this approval, the applicant – *Robert Howman of the Glenn Engineering Corp.* -- submitted a subsequent application on August 19, 2022, requesting two (2) exceptions and a variance: [1] an exception to the landscape requirements to the canopy and accent tree requirements around the detention area, and [2] an exception and variance to the lighting standards for the proposed sports fields.

According to Section 05.03(D), *Detention Basins*, of Article 08, *Landscape and Fence Standards*, of the Unified Development Code (UDC), "(d)etention ponds shall be landscaped in a natural manner using ground cover, grasses, shrubs, berms, and accent and canopy trees. There shall be a minimum of one (1) Canopy Tree per 750 SF and one (1) Accent Tree per 1,500 SF of detention area." The applicant is requesting to omit 35% of the required trees for the detention area and disperse the remaining 65% throughout the site. The applicant has provided an alternative *Landscape Plan* that shows this request.

According to Section 03:03(G), *Illumination*, of Article 07, *Environmental Performance*, of the Unified Development Code (UDC), "(t)he maximum outdoor maintained, computed and measured illumination level within any non-residential development shall not exceed 20 FC outdoors at any point on the site..." The applicant is requesting an exception to the maximum allowed foot candles within the sports fields proposed on the site. The maximum proposed illumination level represented in the provided photometric plan is 70 FC or 50 FC greater than what is permitted by the UDC. Due to the proposed location of the sports fields on the subject property, staff has requested that the applicant provide an overall photometric plan to determine the foot-candle measurements at the property lines. If the proposed photometric plan exceeds the allowable 0.2 foot-candles at the property line, the applicant will be required to request an additional exception.

According to Subsection 06.02(G), *Lighting Standards*, of the Unified Development Code (UDC) "(n)o light standard, light fixture, light pole, pole base or combination thereof shall exceed 20-feet in total height in any overlay district with the exception of the IH-30 Overlay (IH-30 OV) District ..." In this case, the subject property is situated within the SH-205 By-Pass Overlay (SH-205 BY-OV) District. The applicant is requesting a variance to the maximum light pole height within the sports fields proposed on the site. The maximum proposed light pole height represented in the provided photometric plan is 80 feet.

According to Section 09, *Exceptions and Variances*, of Article 11, *Development Applications and Review Procedures*, of the Unified Development Code (UDC), an applicant may request the Planning and Zoning Commission grant an exception or variance to the provisions contained in the Unified Development Code (UDC), where unique or extraordinary conditions exist or where strict adherence to the technical requirements of the Unified Development Code (UDC) would create an undue hardship. Exceptions to the *General Standards* and variances to the *General Overlay District Standards* of the UDC are discretionary decisions that are considered on a *case-by-case basis* by the Planning and Zoning Commission.

In the attached packet staff has included an alternate landscape plan and photometric plan, and the applicant's letter. Staff should note that the approval of any exception or variance would require a supermajority vote (i.e. a *three-fourths* vote of those members present), with a minimum of four (4) votes in the affirmative required for approval. Should the Planning and Zoning Commission have any questions, staff and the applicant will be available at the August 30, 2022 Planning and Zoning Commission Work Session meeting.

PROJECT COMMENTS



CITY OF ROCKWALL
385 S. GOLIAD STREET
ROCKWALL, TEXAS 75087
PHONE: (972) 771-7700

DATE: 8/26/2022

PROJECT NUMBER: MIS2022-019
PROJECT NAME: Variance to the Landscape&Photometric Standards for Rockwall Heath
SITE ADDRESS/LOCATIONS: Ninth Grade

CASE MANAGER: Bethany Ross
CASE MANAGER PHONE: (972) 772-6488
CASE MANAGER EMAIL: bross@rockwall.com

CASE CAPTION: Discuss and consider a request by Robert Howman of Glenn Engineering Corp. on behalf of William Salee of the Rockwall Independent School District (RISD) for the approval of a Miscellaneous Case for Exceptions associated with a Public Secondary School a 173.00-acre tract of land identified as Tract 7-1 of the W. H. Baird Survey, Abstract No. 25 and Lot 1, Block A, Rockwall CCA Addition, City of Rockwall, Rockwall County, Texas, zoned Planned Development District 95 (PD-95) for limited Neighborhood Services (NS) District land uses, situated within the SH-205 By-Pass Overlay (SH-205 BY-OV) District, addressed as 2727 John King Boulevard, and take any action necessary.

DEPARTMENT	REVIEWER	DATE OF REVIEW	STATUS OF PROJECT
ENGINEERING	Sarah Johnston	08/25/2022	Approved w/ Comments
08/25/2022: No trees within 5' of 8" lines, and 10' away from lines larger than 8" unless the lines are private. Sewer maybe private but the water line isn't			
BUILDING	Rusty McDowell	08/24/2022	Approved
No Comments			
FIRE	Ariana Kistner	08/24/2022	Approved
No Comments			
GIS	Lance Singleton	08/22/2022	Approved
No Comments			
POLICE	Chris Cleveland	08/23/2022	Approved
No Comments			
PARKS	Travis Sales	08/22/2022	Approved w/ Comments

08/22/2022: Detention Requirements
1 canopy tree per 750 sqft
1 accent tree for every 1,500 sqft

We have not seen this requirement cause turf issues on other developments.

DEPARTMENT	REVIEWER	DATE OF REVIEW	STATUS OF PROJECT
PLANNING	Bethany Ross	08/26/2022	Approved w/ Comments

08/26/2022: MIS2022-019; Exceptions and a Variance Related to a Public Secondary School – Rockwall Heath
Please address the following comments (M= Mandatory Comments; I = Informational Comments)

I.1 This is a request by Robert Howman of Glenn Engineering Corp. on behalf of William Salee of the Rockwall Independent School District (RISD) for the approval of a Miscellaneous Case for Exceptions associated with a Public Secondary School a 173.00-acre tract of land identified as Tract 7-1 of the W. H. Baird Survey, Abstract No. 25 and Lot 1, Block A, Rockwall CCA Addition, City of Rockwall, Rockwall County, Texas, zoned Planned Development District 95 (PD-95) for limited Neighborhood Services (NS) District land uses, situated within the SH-205 By-Pass Overlay (SH-205 BY-OV) District, addressed as 2727 John King Boulevard, and take any action necessary.

I.2 For questions or comments concerning this case please contact Bethany Ross in the Planning Department at (972) 772-6488 or email bross@rockwall.com.

I.3 According to Section 05.03.D: Detention Basins, of Article 08, Landscape and Fence Standards, of the Unified Development Code (UDC), “(d)detention ponds shall be landscaped in a natural manner using ground cover, grasses, shrubs, berms, and accent and canopy trees. There shall be a minimum of one (1) Canopy Tree per 750 SF and one (1) Accent Tree per 1,500 SF of detention area.”

I.4 According to Section 03:03.G: Illumination of Article 07, Environmental Performance, of the Unified Development Code (UDC), “The maximum outdoor maintained, computed and measured illumination level within any nonresidential development shall not exceed 20 FC outdoors at any point on the site...”

I.5 According to Subsection 06.02(G), Lighting Standards, of the Unified Development Code (UDC), “(n)o light standard, light fixture, light pole, pole base or combination thereof shall exceed 20-feet in total height in any overlay district with the exception of the IH-30 Overlay (IH-30 OV) District ...”

I.6 In this case the applicant is requesting:

- (1) To omit 35% of the required trees for the detention area and disperse the remaining 65% throughout the site. The applicant has provided an alternate Landscape Plan that represents this request,
- (2) An exception to the maximum allowed foot candles within the sports fields proposed on the site. The maximum proposed illumination level represented in the provided photometric plan is 70 FC, and
- (3) An exception to the maximum light pole height within the sports fields proposed on the site. The maximum proposed light pole height represented in the provided photometric plan is 80 feet.

M.7 Please provide an overall photometric plan for the site. If the foot-candles located at the property line of either property exceed the allowable 0.2 foot-candles at the property line, another variance will need to be requested.

I.8 According to Section 09.01, Exceptions to the General Standards of Article 11, Development Applications and Review Procedures, of the Unified Development Code (UDC), “...an applicant may request the Planning and Zoning Commission grant an exception to the provisions contained in the Unified Development Code (UDC), where unique or extraordinary conditions exist or where strict adherence to the technical requirements of the Unified Development Code (UDC) would create an undue hardship.” Exceptions to the General Standards of the UDC are discretionary decisions that are considered on a case-by-case basis by the Planning and Zoning Commission.

I.9 Please note the scheduled meeting for this case:

- 1) Planning & Zoning Work Session meeting will be held on August 30, 2022 at 6pm in the council chambers at City Hall.

I.10 Staff recommends that a representative be present for the meetings as scheduled above to answer any questions the Commission or Council may have regarding your request. All meetings will be held in person, in the City’s Council Chambers, and are scheduled to begin at 6:00 p.m.

N89°00'23"E
34.15'
(DEED CALL
N89°49'51"E
36.45')

N88°21'21" E 3926.93'

PART OF 58
N.L. L6
VOL. 38,

L6

L2

L3



L5

L4

PROPOSED BUILDING

WET DETENTION POND

SITE DATA SUMMARY	
EXISTING ZONING	AG
PROPOSED ZONING	PD FOR NS USES (2002-015)
USE	PUBLIC SCHOOL
LOT AREA	3,464,762 S.F. OR 75.54 AC.
BUILDING AREA (FLOOR AREA)	
PROPOSED FIRST FLOOR	150,170 S.F.
PROPOSED SECOND FLOOR	41,019 S.F.
TOTAL BUILDING AREA	191,189 S.F.
TOTAL FLOOR AREA (FIRST FLOOR)	150,170 S.F.
LOT COVERAGE	150,170 S.F./3,464,762 S.F. = 4.33%
FLOOR AREA RATE	0.051
TOTAL IMPERVIOUS AREA	813,028.31 S.F. OR 18.66 AC.
BUILDING HEIGHT	137'-10" (2 STORY)
TOTAL REQUIRED PARKING (1 PER 5 STUDENTS)	203 SPACES
PARKING PROVIDED	
PARKING SURFACE	
9.0x18.0'	304 SPACES
9.0x20.0'	209 SPACES
15.0x30.0'	19 SPACES
TOTAL PARKING PROVIDED	532 SPACES

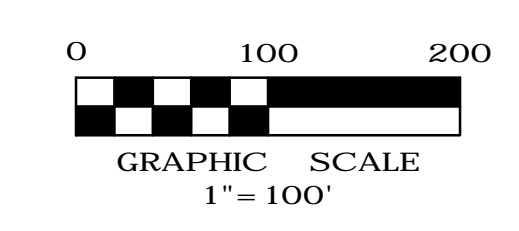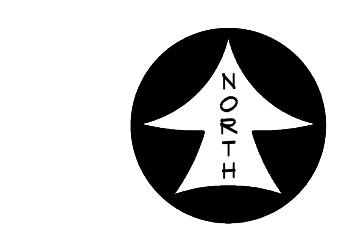

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMUO

CITY OF ROCKWALL CASE NO. SP2022-018

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, L.L.C.
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S.John King Blvd, Rockwall, TX 75032

OVERALL LANDSCAPE PLAN

JOB 21572.0000
DATE 08/16/22
SHEET

L 1

MATCHLINE SEE SHEET L2

PROPOSED BUILDING

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES

1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET


NINTH GRADE CENERS
- South Site

for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

LANDSCAPE PLAN
AREA B

JOB 21572.0000
DATE 08/16/22
SHEET

L 3

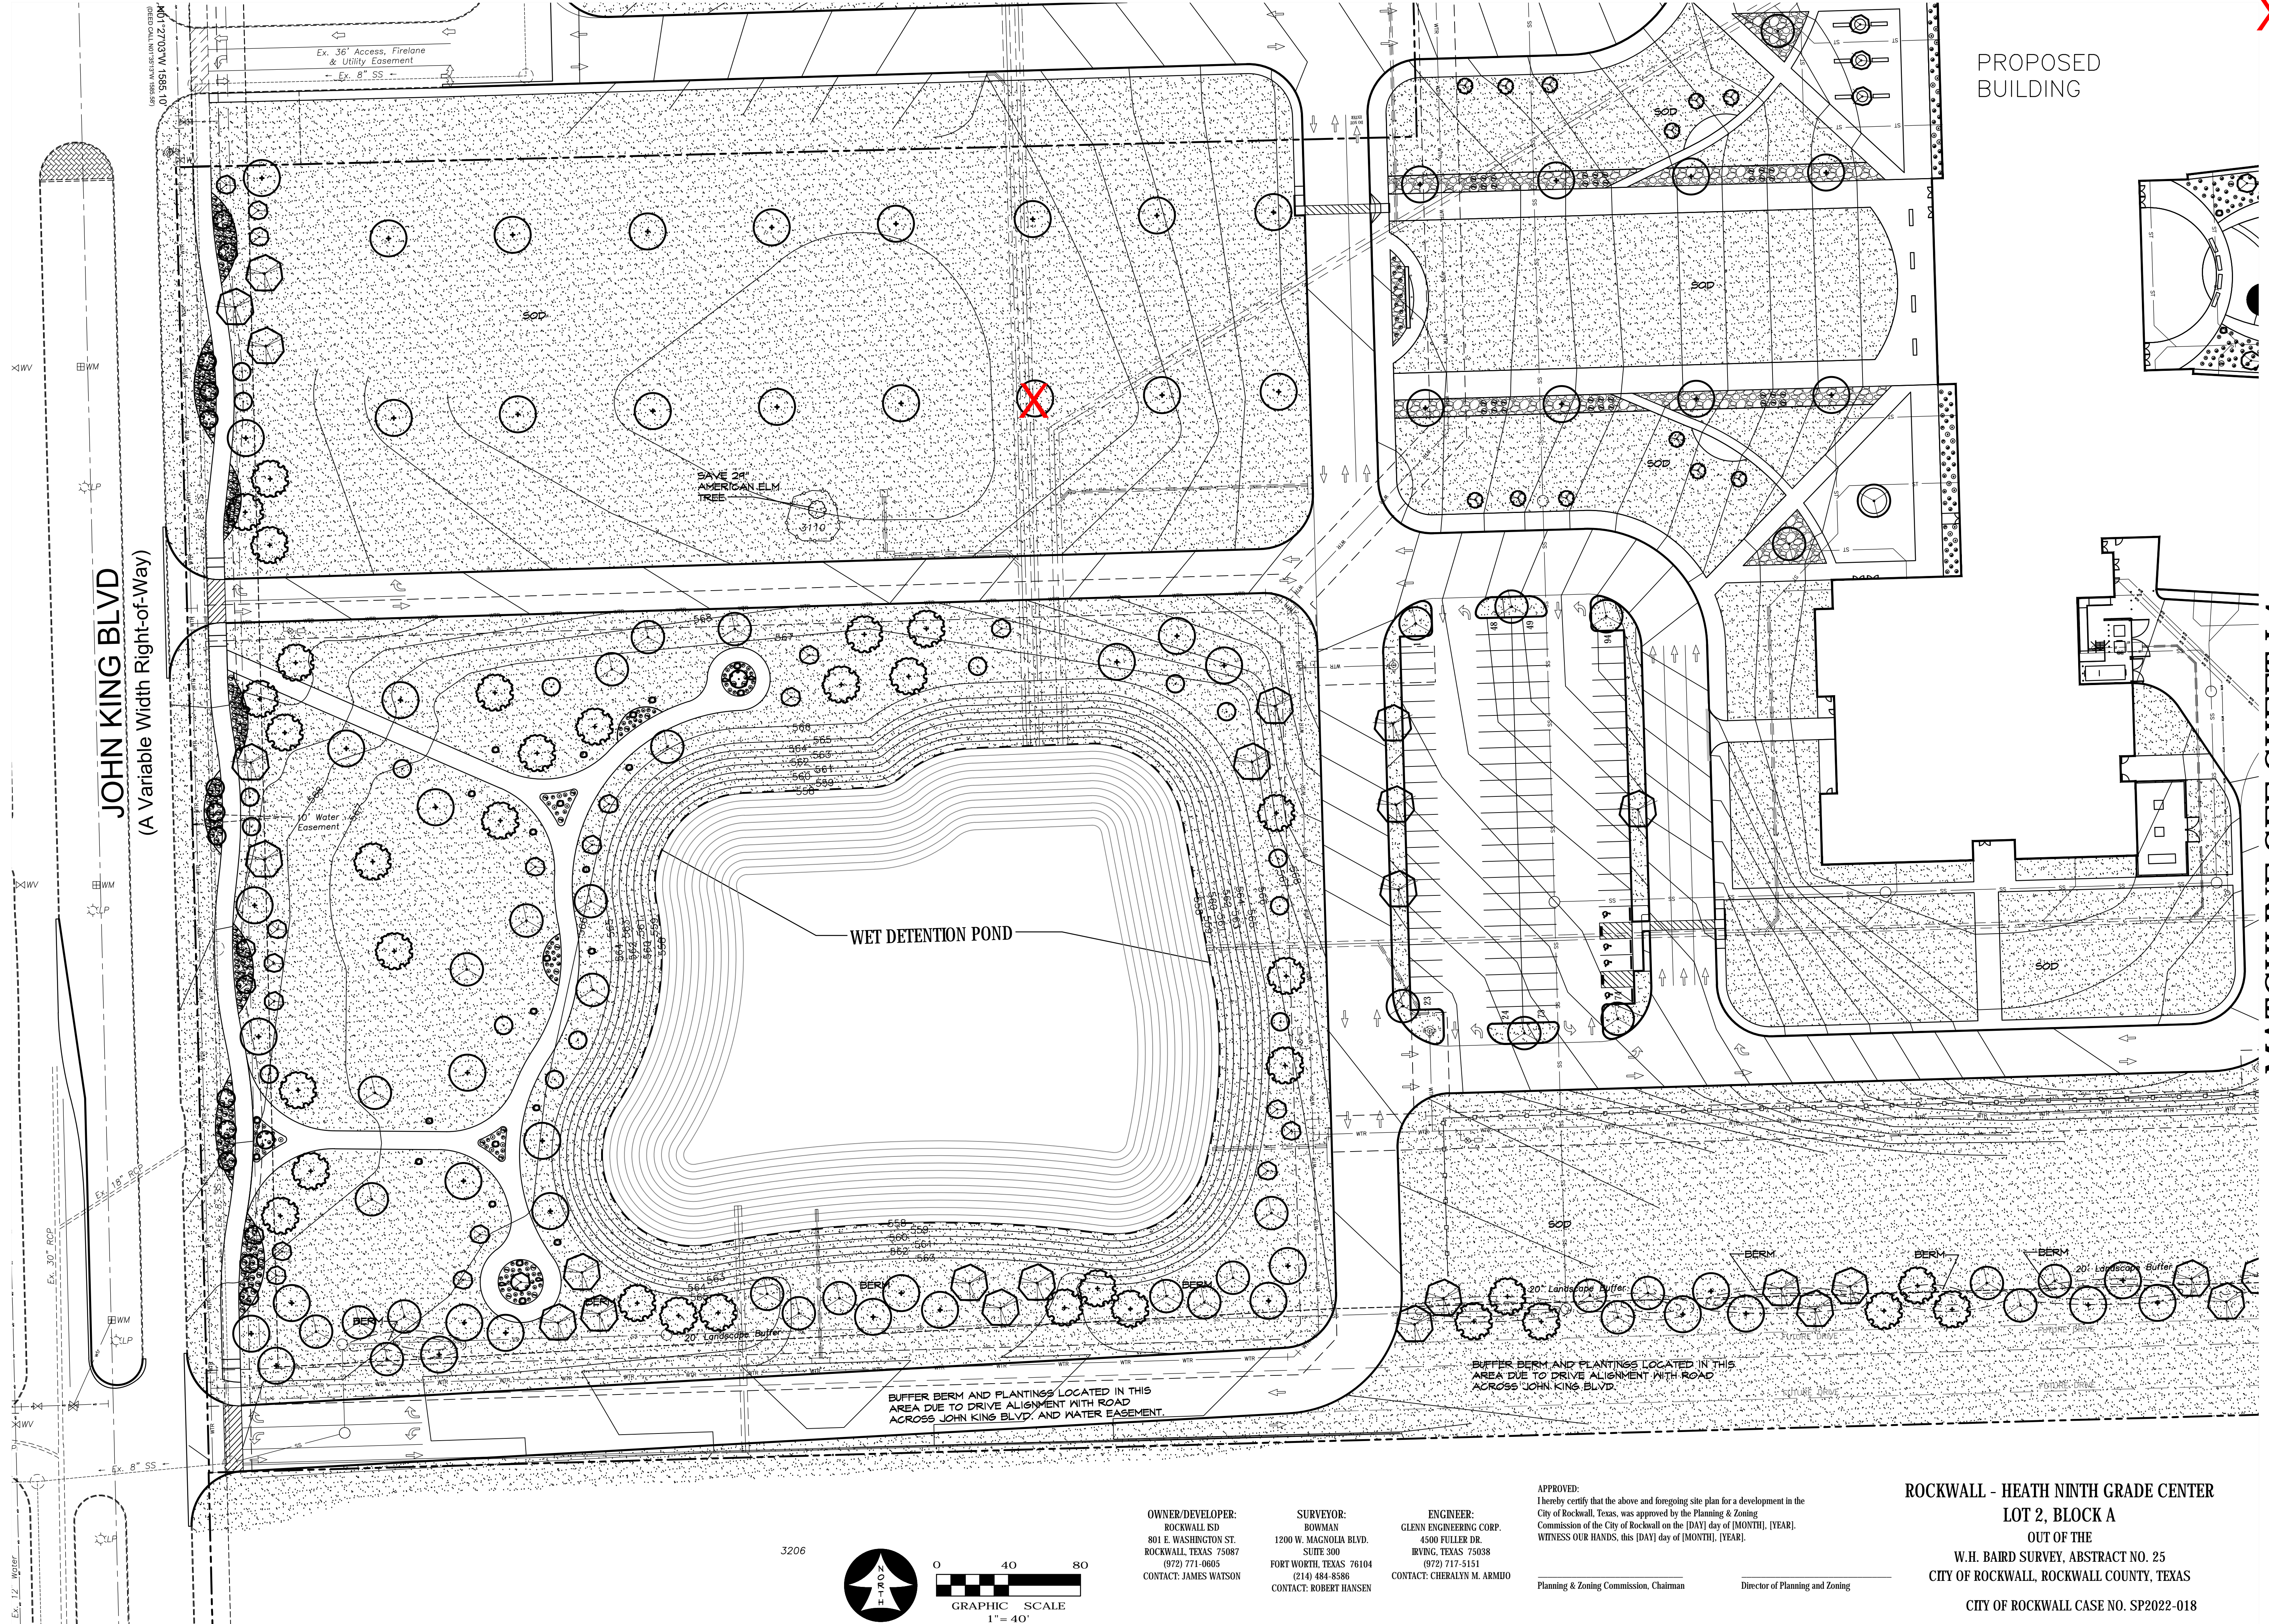

JOHN KING BLVD
(A Variable Width Right-of-Way)

MATCHLINE SEE SHEET L4

WET DETENTION POND

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD. AND WATER EASEMENT.

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD.

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO



APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman

Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

3206

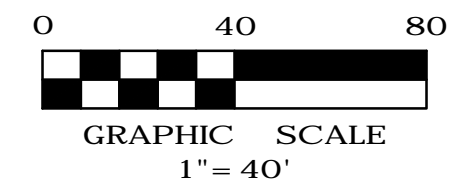

ISSUES	
1	05/11/22 30% PROGRESS SET
2	07/06/22 60% PROGRESS SET
3	08/04/22 90% PROGRESS SET
4	08/16/22 95% PROGRESS SET
5	
6	

REVISIONS	

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.


RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S.John King Blvd, Rockwall, TX 75032

DETENTION ENLARGEMENT

JOB 21572.0000
DATE 08/16/22
SHEET

L 3B

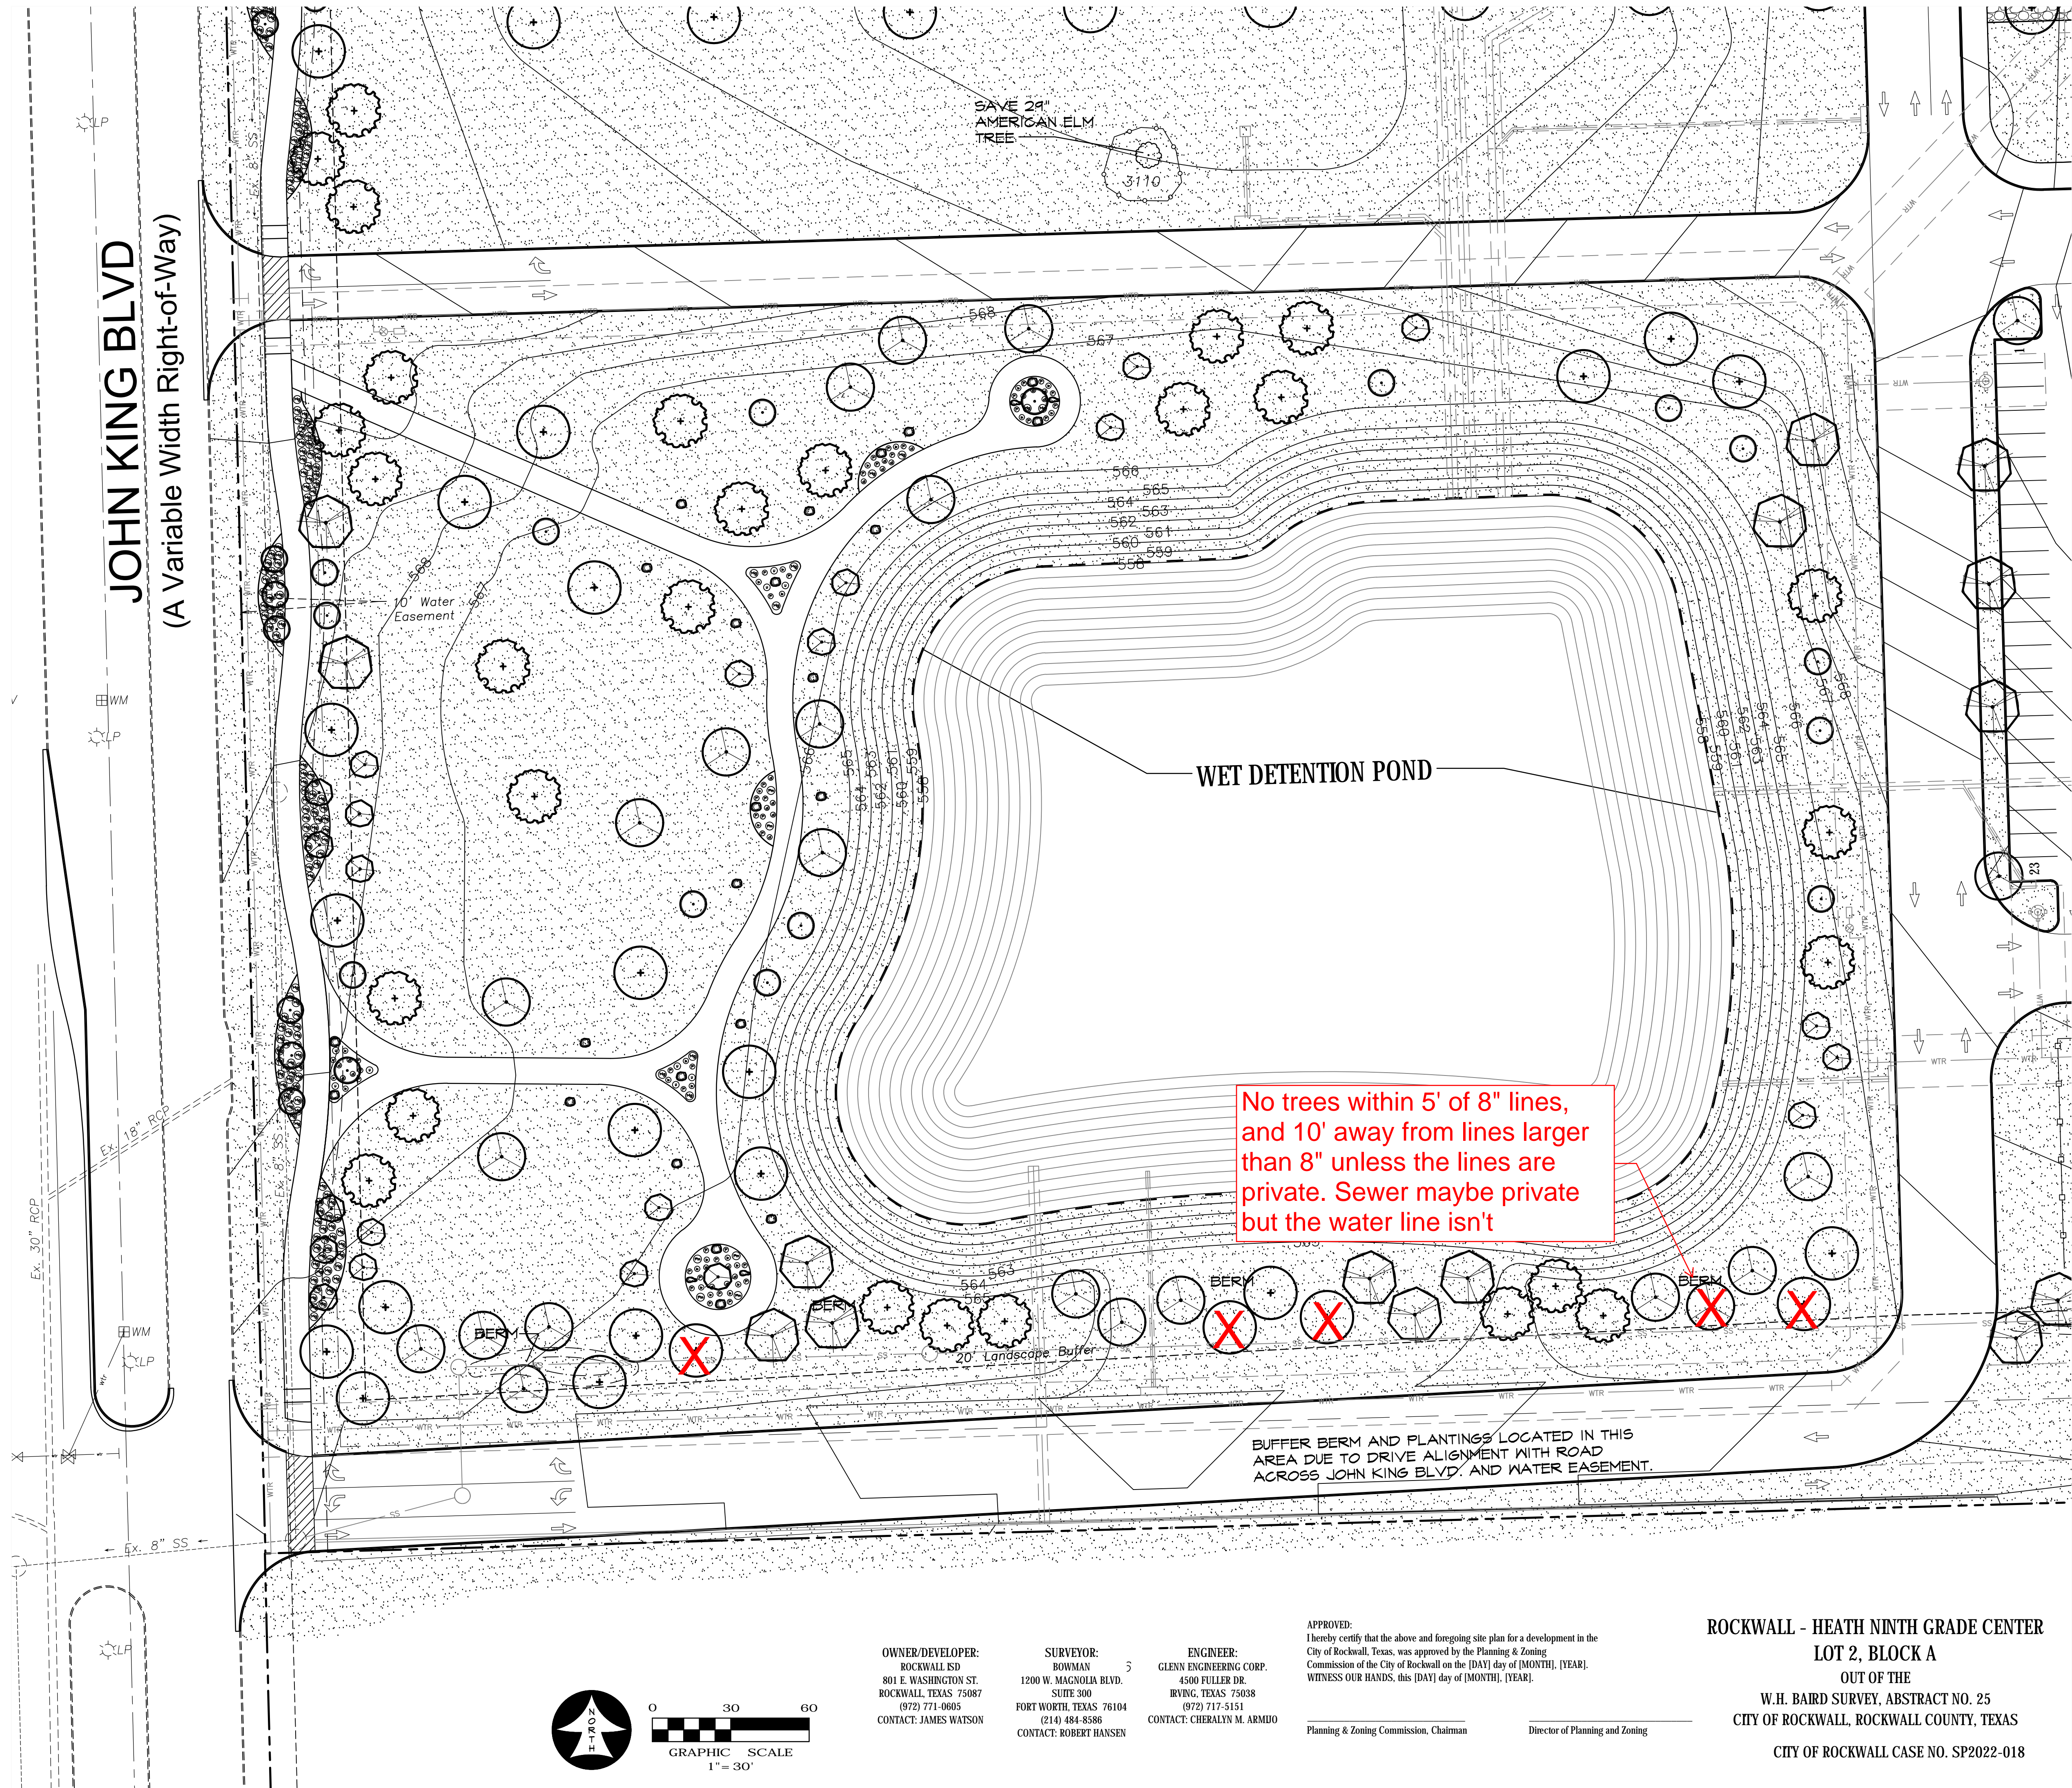

JOHN KING BLVD
(A Variable Width Right-of-Way)

No trees within 5' of 8" lines, and 10' away from lines larger than 8" unless the lines are private. Sewer maybe private but the water line isn't

BUFFER BERM AND PLANTINGS LOCATED IN THIS AREA DUE TO DRIVE ALIGNMENT WITH ROAD ACROSS JOHN KING BLVD. AND WATER EASEMENT.


OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN


ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMUO

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

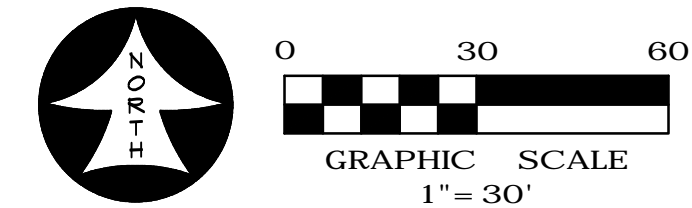

Planning & Zoning Commission, Chairman
Director of Planning and Zoning

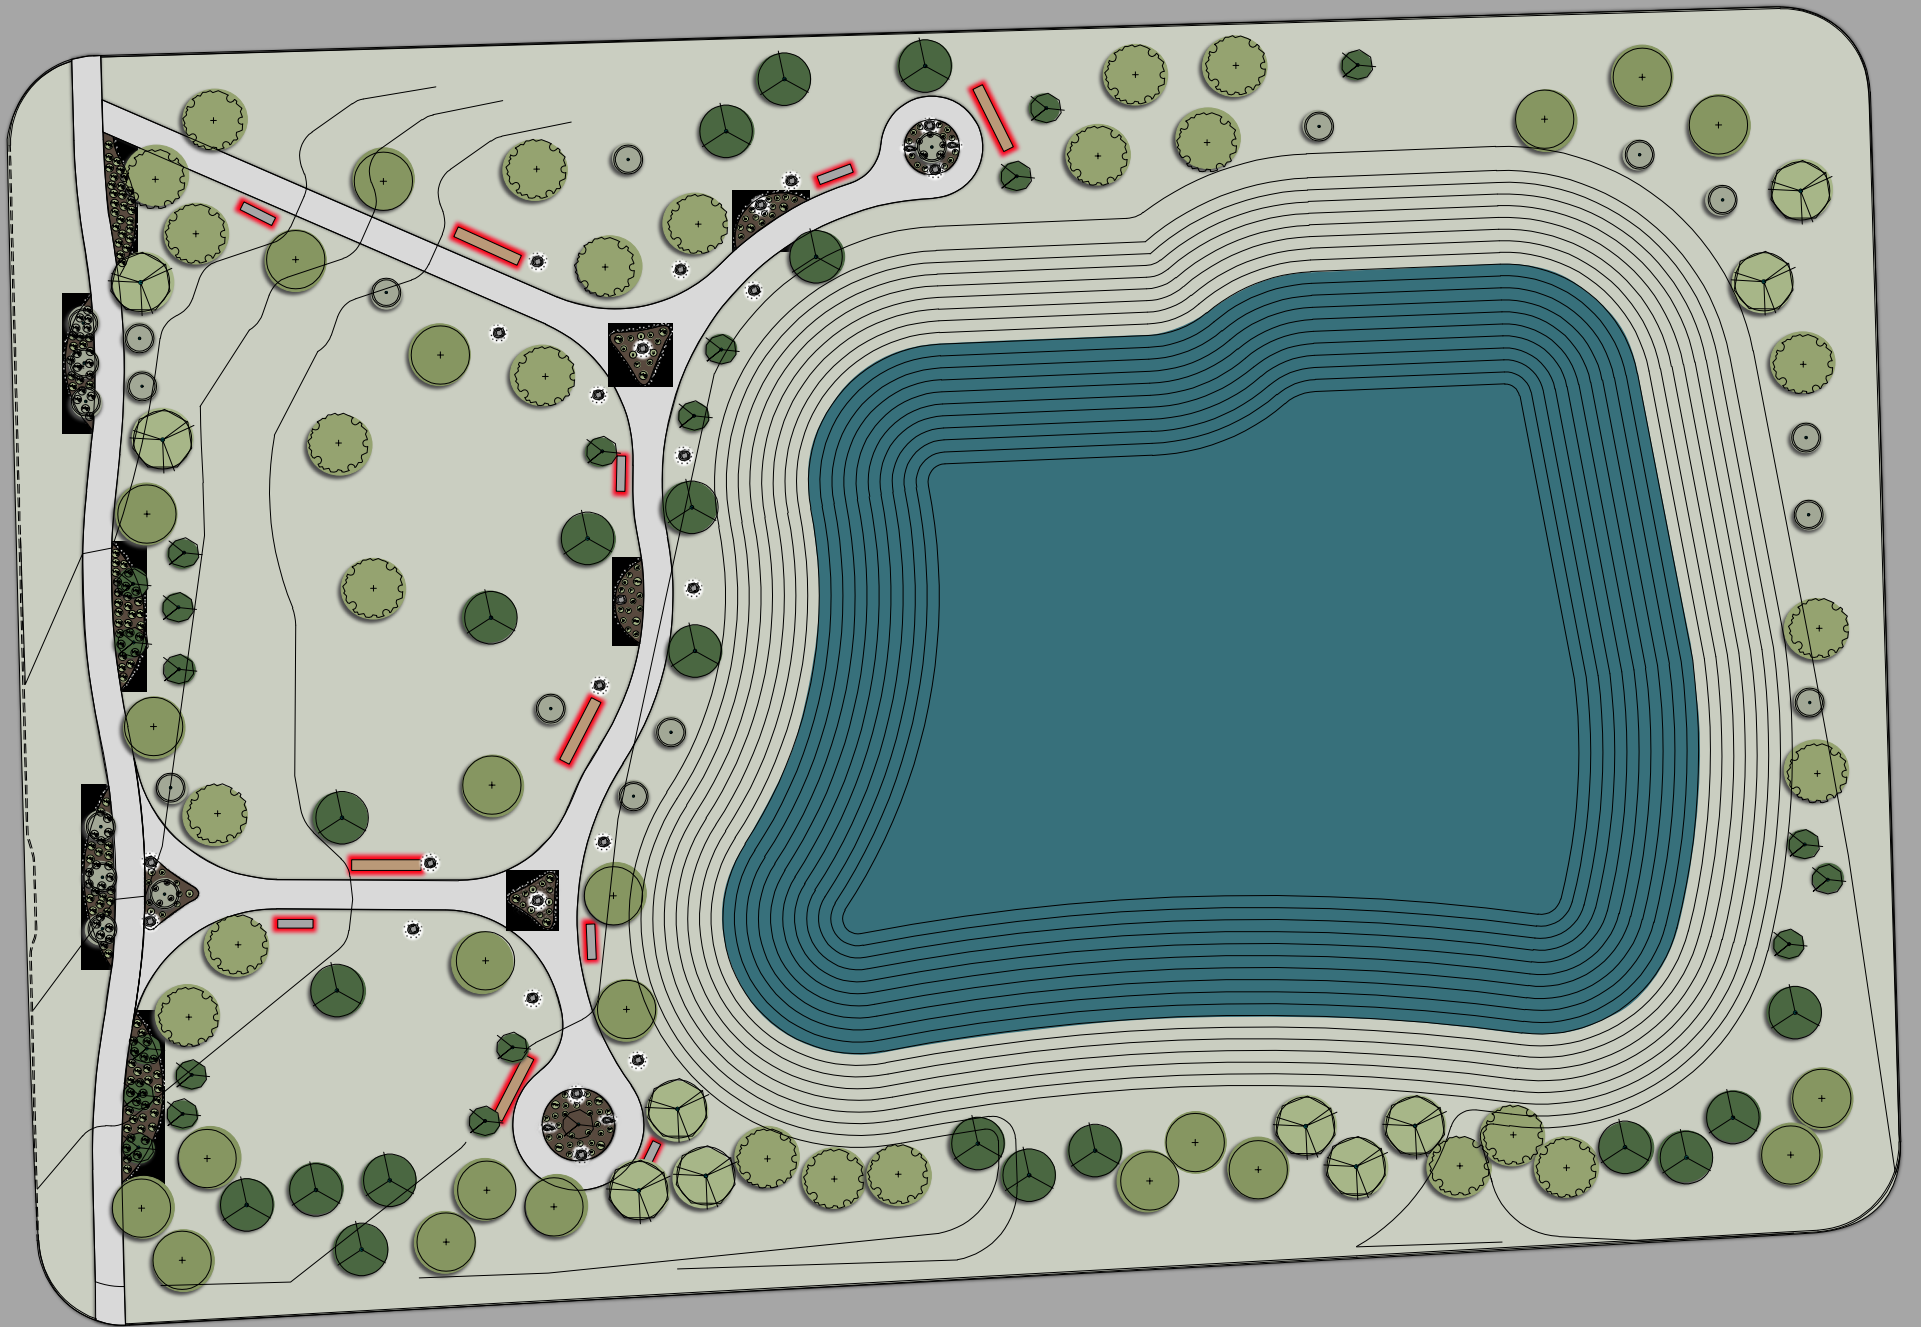





Rockwall ISD 9th Grade Center South

Rockwall, TX

Lighting System

Pole / Fixture Summary						
Pole ID	Pole Height	Mtg Height	Fixture Qty	Luminaire Type	Load	Circuit
A1-A2	70'	70'	4	TLC-LED-1500	5.72 kW	D
B1-B2	80'	16'	1	TLC-BT-575	0.58 kW	D
		80'	6	TLC-LED-1500	8.58 kW	D
C1-C2	70'	70'	3	TLC-LED-1200	3.51 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
D1-D2	70'	70'	4	TLC-LED-1200	4.68 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
F1-F4	80'	80'	7	TLC-LED-1500	10.01 kW	A
		16'	2	TLC-BT-575	1.15 kW	A
T1-T2	40'	40'	2	TLC-LED-600	1.16 kW	B
T3	40'	40'	2	TLC-LED-600	1.16 kW	B
		40'	2	TLC-LED-600	1.16 kW	C
T4	40'	40'	2	TLC-LED-600	1.16 kW	C
		40'	2	TLC-LED-600	1.16 kW	B
T5-T6	40'	40'	2	TLC-LED-600	1.16 kW	C
18			94		103.50 kW	

Circuit Summary			
Circuit	Description	Load	Fixture Qty
A	Football	44.64 kW	36
B	Tennis 1-2	4.64 kW	8
C	Tennis 3-4	4.64 kW	8
D	Baseball	49.58 kW	42

Fixture Type Summary							
Type	Source	Wattage	Lumens	L90	L80	L70	Quantity
TLC-LED-1500	LED 5700K - 75 CRI	1430W	160,000	>120,000	>120,000	>120,000	48
TLC-LED-1200	LED 5700K - 75 CRI	1170W	136,000	>120,000	>120,000	>120,000	14
TLC-BT-575	LED 5700K - 75 CRI	575W	52,000	>120,000	>120,000	>120,000	16
TLC-LED-600	LED 5700K - 75 CRI	580W	65,600	>120,000	>120,000	>120,000	16

Light Level Summary

Calculation Grid Summary								
Grid Name	Calculation Metric	Illumination					Circuits	Fixture Qty
		Ave	Min	Max	Max/Min	Ave/Min		
Baseball (Infield)	Horizontal Illuminance	52.7	39	69	1.75	1.35	D	42
Baseball (Outfield)	Horizontal Illuminance	33.4	26	45	1.75	1.28	D	42
Football	Horizontal Illuminance	36	31	43	1.40	1.16	A	36
Tennis 1-2	Horizontal Illuminance	37.5	30	48	1.61	1.25	B	8
Tennis 3-4	Horizontal Illuminance	37.1	30	49	1.64	1.24	C	8
Track	Horizontal Illuminance	18.7	3	38	11.34	6.22	A	36

From Hometown to Professional




EQUIPMENT LIST FOR AREAS SHOWN							
Pole				Luminaires			
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID / OTHER GRIDS
4	F1-F4	80'	-	15.5'	TLC-BT-575	2	2 0
				80'	TLC-LED-1500	7	7 0
4	TOTALS					36	36 0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Football
Size:	360' x 160'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
	Entire Grid
Guaranteed Average:	30
Scan Average:	35.95
Maximum:	43
Minimum:	31
Avg / Min:	1.17
Guaranteed Max / Min:	2.5
Max / Min:	1.40
UG (adjacent pts):	1.17
CU:	0.47
No. of Points:	72
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

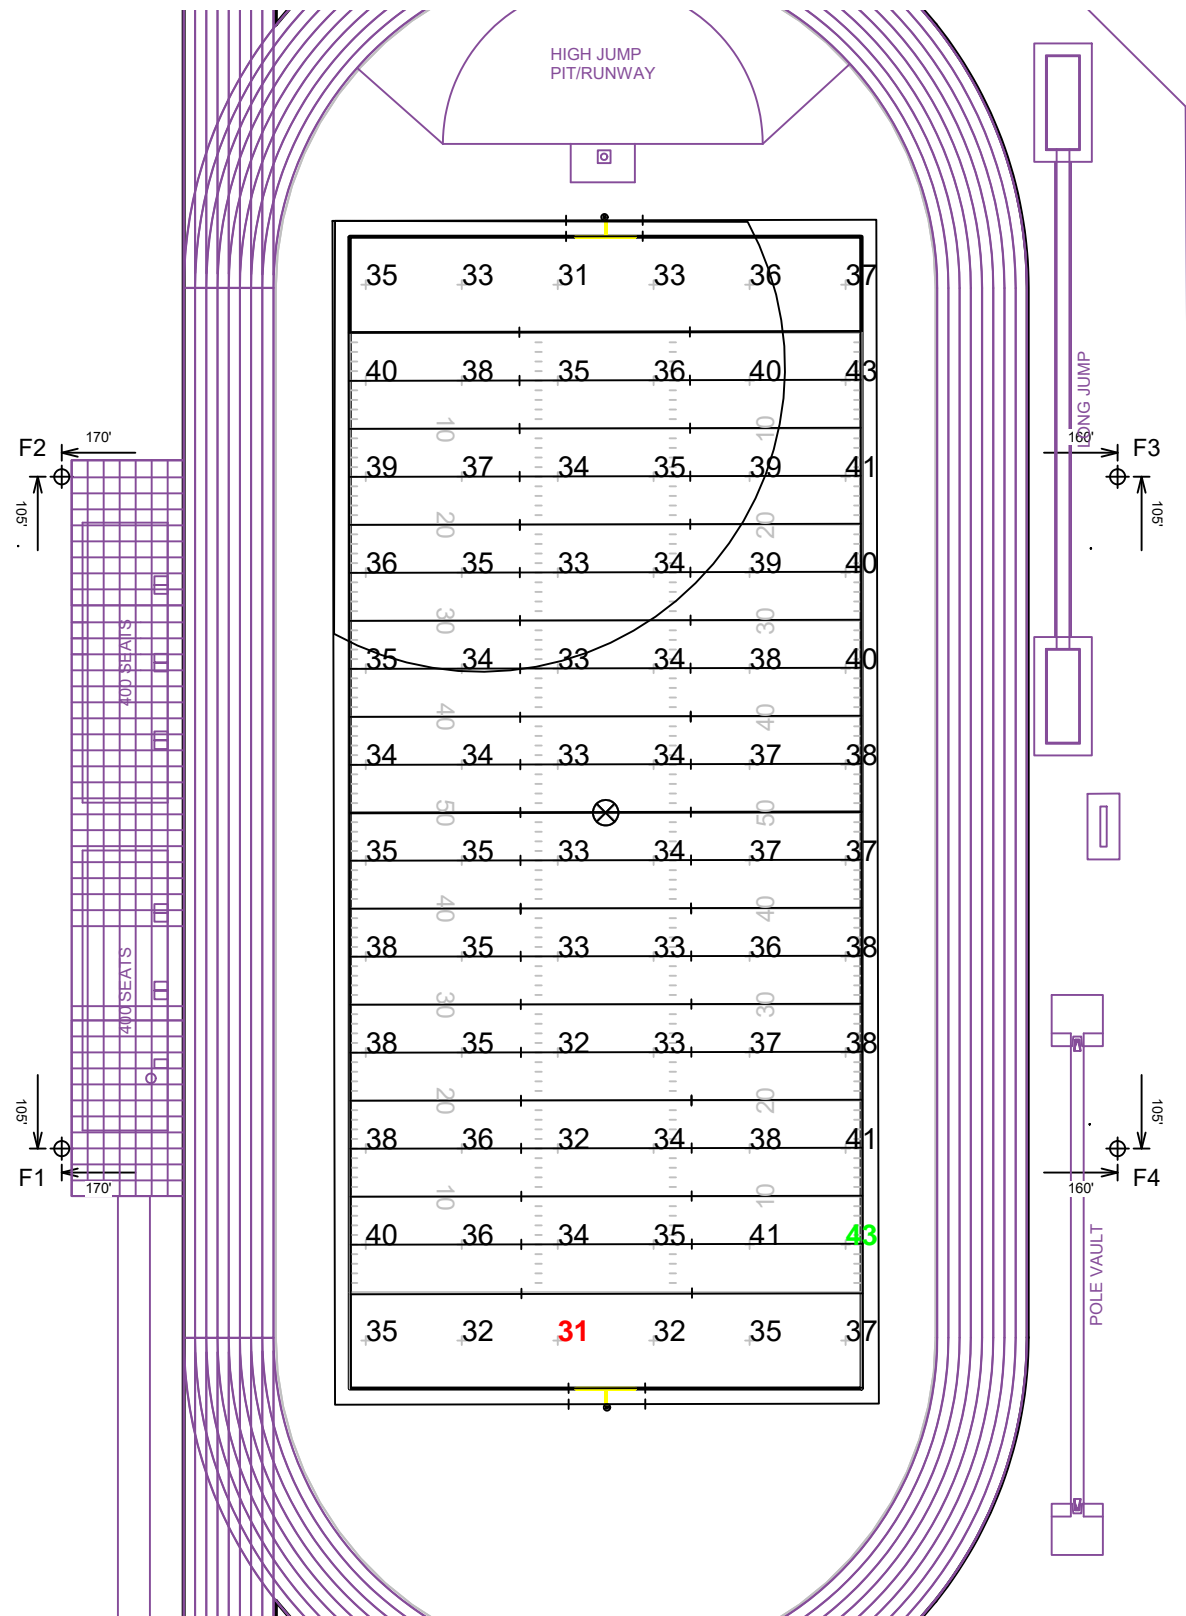


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.


EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
4	F1-F4	80'	0'	15.52'	TLC-BT-575	2	2	0
				80'	TLC-LED-1500	7	7	0
4	TOTALS					36	36	0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Track
Size:	Irregular
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
	Entire Grid
Scan Average:	18.66
Maximum:	38
Minimum:	3
Avg / Min:	5.56
Max / Min:	11.34
UG (adjacent pts):	0.00
CU:	0.16
No. of Points:	48
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

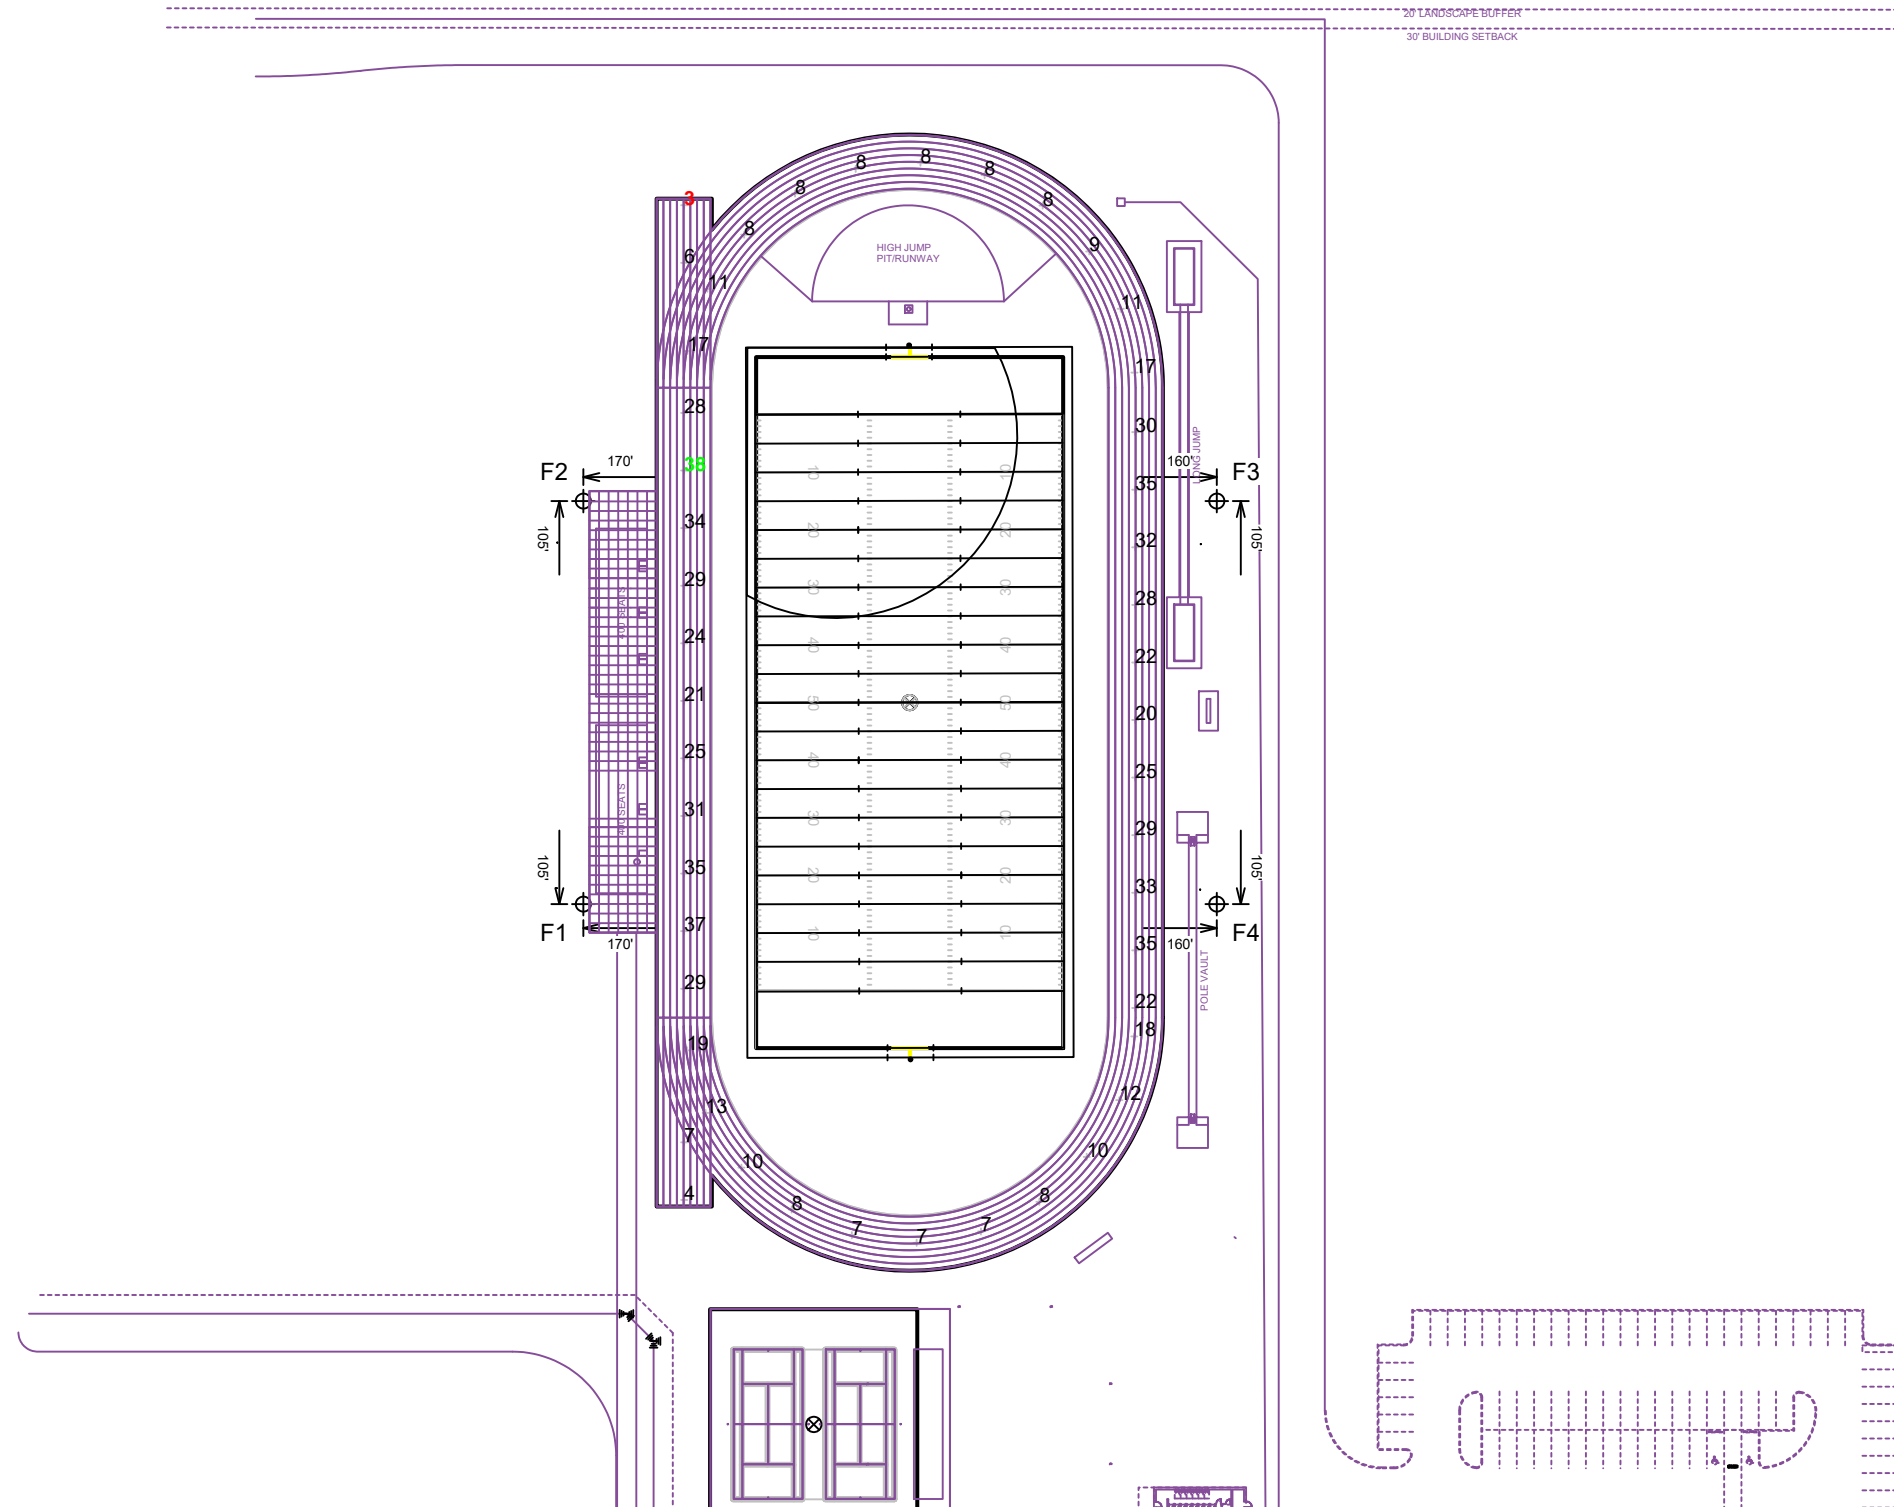


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume $\pm 3\%$ nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) \oplus dimensions are relative to 0,0 reference point(s) \otimes



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY

Rockwall ISD 9th Grade Center South

Rockwall, TX

EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T1-T2	40'	-	40'	TLC-LED-600	2	2	0
2	T3-T4	40'	-	40'	TLC-LED-600	4	2	2
4	TOTALS					12	8	4

GRID SUMMARY	
Name:	Tennis 1-2
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade




ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.52
Maximum:	48
Minimum:	30
Avg / Min:	1.26
Guaranteed Max / Min:	2.5
Max / Min:	1.61
UG (adjacent pts):	0.00
CU:	0.89
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	B
No. of Luminaires:	8
Total Load:	4.64 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

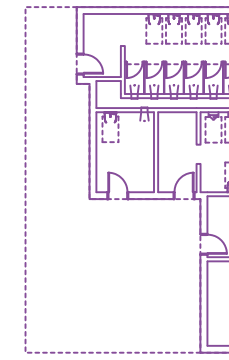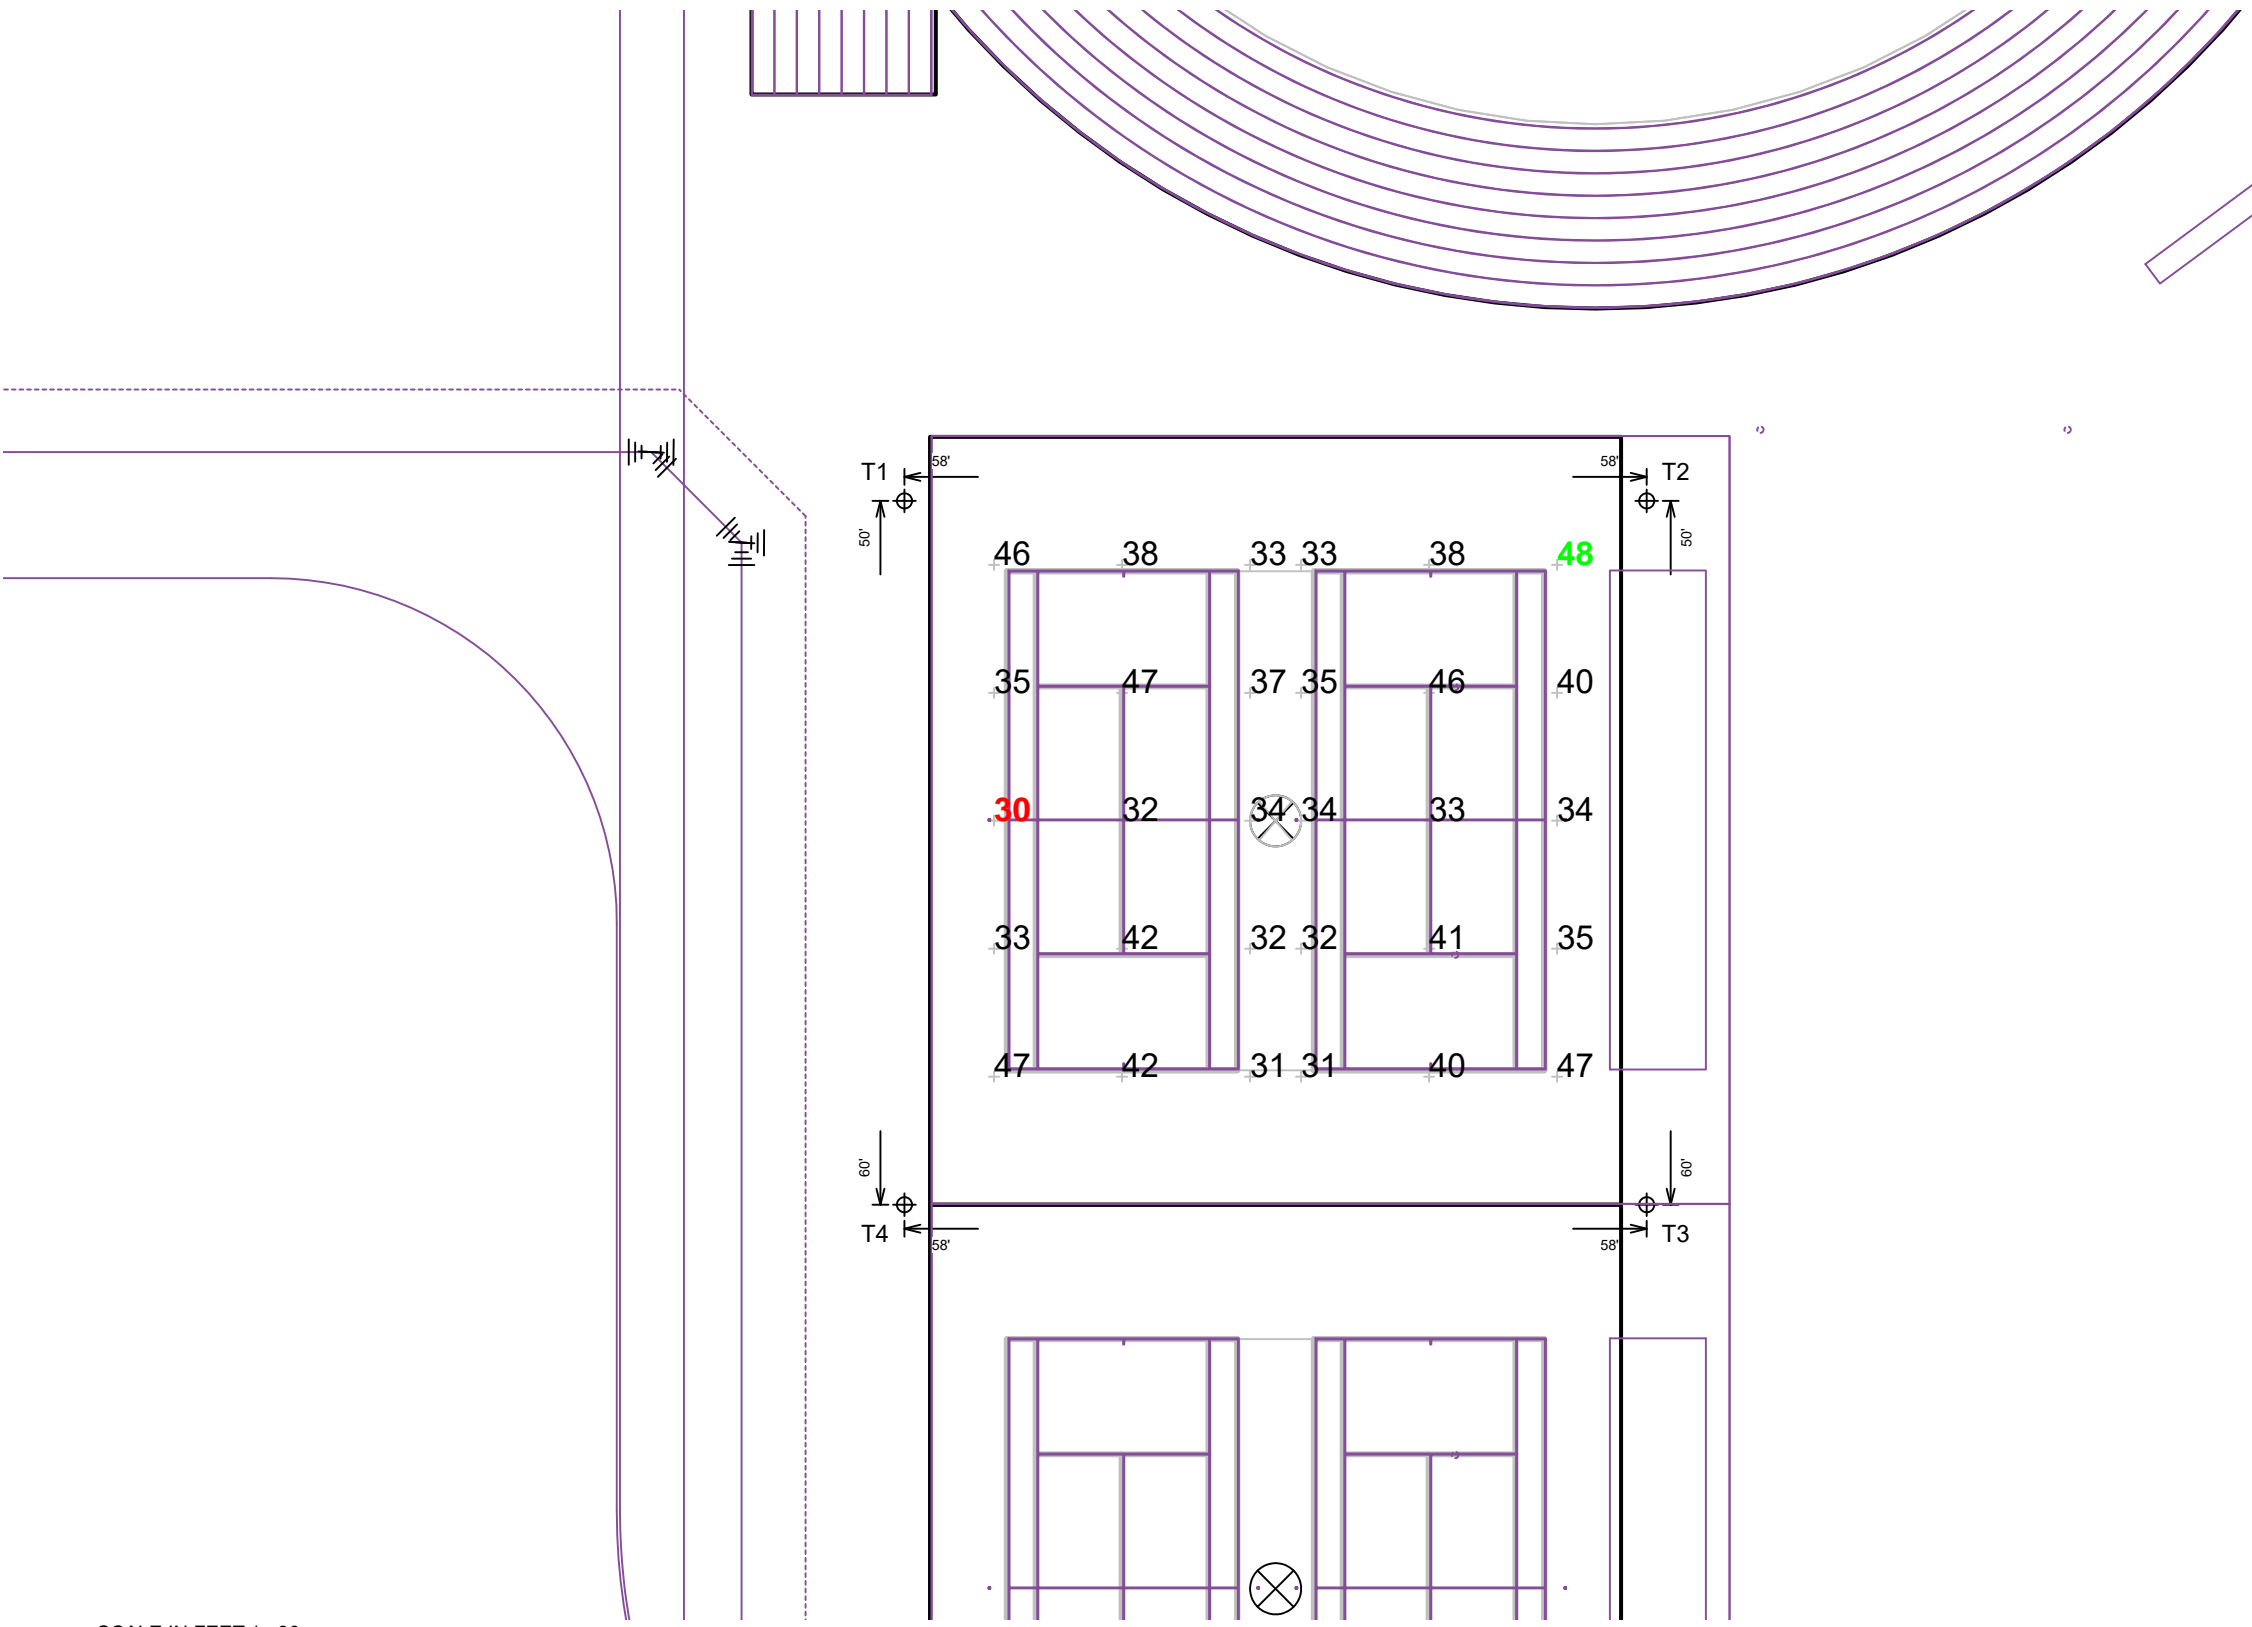

Pole location(s) Ⓧ dimensions are relative to 0,0 reference point(s) ⊗




EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T3-T4	40'	0'	40'	TLC-LED-600	4	2	2
2	T5-T6	40'	-	40'	TLC-LED-600	2	2	0
4	TOTALS					12	8	4

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Tennis 3-4
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.13
Maximum:	49
Minimum:	30
Avg / Min:	1.23
Guaranteed Max / Min:	2.5
Max / Min:	1.64
UG (adjacent pts):	0.00
CU:	0.88
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	C
No. of Luminaires:	8
Total Load:	4.64 kW

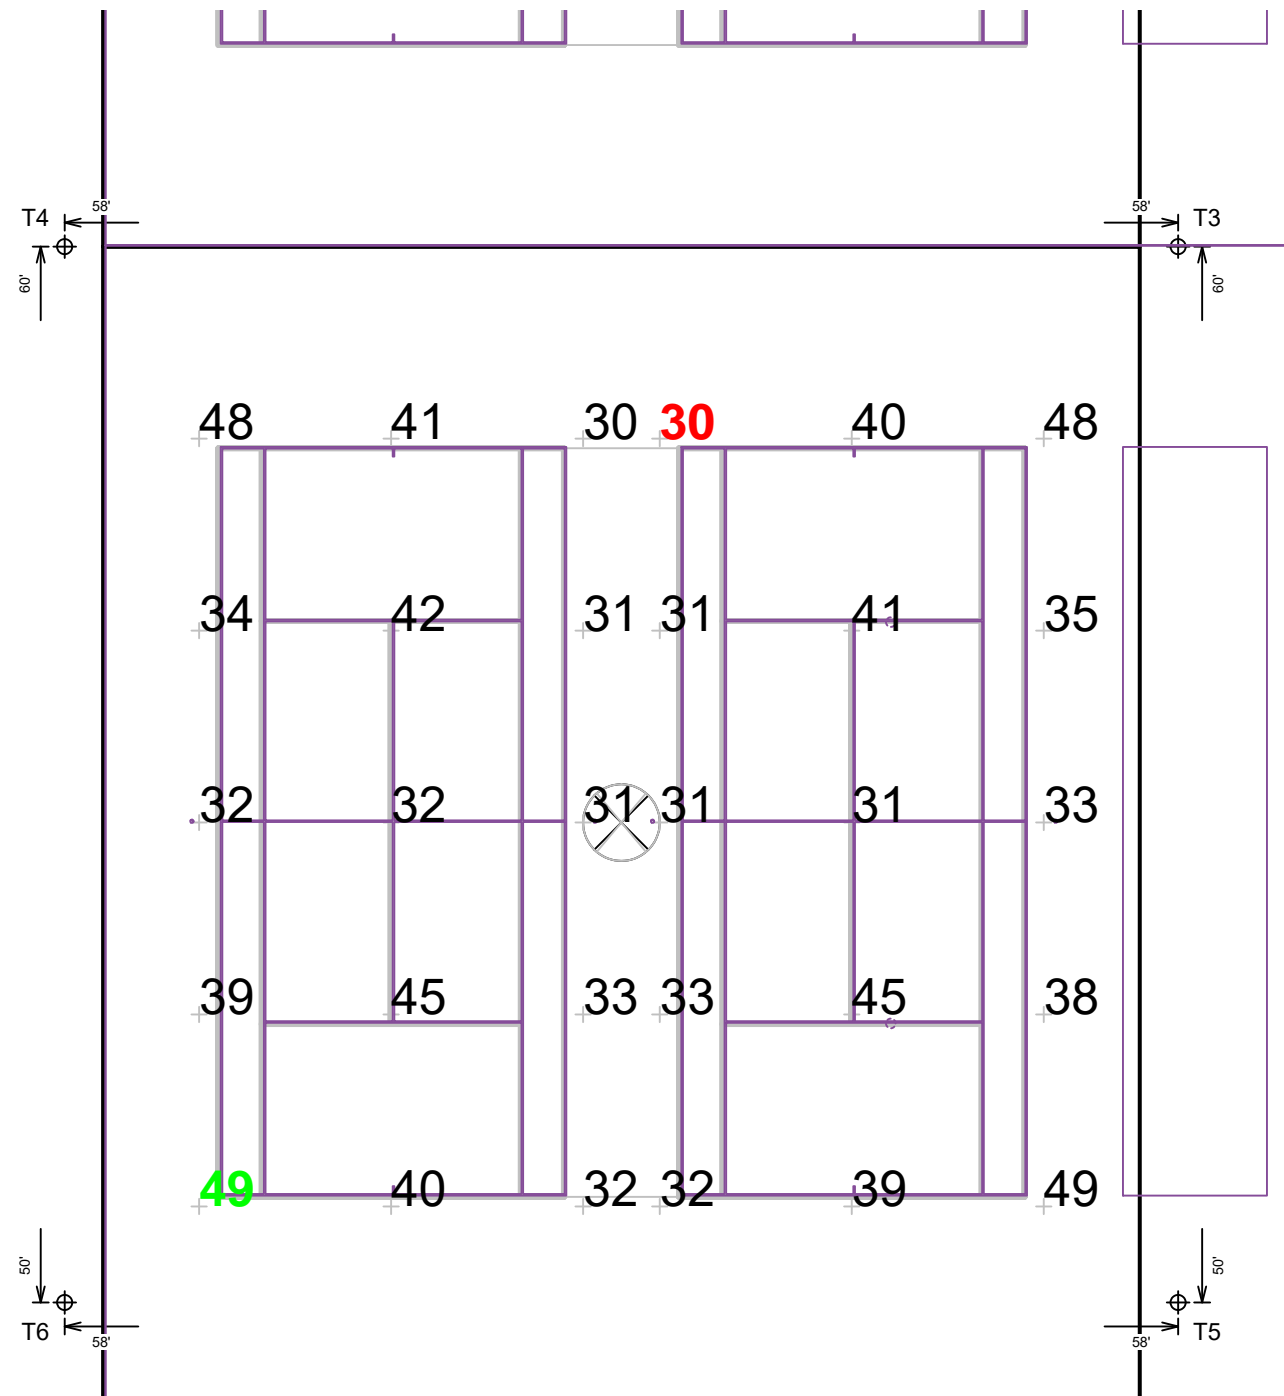

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.


Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

DO NOT ENTER

SCALE IN FEET 1 : 20



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗




We Make It Happen.

Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

EQUIPMENT LIST FOR AREAS SHOWN								
Pole			Luminaires					
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	A1-A2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1500	4	4	0
2	B1-B2	80'	-	15.5'	TLC-BT-575	1	1	0
				80'	TLC-LED-1500	6	6	0
2	C1-C2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	3	3	0
2	D1-D2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	4	4	0
8	TOTALS					42	42	0

GRID SUMMARY	
Name:	Baseball
Size:	Irregular 315' / 390' / 315'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY		
MAINTAINED HORIZONTAL FOOTCANDLES		
	Infield	Outfield
Guaranteed Average:	50	30
Scan Average:	52.69	33.40
Maximum:	69	45
Minimum:	39	26
Avg / Min:	1.34	1.30
Guaranteed Max / Min:	2	2.5
Max / Min:	1.75	1.75
UG (adjacent pts):	1.21	1.34
CU:	0.73	
No. of Points:	25	93
LUMINAIRE INFORMATION		
Applied Circuits:	D	
No. of Luminaires:	42	
Total Load:	49.58 kW	

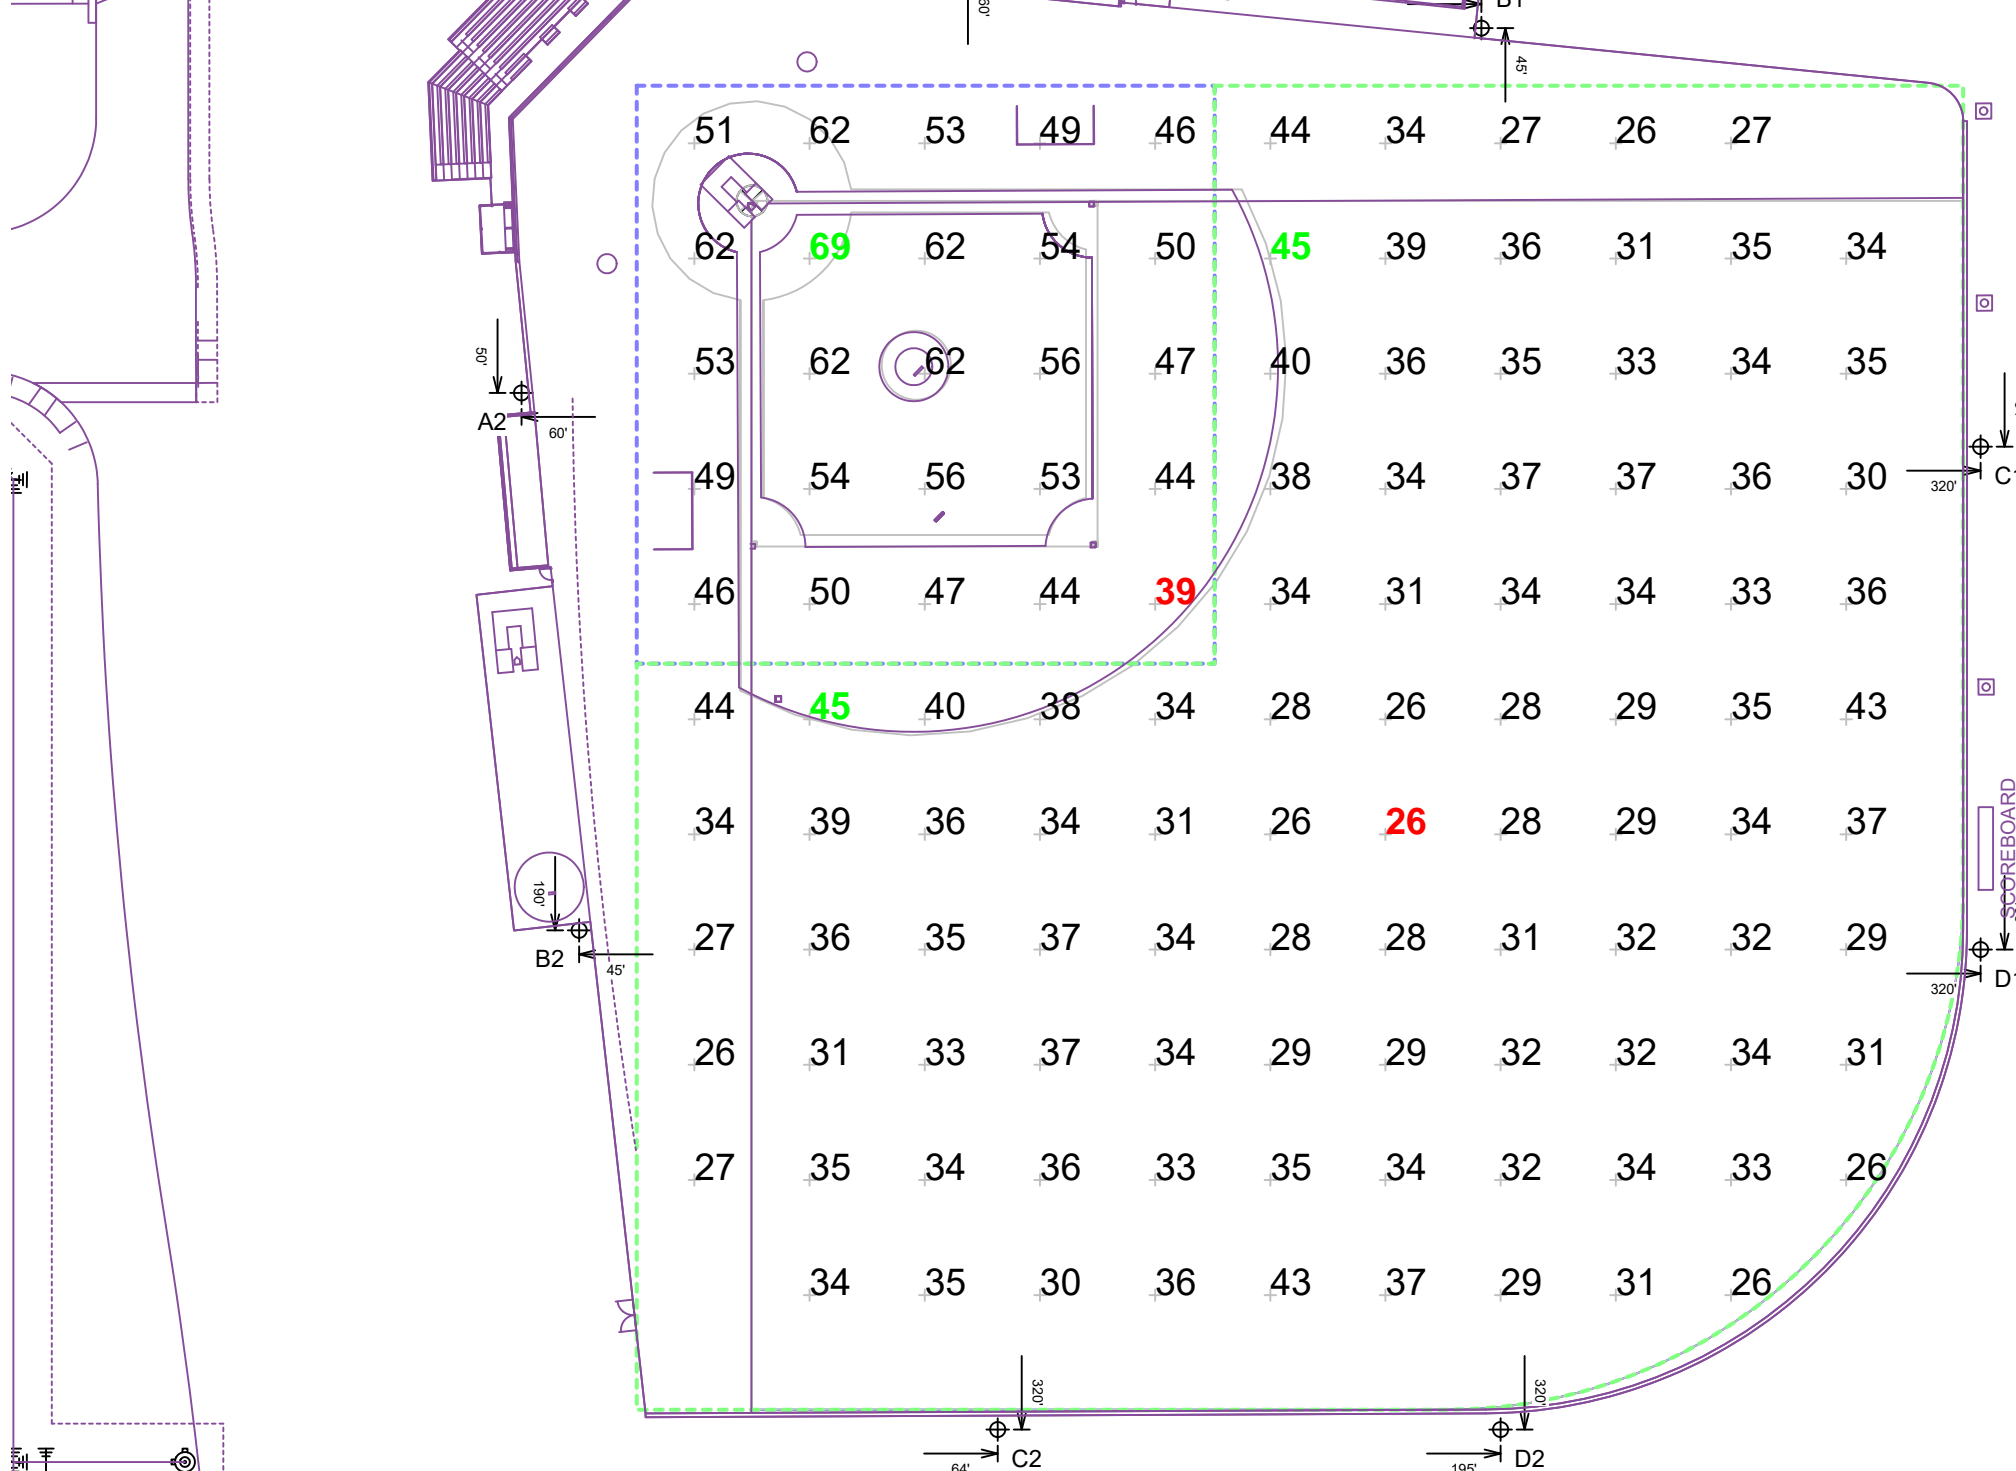


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.


Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) Ⓧ dimensions are relative to 0,0 reference point(s) ⊗



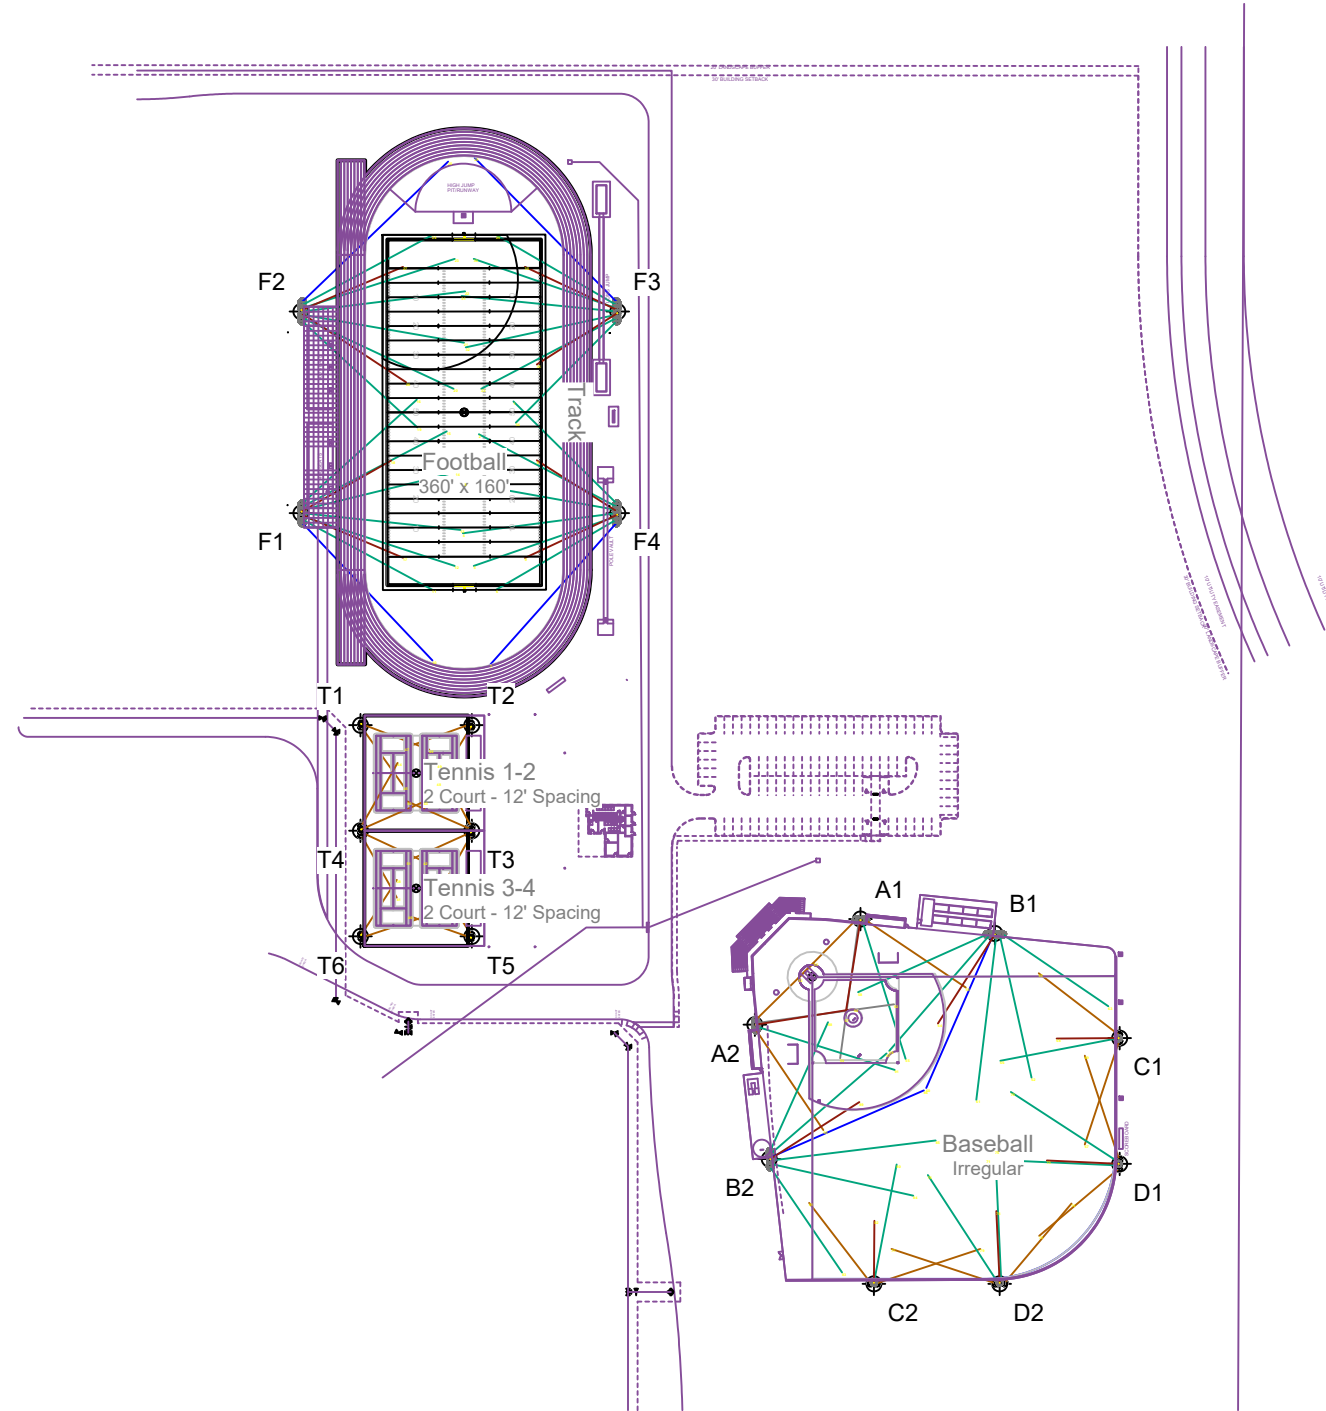

EQUIPMENT LAYOUT

INCLUDES:

- Baseball
- Football
- Tennis 1-2
- Tennis 3-4
- Track

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.


Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

EQUIPMENT LIST FOR AREAS SHOWN

QTY	Pole			Luminaires		QTY / POLE
	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	
2	A1-A2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1500	1 4
2	B1-B2	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	1 6
2	C1-C2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 3
2	D1-D2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 4
4	F1-F4	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	2 7
4	T1-T2 T5-T6	40'	-	40'	TLC-LED-600	2
2	T3-T4	40'	-	40'	TLC-LED-600	4
18	TOTALS					94

SINGLE LUMINAIRE AMPERAGE DRAW CHART

Ballast Specifications (.90 min power factor)	Line Amperage Per Luminaire (max draw)						
	208 (60)	220 (60)	240 (60)	277 (60)	347 (60)	380 (60)	480 (60)
Single Phase Voltage							
TLC-LED-1500	8.5	8.1	7.4	6.4	5.1	4.7	3.7
TLC-LED-1200	7.0	6.6	6.1	5.2	4.2	4.0	3.0
TLC-BT-575	3.4	3.2	2.9	2.5	2.0	1.8	1.5
TLC-LED-600	3.4	3.2	3.0	2.6	2.0	1.9	1.5



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗







DEVELOPMENT APPLICATION

City of Rockwall
Planning and Zoning Department
385 S. Goliad Street
Rockwall, Texas 75087

STAFF USE ONLY

PLANNING & ZONING CASE NO.

NOTE: THE APPLICATION IS NOT CONSIDERED ACCEPTED BY THE CITY UNTIL THE PLANNING DIRECTOR AND CITY ENGINEER HAVE SIGNED BELOW.

DIRECTOR OF PLANNING:

CITY ENGINEER:

PLEASE CHECK THE APPROPRIATE BOX BELOW TO INDICATE THE TYPE OF DEVELOPMENT REQUEST [SELECT ONLY ONE BOX]:

PLATTING APPLICATION FEES:

- MASTER PLAT (\$100.00 + \$15.00 ACRE)¹
- PRELIMINARY PLAT (\$200.00 + \$15.00 ACRE)¹
- FINAL PLAT (\$300.00 + \$20.00 ACRE)¹
- REPLAT (\$300.00 + \$20.00 ACRE)¹
- AMENDING OR MINOR PLAT (\$150.00)
- PLAT REINSTATEMENT REQUEST (\$100.00)

SITE PLAN APPLICATION FEES:

- SITE PLAN (\$250.00 + \$20.00 ACRE)¹
- AMENDED SITE PLAN/ELEVATIONS/LANDSCAPING PLAN (\$100.00)

ZONING APPLICATION FEES:

- ZONING CHANGE (\$200.00 + \$15.00 ACRE)¹
- SPECIFIC USE PERMIT (\$200.00 + \$15.00 ACRE)^{1 & 2}
- PD DEVELOPMENT PLANS (\$200.00 + \$15.00 ACRE)¹

OTHER APPLICATION FEES:

- TREE REMOVAL (\$75.00)
- VARIANCE REQUEST/SPECIAL EXCEPTIONS (\$100.00)²

NOTES:

¹: IN DETERMINING THE FEE, PLEASE USE THE EXACT ACREAGE WHEN MULTIPLYING BY THE PER ACRE AMOUNT. FOR REQUESTS ON LESS THAN ONE ACRE, ROUND UP TO ONE (1) ACRE.
²: A \$1,000.00 FEE WILL BE ADDED TO THE APPLICATION FEE FOR ANY REQUEST THAT INVOLVES CONSTRUCTION WITHOUT OR NOT IN COMPLIANCE TO AN APPROVED BUILDING PERMIT.

PROPERTY INFORMATION [PLEASE PRINT]

ADDRESS 2727 S. John King Blvd, Rockwall, TX 75032

SUBDIVISION Rockwall Heath High School 9th Grade Center

LOT 1 BLOCK A

GENERAL LOCATION Rockwall 9th Grade Center - South site - at the Gene Burton Academy

ZONING, SITE PLAN AND PLATTING INFORMATION [PLEASE PRINT]

CURRENT ZONING AG CURRENT USE PUBLIC SCHOOL

PROPOSED ZONING NEIGHBORHOOD SERVICES PROPOSED USE PUBLIC SCHOOL

ACREAGE 27.446 LOTS [CURRENT] 1 LOTS [PROPOSED] 1

SITE PLANS AND PLATS: BY CHECKING THIS BOX YOU ACKNOWLEDGE THAT DUE TO THE PASSAGE OF HB3167 THE CITY NO LONGER HAS FLEXIBILITY WITH REGARD TO ITS APPROVAL PROCESS, AND FAILURE TO ADDRESS ANY OF STAFF'S COMMENTS BY THE DATE PROVIDED ON THE DEVELOPMENT CALENDAR WILL RESULT IN THE DENIAL OF YOUR CASE.

OWNER/APPLICANT/AGENT INFORMATION [PLEASE PRINT/CHECK THE PRIMARY CONTACT/ORIGINAL SIGNATURES ARE REQUIRED]

OWNER Rockwall Independent School District APPLICANT Glenn Engineering Corp.

CONTACT PERSON William Salee - Executive Director of Operations

CONTACT PERSON Robert Howman

ADDRESS 1191 T.L. Townsend Drive

ADDRESS 4500 Fuller Drive

Suite 220

CITY, STATE & ZIP Rockwall, Texas 75087

CITY, STATE & ZIP Irving, Texas 75038

PHONE 469-698-7031

PHONE 972-989-2174 cell

E-MAIL will.salee@rockwallisd.org

E-MAIL rahowman@glennengineering.com

NOTARY VERIFICATION [REQUIRED]

BEFORE ME, THE UNDERSIGNED AUTHORITY, ON THIS DAY PERSONALLY APPEARED Will Salee [OWNER] THE UNDERSIGNED, WHO STATED THE INFORMATION ON THIS APPLICATION TO BE TRUE AND CERTIFIED THE FOLLOWING:


I HEREBY CERTIFY THAT I AM THE OWNER FOR THE PURPOSE OF THIS APPLICATION; ALL INFORMATION SUBMITTED HEREIN IS TRUE AND CORRECT; AND THE APPLICATION FEE OF \$ 100.00 TO COVER THE COST OF THIS APPLICATION, HAS BEEN PAID TO THE CITY OF ROCKWALL ON THIS THE 19th DAY OF August, 2022. BY SIGNING THIS APPLICATION, I AGREE THAT THE CITY OF ROCKWALL (I.E. "CITY") IS AUTHORIZED AND PERMITTED TO PROVIDE INFORMATION CONTAINED WITHIN THIS APPLICATION TO THE PUBLIC. THE CITY IS ALSO AUTHORIZED AND PERMITTED TO REPRODUCE ANY COPYRIGHTED INFORMATION SUBMITTED IN CONJUNCTION WITH THIS APPLICATION, IF SUCH REPRODUCTION IS ASSOCIATED OR IN RESPONSE TO A REQUEST FOR PUBLIC INFORMATION."


GIVEN UNDER MY HAND AND SEAL OF OFFICE ON THIS THE 19th DAY OF August, 2022

OWNER'S SIGNATURE

NOTARY PUBLIC IN AND FOR THE STATE OF TEXAS

Will Salee
Diana Chapman

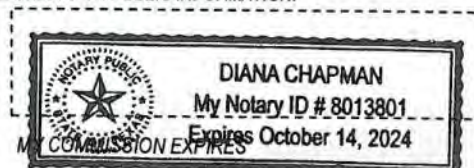

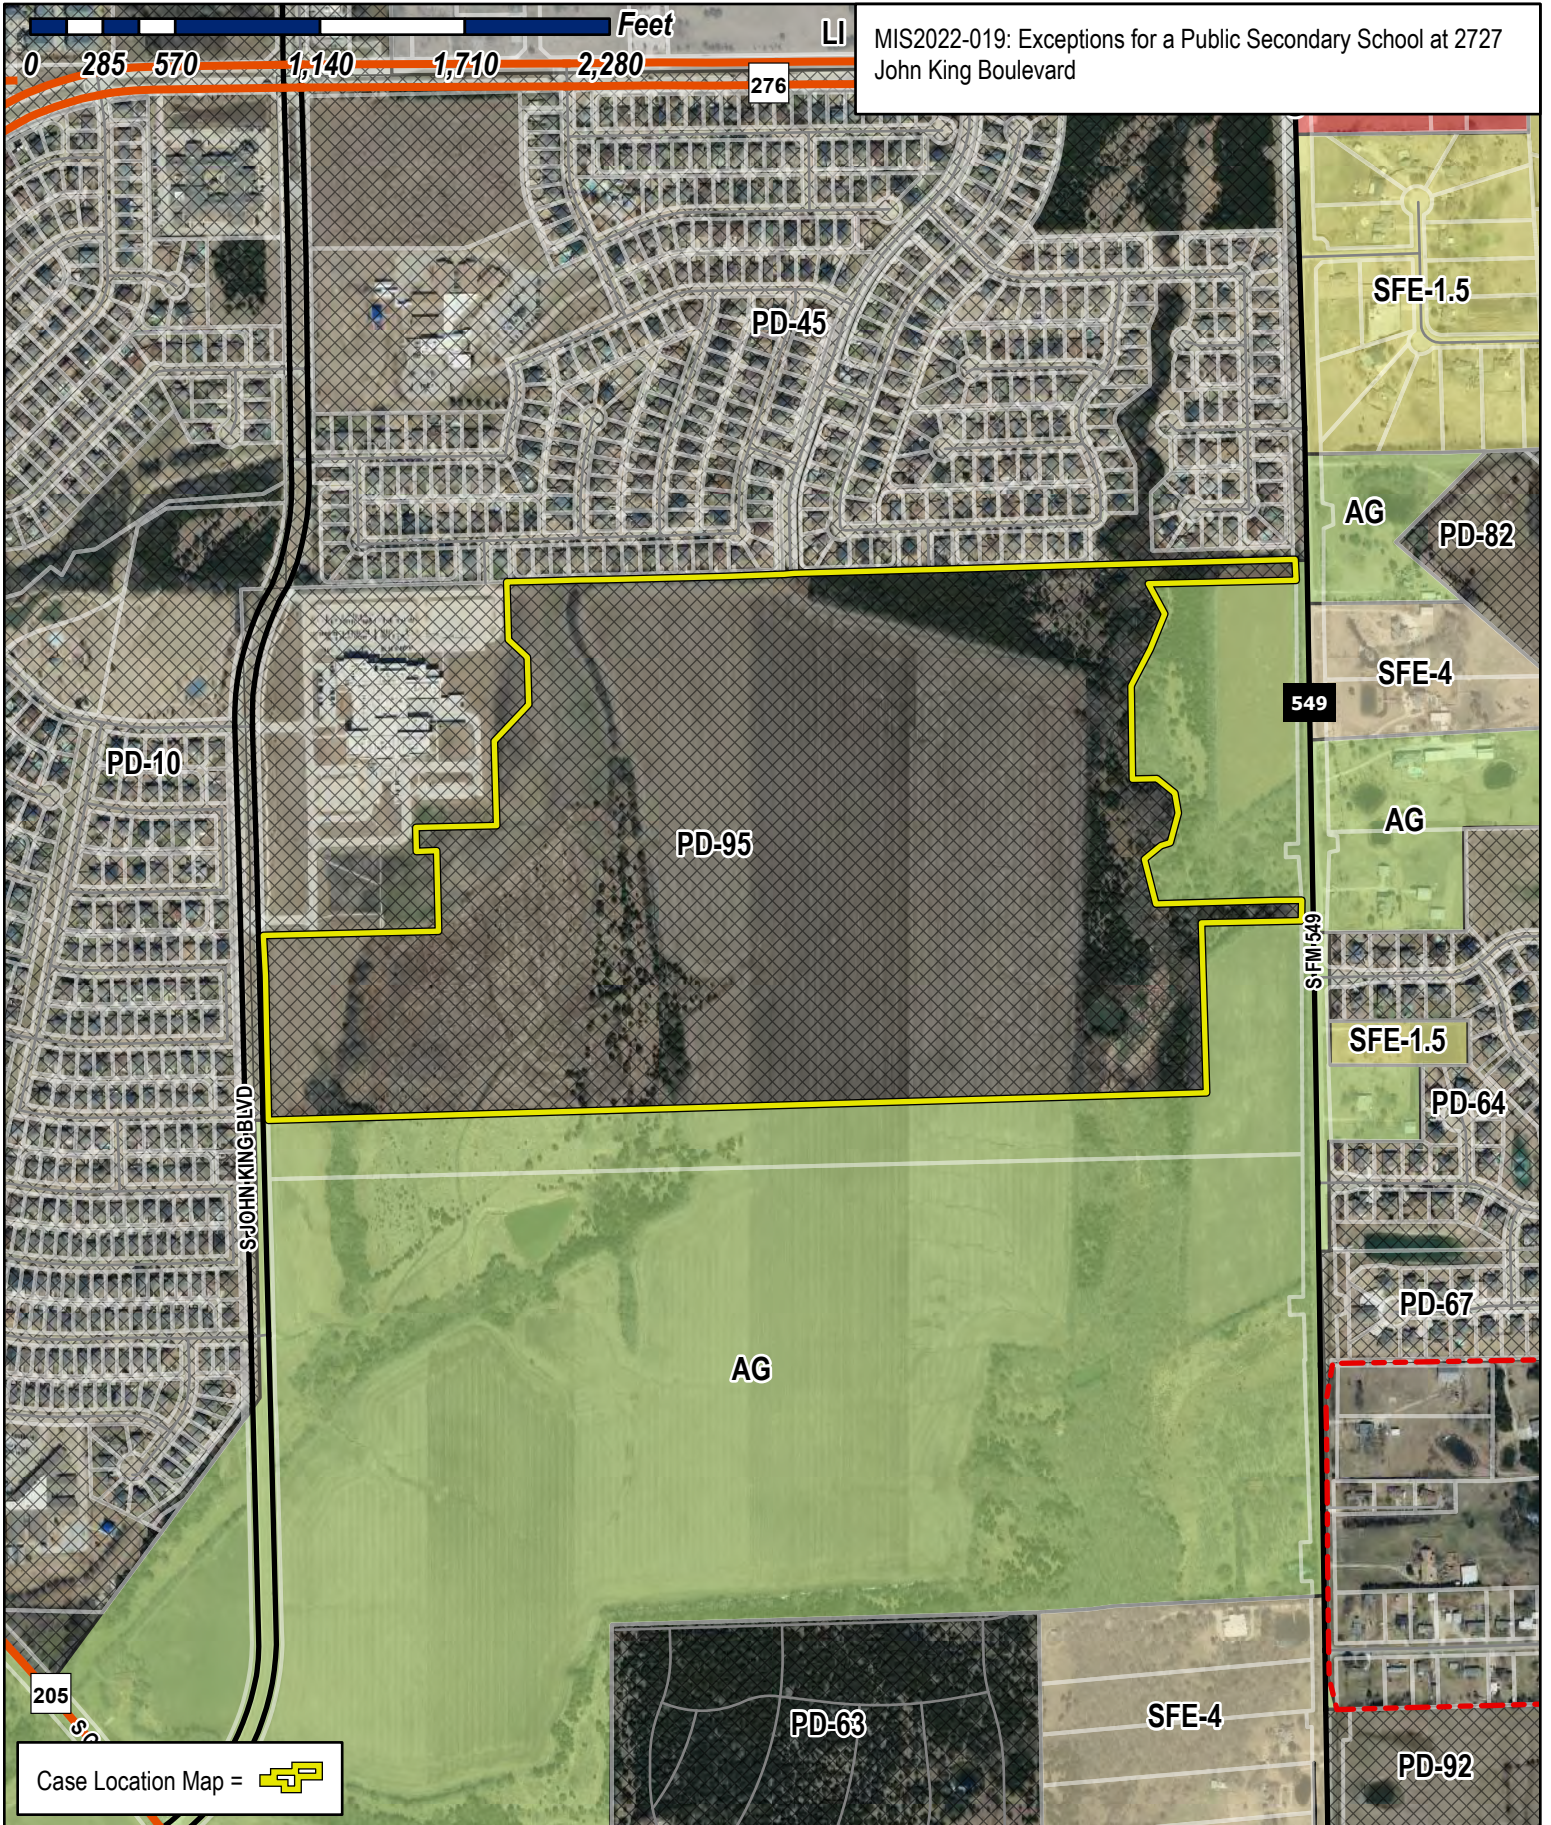

City of Rockwall

Planning & Zoning Department
 385 S. Goliad Street
 Rockwall, Texas 75032
 (P): (972) 771-7745
 (W): www.rockwall.com

The City of Rockwall GIS maps are continually under development and therefore subject to change without notice. While we endeavor to provide timely and accurate information, we make no guarantees. The City of Rockwall makes no warranty, express or implied, including warranties of merchantability and fitness for a particular purpose. Use of the information is the sole responsibility of the user.





August 19, 2022

Ryan Miller
Director of Planning
City of Rockwall
385 South Goliad
Rockwall, TX 75087

**Rockwall ISD – Updated Site Plans for Ninth Grade Center Projects:
SP 2022-17 (FM1141& Quail Run) & SP2022-18 (John King Blvd at GBCCA)**

Mr. Miller,

Per recent site plan approval for the above referenced projects on July 12, 2022 by the Planning & Zoning Commission, there were the following conditional approval items noted by the city staff that are to be addressed related to landscape plan requirements and sports field/court lighting:

North Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing landscaping along the right-of-way of Panhandle Drive (i.e. berms and shrubbery with a minimum of one [1] canopy tree and one [1] accent tree per 50-feet of linear frontage). In addition, the Landscape Plan should show one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

South Site:

- (1) *The applicant will need to provide an updated Landscape Plan showing one (1) canopy tree per 750 SF of detention area and one (1) accent tree per 1,500 SF of detention area.*
- (2) *The applicant must request an exception for any light pole greater than 30'-0" in height per Subsection 03.03.D, of Article 07*

Rockwall ISD is submitting updated landscape plans showing the number and location of proposed trees to include in regards to the detention areas. The North plan submitted with this letter includes the required landscaping along the Panhandle Drive right of way as required.

Landscape Plan – Detention Areas

Rockwall ISD is requesting a partial variance for consideration by the Planning & Zoning Commission. The space available around the perimeter of the detention pond is limited due to the required location on the site for these detention areas. At both sites, 3-tiered screening elements are adjacent to the detention areas limiting the amount of trees that can feasibly fit around and near the detention basin. Forcing trees in this area will create a scenario where tree canopy growth will inhibit any ground cover, reduce tree health, and increase the likelihood of erosion due to the lack of groundcover. All other required trees for the 3-tier screening and required parking lot trees are shown to be provided and we will be in compliance. As a result, the district is asking for the following variance:

Approval to disperse throughout the site as many of the required detention canopy and accent trees in open areas possible that are not reserved for future potential building expansions and in a manner that will not create a hazard, nuisance or erosion issue. Once those spaces are exhausted we propose to then omit the following numbers of trees per site:



North Site:

Number of Required Detention Trees: (155) Number of trees proposed to be planted: (101)
Omit (36) Canopy Trees & (18) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (162) Canopy Trees & (245) Accent Trees: (407) Total for Screening
- Required Trees at Parking Areas: (39) Canopy Trees

Total Number of Trees to be planted if variance is approved: (547) Total North Site Trees

South Site:

Number of Required Detention Trees: (198) Number of trees proposed to be planted: (132)
Omit (43) Canopy Trees & (23) Accent Trees related to detention area requirements.
Approximate percentage of detention trees requesting to omit: (35%)

Other Required Trees to be planted:

- 3-Tier Screening Trees (234) Canopy Trees & (70) Accent Trees: (304) Total for Screening
- Required Trees at Parking Areas: (53) Canopy Trees

Total Number of Trees to be planted if variance is approved: (489) Total South Site Trees

In lieu of investing resources in dispersed trees that do not serve the purpose of beautifying the detention area and would have to be removed in the future, the district would like to direct those resources to beautifying and creating community accessible amenities for the detention areas in the following ways as an alternate compliance method for consideration:

1. Create a Wet Pond - In lieu of a dry detention basin, the district would propose to make these a constant level wet retention pond while still functioning to detain runoff as required.
 - a. The pond would include an aeration fountain element
 - b. The pond would include circulation plumbing to minimize algae growth
 - c. The pond will have an organic shape and have a flagstone border
 - d. The district would utilize HVAC condensate collection to fill the pond in hot, humid summer & spring seasons where pond evaporation is the greatest.
2. Create Park Amenities -The district would create a park area that is accessible to the community off the adjacent thoroughfare (John King – South & Quail Run Road – North) from the required 10-foot wide walk pathways at both locations.
 - a. Please refer the provided rendered images of park areas for proposed aesthetics
 - b. Park area will include 10' meandering pathways to pond overlook areas
 - c. Park area will include multiple park bench seating areas off of walkways
 - d. Park area will include landscape boulders within park area as an enhanced landscape feature to reinforce a more natural park setting.

This alternative method proposed to beautify the pond would transform an otherwise unattractive drainage area on both sites to a park amenity that can be utilized by both the school district and the community and will ensure resources expended provide permanent beautification elements to the site. Rockwall ISD requests acceptance of this variance and the alternate compliance method in lieu of planting the partial amount of trees requested to be omitted at each site.



Sports Field Lighting – Exception Request

Per the above referenced comment, Rockwall ISD is requesting the following exceptions to install sports field lighting as necessary for utilization by the campus when daylight levels are not adequate for practice and game events:

1. Tennis Court Lighting – 40' above tennis court surface
2. Baseball Field Lighting – 70' above baseball field surface
3. Football/Soccer Field Lighting – 80' above field surface

Sports field lighting product data and photometric data are included in this request for review. All parking lot lighting at both site locations will be 25' above adjacent parking surfaces and be in compliance. The need for this exception request is to ensure light levels are adequate for these sports fields/courts for playability and safety.

The following mitigation items are proposed to be implemented:

1. Implementation of 3-tier landscape screening as required by City of Rockwall.
2. Intentional site location of fields on the property to minimize adjacency to the densest residential areas as possible as discussed in previous P&Z meetings.
3. Use of current LED sports field technology that allows LED lamps to be screened and focused on the play fields with minimal light spread beyond the field area.
4. Sports field/court lighting will be controlled by the district's energy management system. This will require users to make reservations to turn lights on and create the ability to have lockout times when lights cannot be used and the ability to turn off the fixtures remotely if required.

Rockwall ISD requests acceptance of the requested light pole height exceptions as proposed to ensure adequate playability of and safety of the field use.

I look forward to attending the Planning & Zoning Commission in person on August 30th to provide a presentation and address any questions the commission may have in regards to the districts proposed requests.

Sincerely,

A handwritten signature in blue ink, appearing to read 'Will Salee', is written over a light blue horizontal line.

Will Salee
Executive Director of Operations

N89°00'23"E
34.15'
(DEED CALL
N89°49'51"E
36.45')

N88°21'21" E 3926.93'

PART OF 58
N.L. L6
VOL. 38,

L6



L2

L3

L5

L4

SITE DATA SUMMARY	
EXISTING ZONING	AG
PROPOSED ZONING	PD FOR NS USES (2002-015)
USE	PUBLIC SCHOOL
LOT AREA	3,464,762 S.F. OR 75.54 AC.
BUILDING AREA (FLOOR AREA)	
PROPOSED FIRST FLOOR	150,170 S.F.
PROPOSED SECOND FLOOR	41,019 S.F.
TOTAL BUILDING AREA	191,189 S.F.
TOTAL FLOOR AREA (FIRST FLOOR)	150,170 S.F.
LOT COVERAGE	150,170 S.F./3,464,762 S.F. = 4.33%
FLOOR AREA RATIO	0.051
TOTAL IMPERVIOUS AREA	813,028.31 S.F. OR 18.66 AC.
BUILDING HEIGHT	137'-10" (2 STORY)
TOTAL REQUIRED PARKING (1 PER 5 STUDENTS)	203 SPACES
PARKING PROVIDED	
PARKING SURFACE	
9.0x18.0'	304 SPACES
9.0x20.0'	209 SPACES
15.0x30.0'	19 SPACES
TOTAL PARKING PROVIDED	532 SPACES

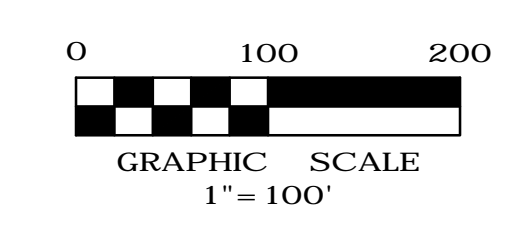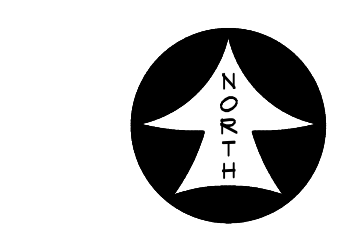

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
CONTACT: JAMES WATSON

SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMUO

CITY OF ROCKWALL CASE NO. SP2022-018

CORGAN

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, L.L.C.
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET


NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S. John King Blvd, Rockwall, TX 75032

OVERALL LANDSCAPE PLAN

JOB 21572.0000
DATE 08/16/22
SHEET

L 1

MATCHLINE SEE SHEET L2

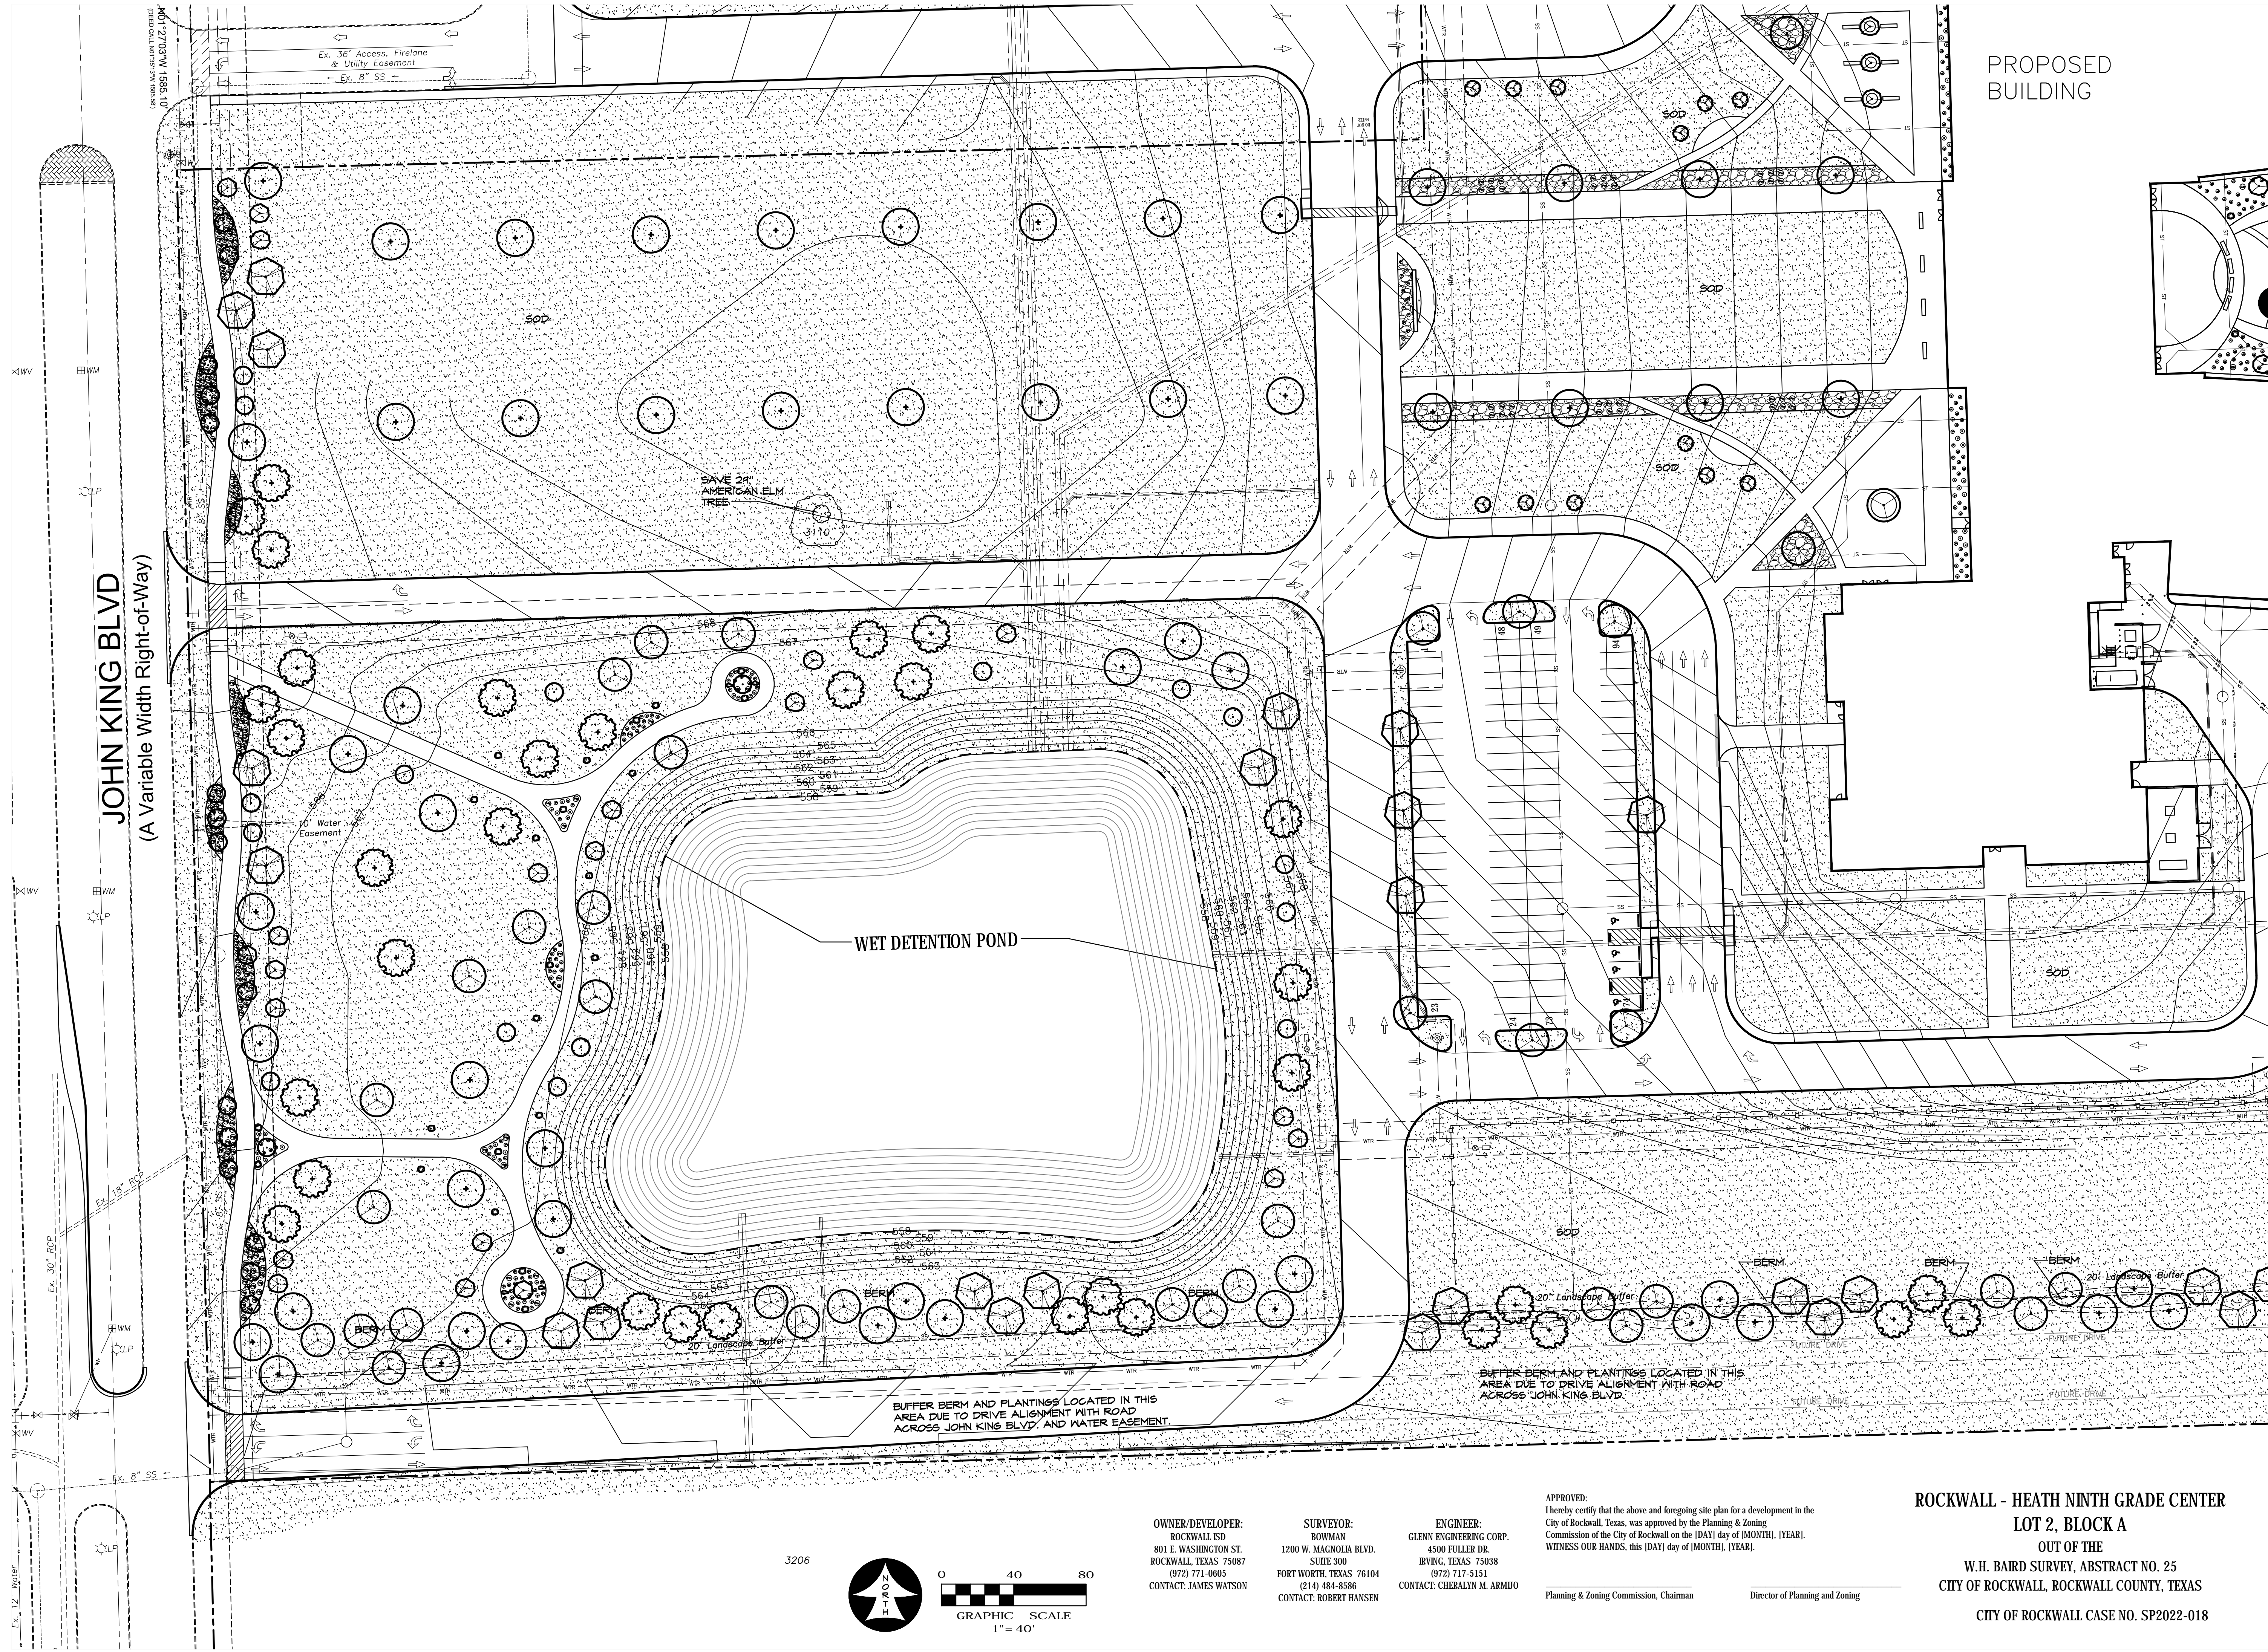

PROPOSED BUILDING

CORGAN
 401 N. Houston St
 Dallas, TX 75202
 T: 214-748-2000

ISSUES		
1	05/11/22	30% PROGRESS SET
2	07/06/22	60% PROGRESS SET
3	08/04/22	90% PROGRESS SET
4	08/16/22	95% PROGRESS SET
5		
6		

REVISIONS		

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
 11914 WISHING WELL CT.
 FRISCO, TEXAS 75035
 PHONE (972) 335-0889
 FAX (469) 362-5433
 EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
 - South Site
 for
 Rockwall Independent School district
 2727 S.John King Blvd, Rockwall, TX 75032

LANDSCAPE PLAN
 AREA B

JOB 21572.0000
 DATE 08/16/22
 SHEET **L 3**

APPROVED: I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR]. WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].


OWNER/DEVELOPER: ROCKWALL ISD, 801 E. WASHINGTON ST. ROCKWALL, TEXAS 75087 (972) 771-0605 CONTACT: JAMES WATSON


SURVEYOR: BOWMAN, 1200 W. MAGNOLIA BLVD. SUITE 300 FORT WORTH, TEXAS 76104 (214) 484-8586 CONTACT: ROBERT HANSEN

ENGINEER: GLENN ENGINEERING CORP., 4500 FULLER DR. IRVING, TEXAS 75038 (972) 717-5151 CONTACT: CHERALYN M. ARMDO

Planning & Zoning Commission, Chairman
 Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
 LOT 2, BLOCK A
 OUT OF THE
 W.H. BAIRD SURVEY, ABSTRACT NO. 25
 CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
 CITY OF ROCKWALL CASE NO. SP2022-018

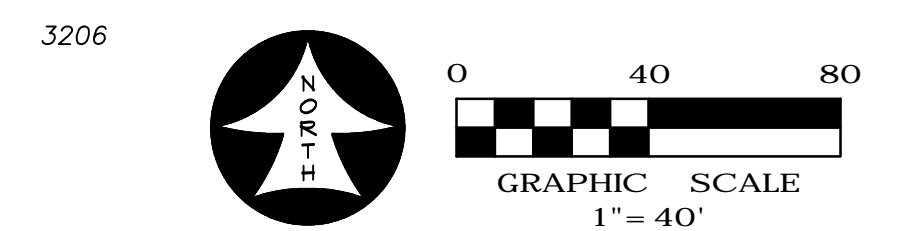

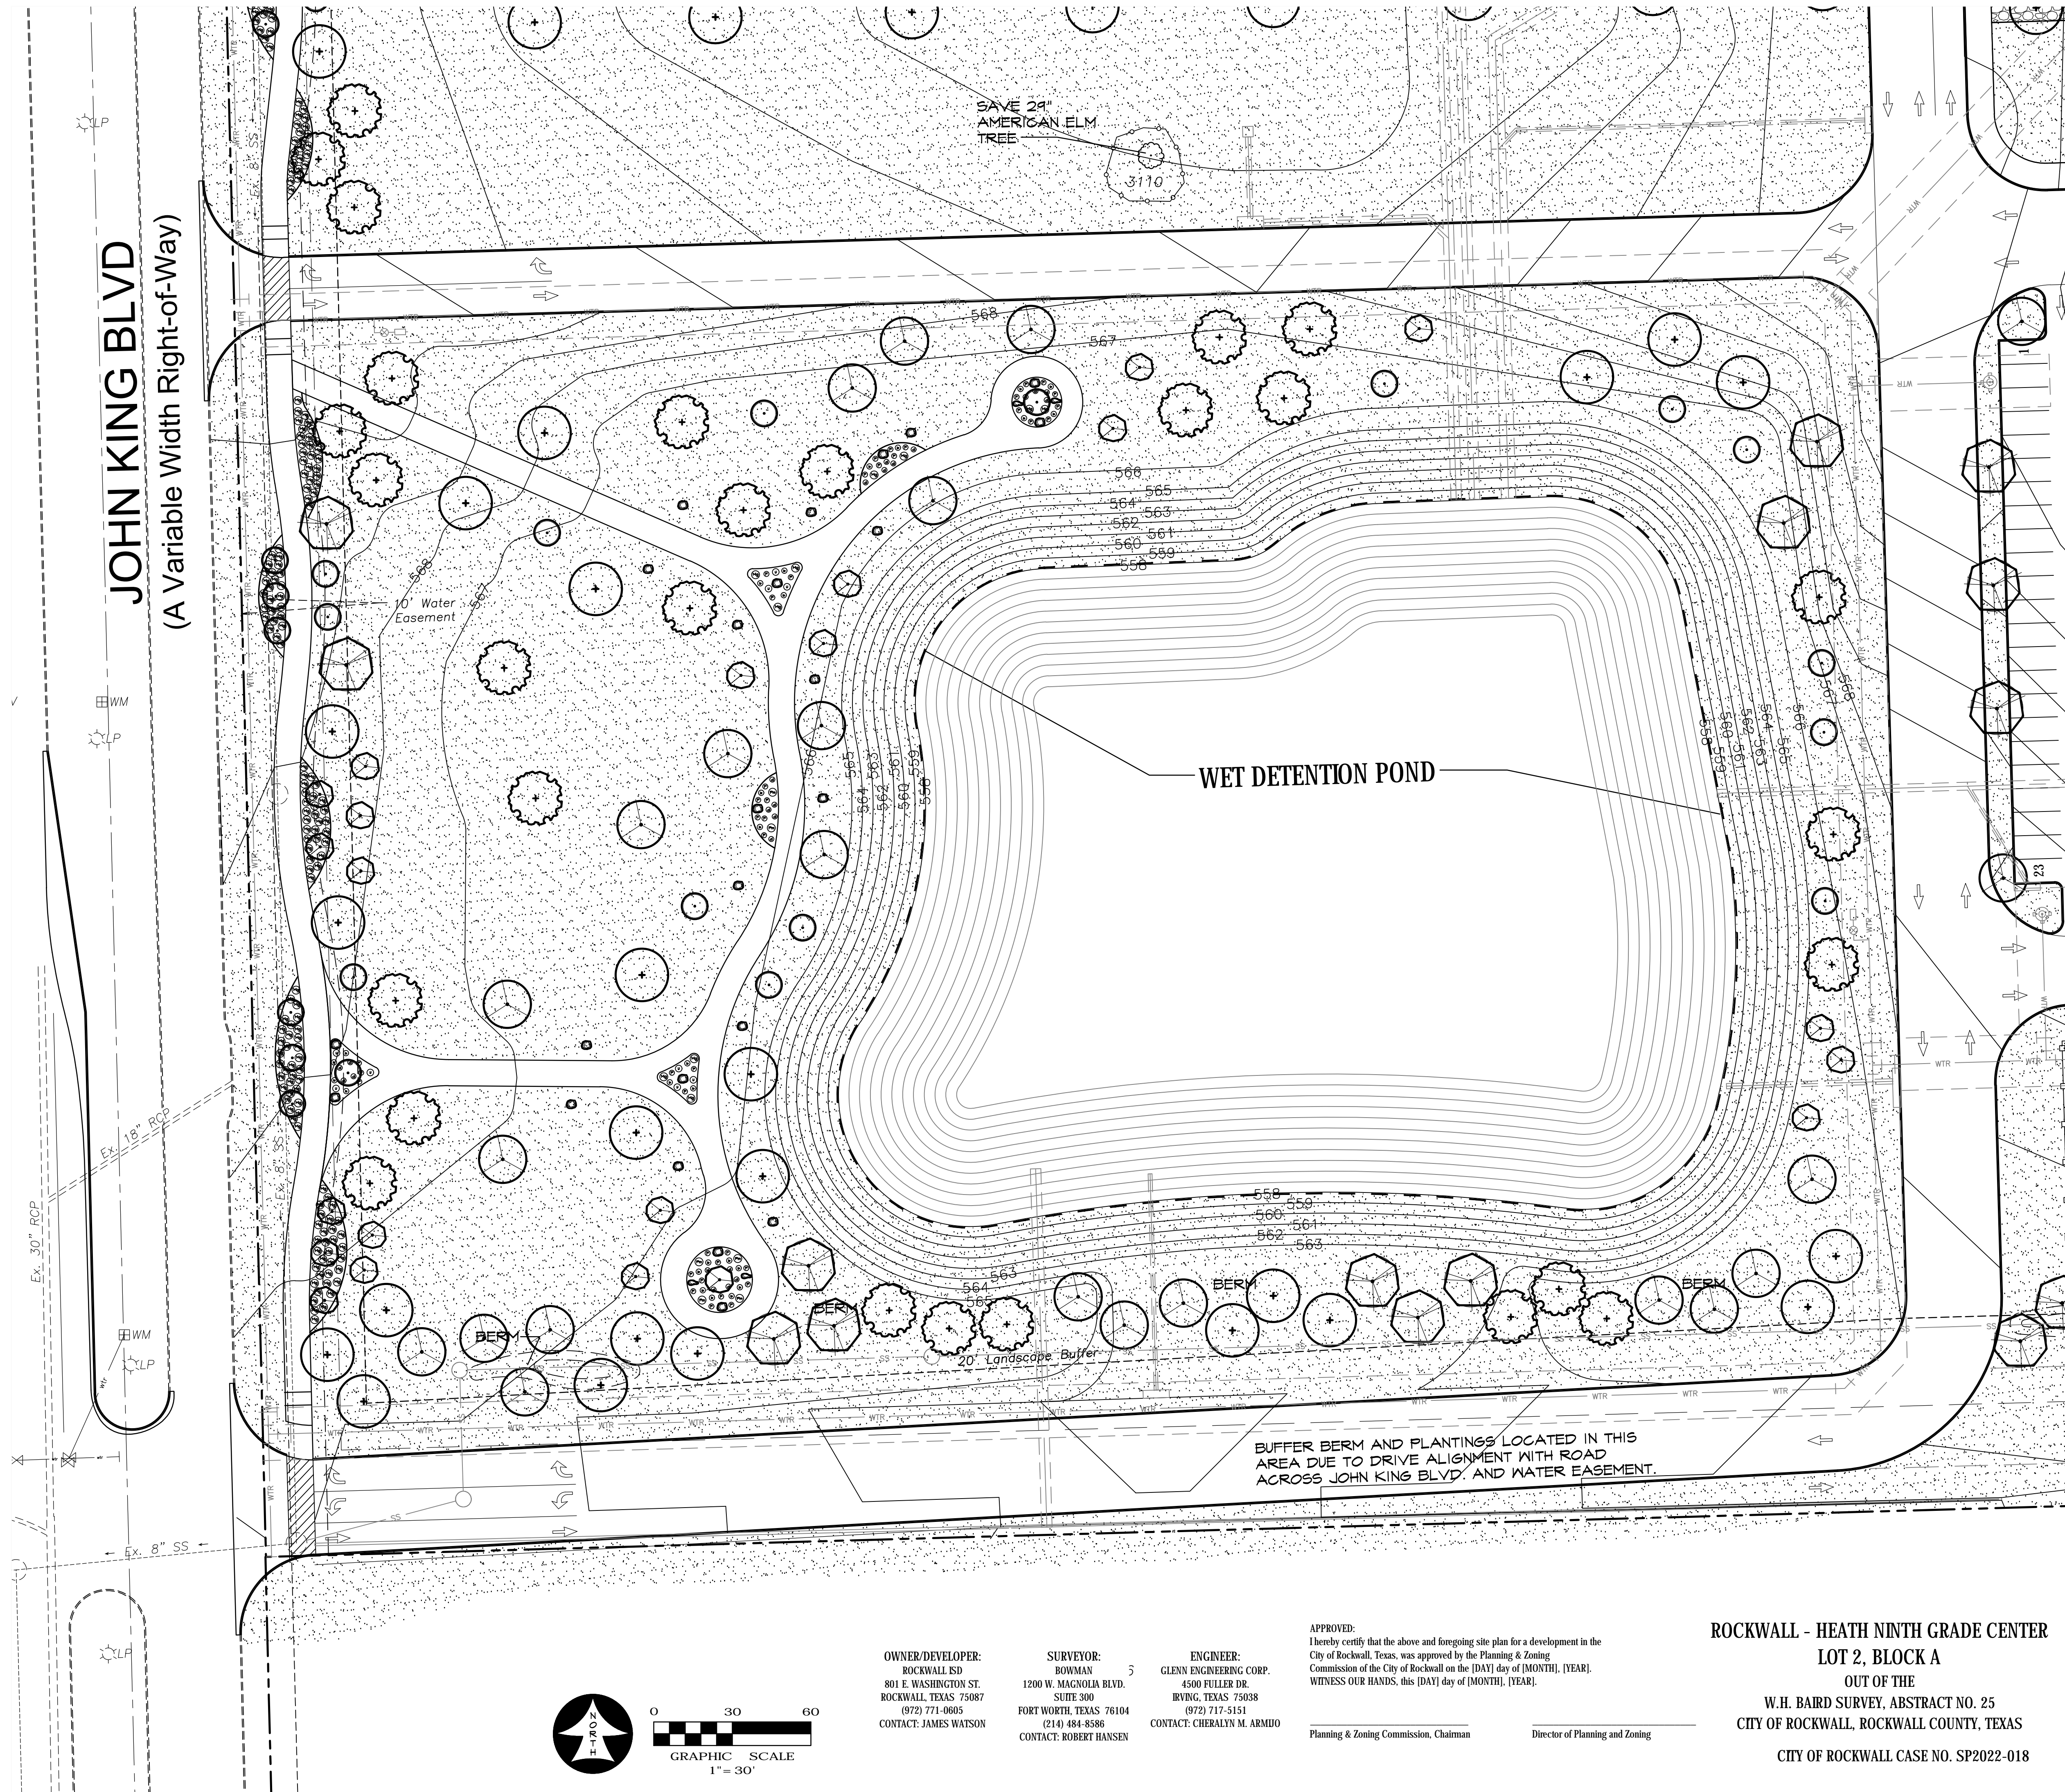

CORGAN ■

401 N. Houston St
Dallas, TX 75202
T: 214-748-2000

ISSUES	
1	05/11/22 30% PROGRESS SET
2	07/06/22 60% PROGRESS SET
3	08/04/22 90% PROGRESS SET
4	08/16/22 95% PROGRESS SET
5	
6	

REVISIONS	

THIS DOCUMENT IS RELEASED FOR PERMIT REVIEW UNDER THE AUTHORITY OF: MICHAEL RAMSEY REGISTERED LANDSCAPE ARCHITECT #1901. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

RAMSEY LANDSCAPE ARCHITECTS, LLC
11914 WISHING WELL CT.
FRISCO, TEXAS 75035
PHONE (972) 335-0889
FAX (469) 362-5433
EMAIL: MIKE.RL@ATT.NET

NINTH GRADE CENERS
- South Site
for
Rockwall Independent School district
2727 S.John King Blvd, Rockwall, TX 75032

DETENTION ENLARGEMENT

JOB 21572.0000
DATE 08/16/22
SHEET

L 3B

OWNER/DEVELOPER:
ROCKWALL ISD
801 E. WASHINGTON ST.
ROCKWALL, TEXAS 75087
(972) 771-0605
CONTACT: JAMES WATSON


SURVEYOR:
BOWMAN
1200 W. MAGNOLIA BLVD.
SUITE 300
FORT WORTH, TEXAS 76104
(214) 484-8586
CONTACT: ROBERT HANSEN

ENGINEER:
GLENN ENGINEERING CORP.
4500 FULLER DR.
IRVING, TEXAS 75038
(972) 717-5151
CONTACT: CHERALYN M. ARMDO

APPROVED:
I hereby certify that the above and foregoing site plan for a development in the City of Rockwall, Texas, was approved by the Planning & Zoning Commission of the City of Rockwall on the [DAY] day of [MONTH], [YEAR].
WITNESS OUR HANDS, this [DAY] day of [MONTH], [YEAR].

Planning & Zoning Commission, Chairman
Director of Planning and Zoning

ROCKWALL - HEATH NINTH GRADE CENTER
LOT 2, BLOCK A
OUT OF THE
W.H. BAIRD SURVEY, ABSTRACT NO. 25
CITY OF ROCKWALL, ROCKWALL COUNTY, TEXAS
CITY OF ROCKWALL CASE NO. SP2022-018

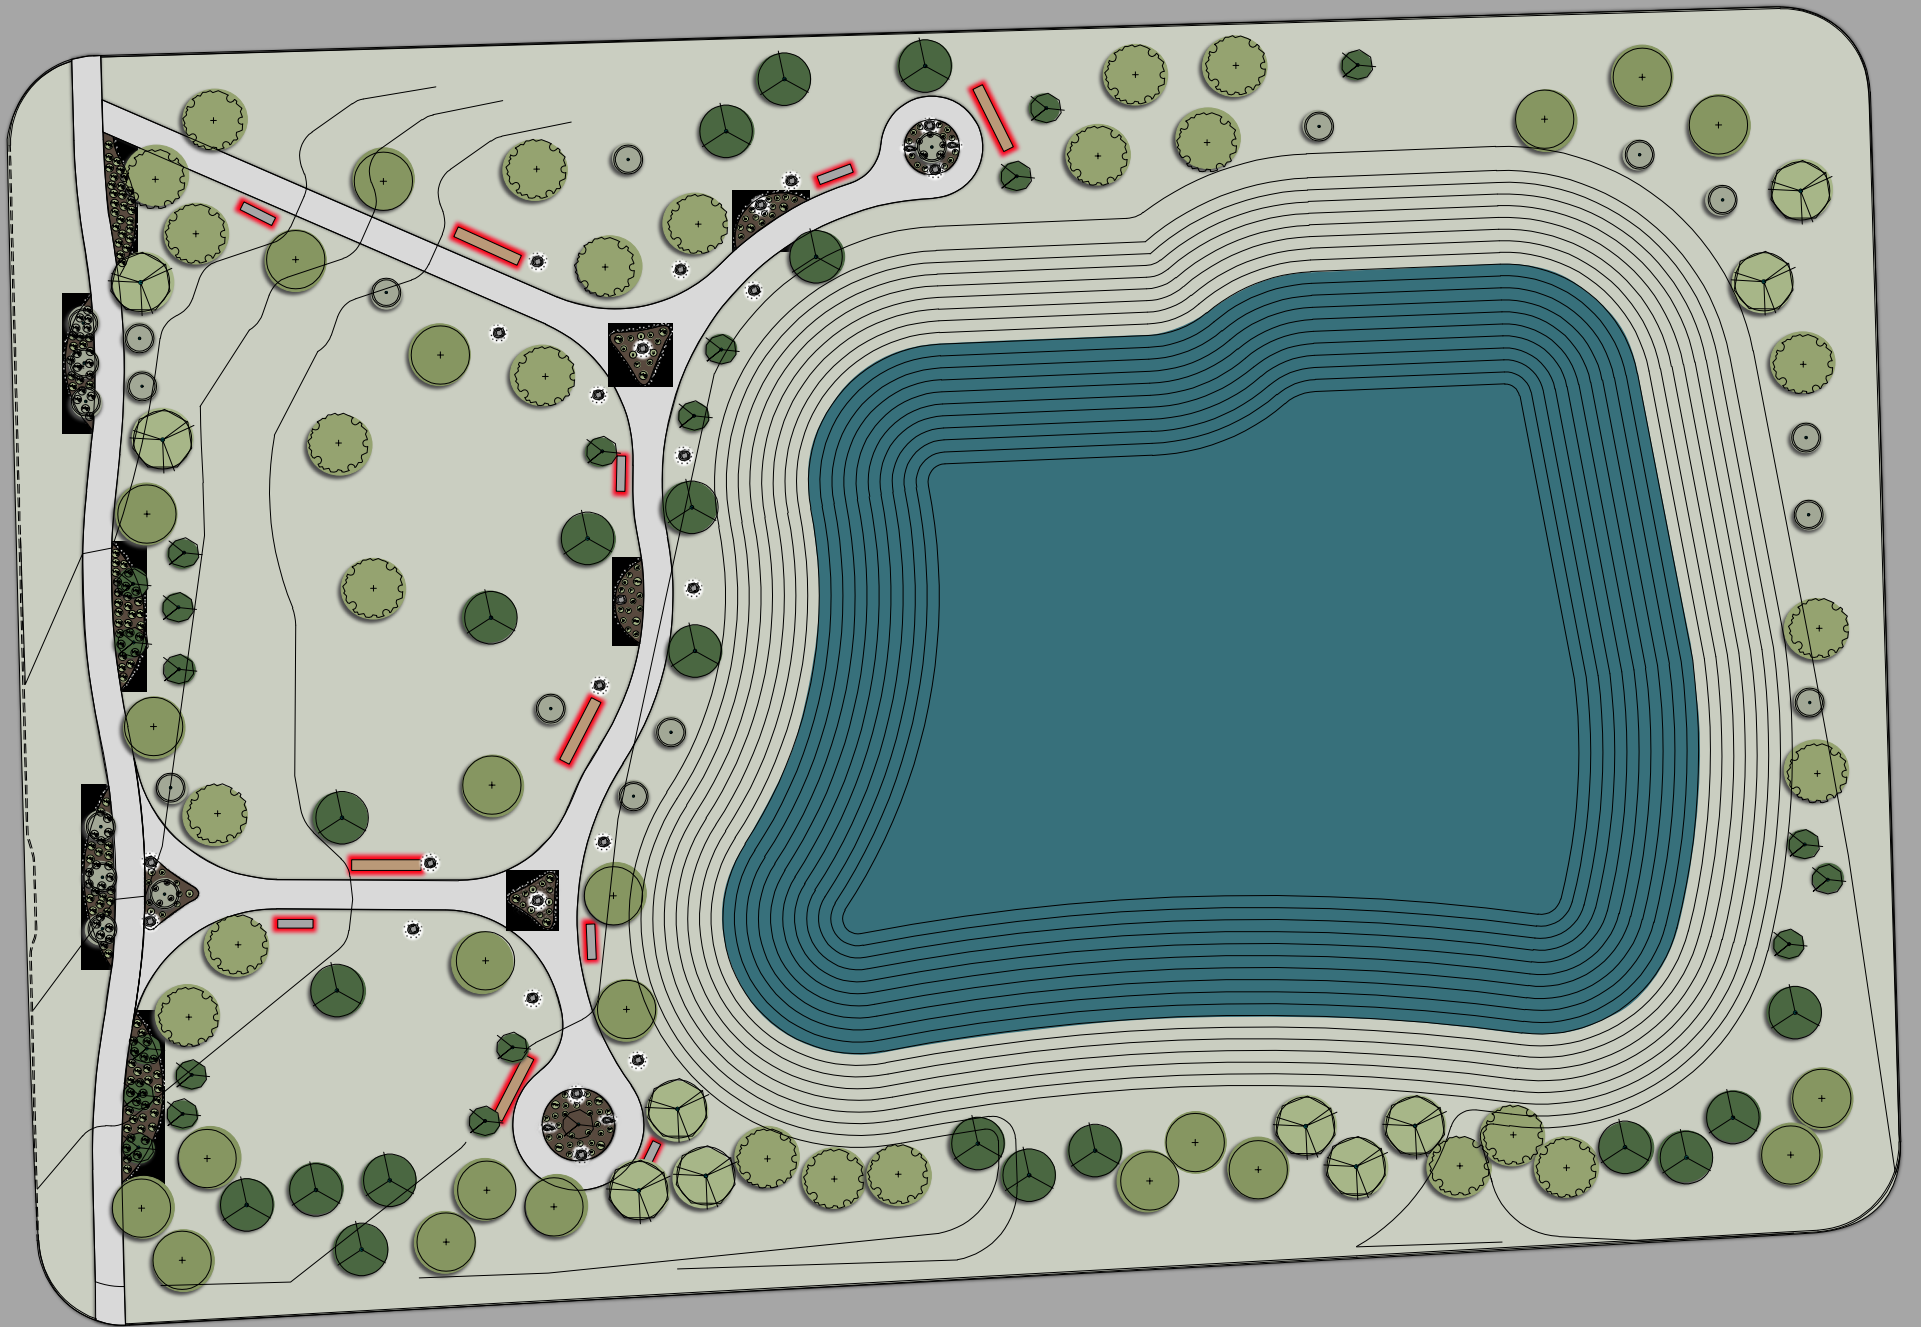





Rockwall ISD 9th Grade Center South

Rockwall, TX

Lighting System

Pole / Fixture Summary						
Pole ID	Pole Height	Mtg Height	Fixture Qty	Luminaire Type	Load	Circuit
A1-A2	70'	70'	4	TLC-LED-1500	5.72 kW	D
B1-B2	80'	16'	1	TLC-BT-575	0.58 kW	D
		80'	6	TLC-LED-1500	8.58 kW	D
C1-C2	70'	70'	3	TLC-LED-1200	3.51 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
D1-D2	70'	70'	4	TLC-LED-1200	4.68 kW	D
		16'	1	TLC-BT-575	0.58 kW	D
F1-F4	80'	80'	7	TLC-LED-1500	10.01 kW	A
		16'	2	TLC-BT-575	1.15 kW	A
T1-T2	40'	40'	2	TLC-LED-600	1.16 kW	B
T3	40'	40'	2	TLC-LED-600	1.16 kW	B
		40'	2	TLC-LED-600	1.16 kW	C
T4	40'	40'	2	TLC-LED-600	1.16 kW	C
		40'	2	TLC-LED-600	1.16 kW	B
T5-T6	40'	40'	2	TLC-LED-600	1.16 kW	C
18			94		103.50 kW	

Circuit Summary			
Circuit	Description	Load	Fixture Qty
A	Football	44.64 kW	36
B	Tennis 1-2	4.64 kW	8
C	Tennis 3-4	4.64 kW	8
D	Baseball	49.58 kW	42

Fixture Type Summary							
Type	Source	Wattage	Lumens	L90	L80	L70	Quantity
TLC-LED-1500	LED 5700K - 75 CRI	1430W	160,000	>120,000	>120,000	>120,000	48
TLC-LED-1200	LED 5700K - 75 CRI	1170W	136,000	>120,000	>120,000	>120,000	14
TLC-BT-575	LED 5700K - 75 CRI	575W	52,000	>120,000	>120,000	>120,000	16
TLC-LED-600	LED 5700K - 75 CRI	580W	65,600	>120,000	>120,000	>120,000	16


Light Level Summary

Calculation Grid Summary								
Grid Name	Calculation Metric	Illumination					Circuits	Fixture Qty
		Ave	Min	Max	Max/Min	Ave/Min		
Baseball (Infield)	Horizontal Illuminance	52.7	39	69	1.75	1.35	D	42
Baseball (Outfield)	Horizontal Illuminance	33.4	26	45	1.75	1.28	D	42
Football	Horizontal Illuminance	36	31	43	1.40	1.16	A	36
Tennis 1-2	Horizontal Illuminance	37.5	30	48	1.61	1.25	B	8
Tennis 3-4	Horizontal Illuminance	37.1	30	49	1.64	1.24	C	8
Track	Horizontal Illuminance	18.7	3	38	11.34	6.22	A	36

From Hometown to Professional



EQUIPMENT LIST FOR AREAS SHOWN							
Pole				Luminaires			
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID / OTHER GRIDS
4	F1-F4	80'	-	15.5'	TLC-BT-575	2	2 0
				80'	TLC-LED-1500	7	7 0
4	TOTALS					36	36 0

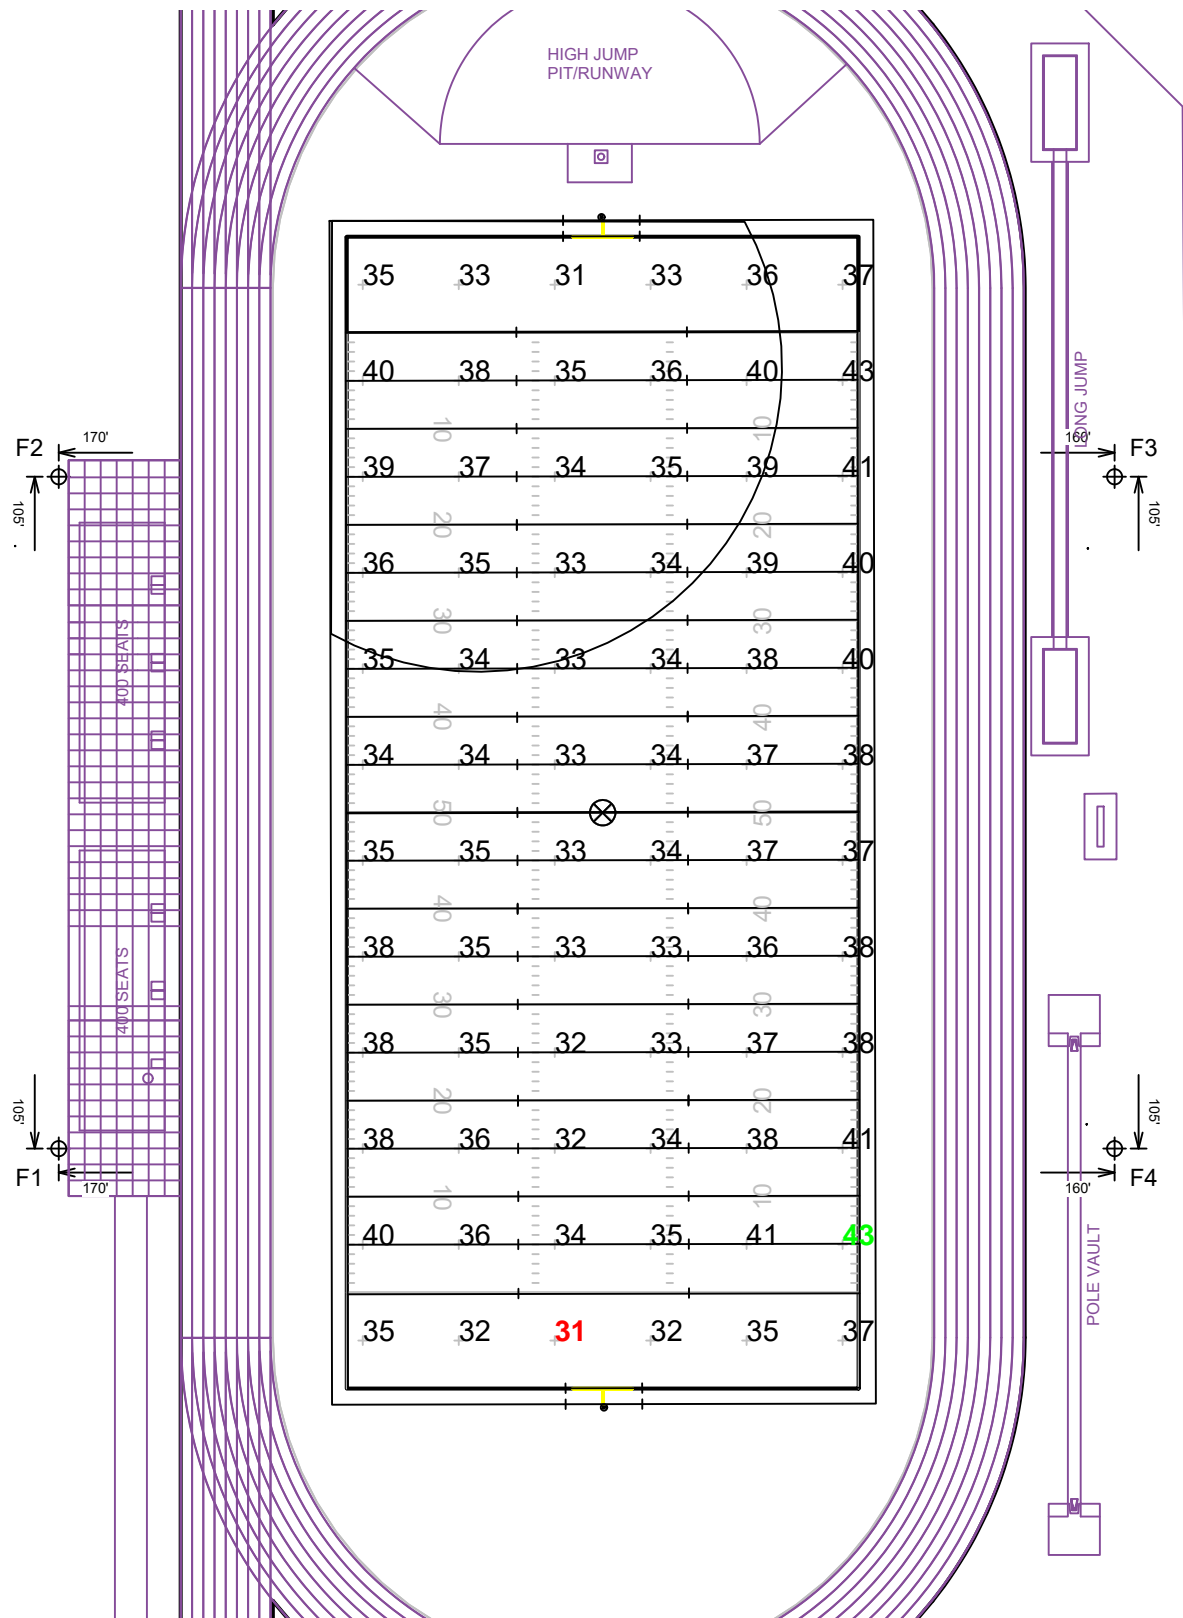

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Football
Size:	360' x 160'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade


ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
	Entire Grid
Guaranteed Average:	30
Scan Average:	35.95
Maximum:	43
Minimum:	31
Avg / Min:	1.17
Guaranteed Max / Min:	2.5
Max / Min:	1.40
UG (adjacent pts):	1.17
CU:	0.47
No. of Points:	72
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY


EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
4	F1-F4	80'	0'	15.52'	TLC-BT-575	2	2	0
				80'	TLC-LED-1500	7	7	0
4	TOTALS					36	36	0

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Track
Size:	Irregular
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Scan Average:	18.66
Maximum:	38
Minimum:	3
Avg / Min:	5.56
Max / Min:	11.34
UG (adjacent pts):	0.00
CU:	0.16
No. of Points:	48
LUMINAIRE INFORMATION	
Applied Circuits:	A
No. of Luminaires:	36
Total Load:	44.64 kW

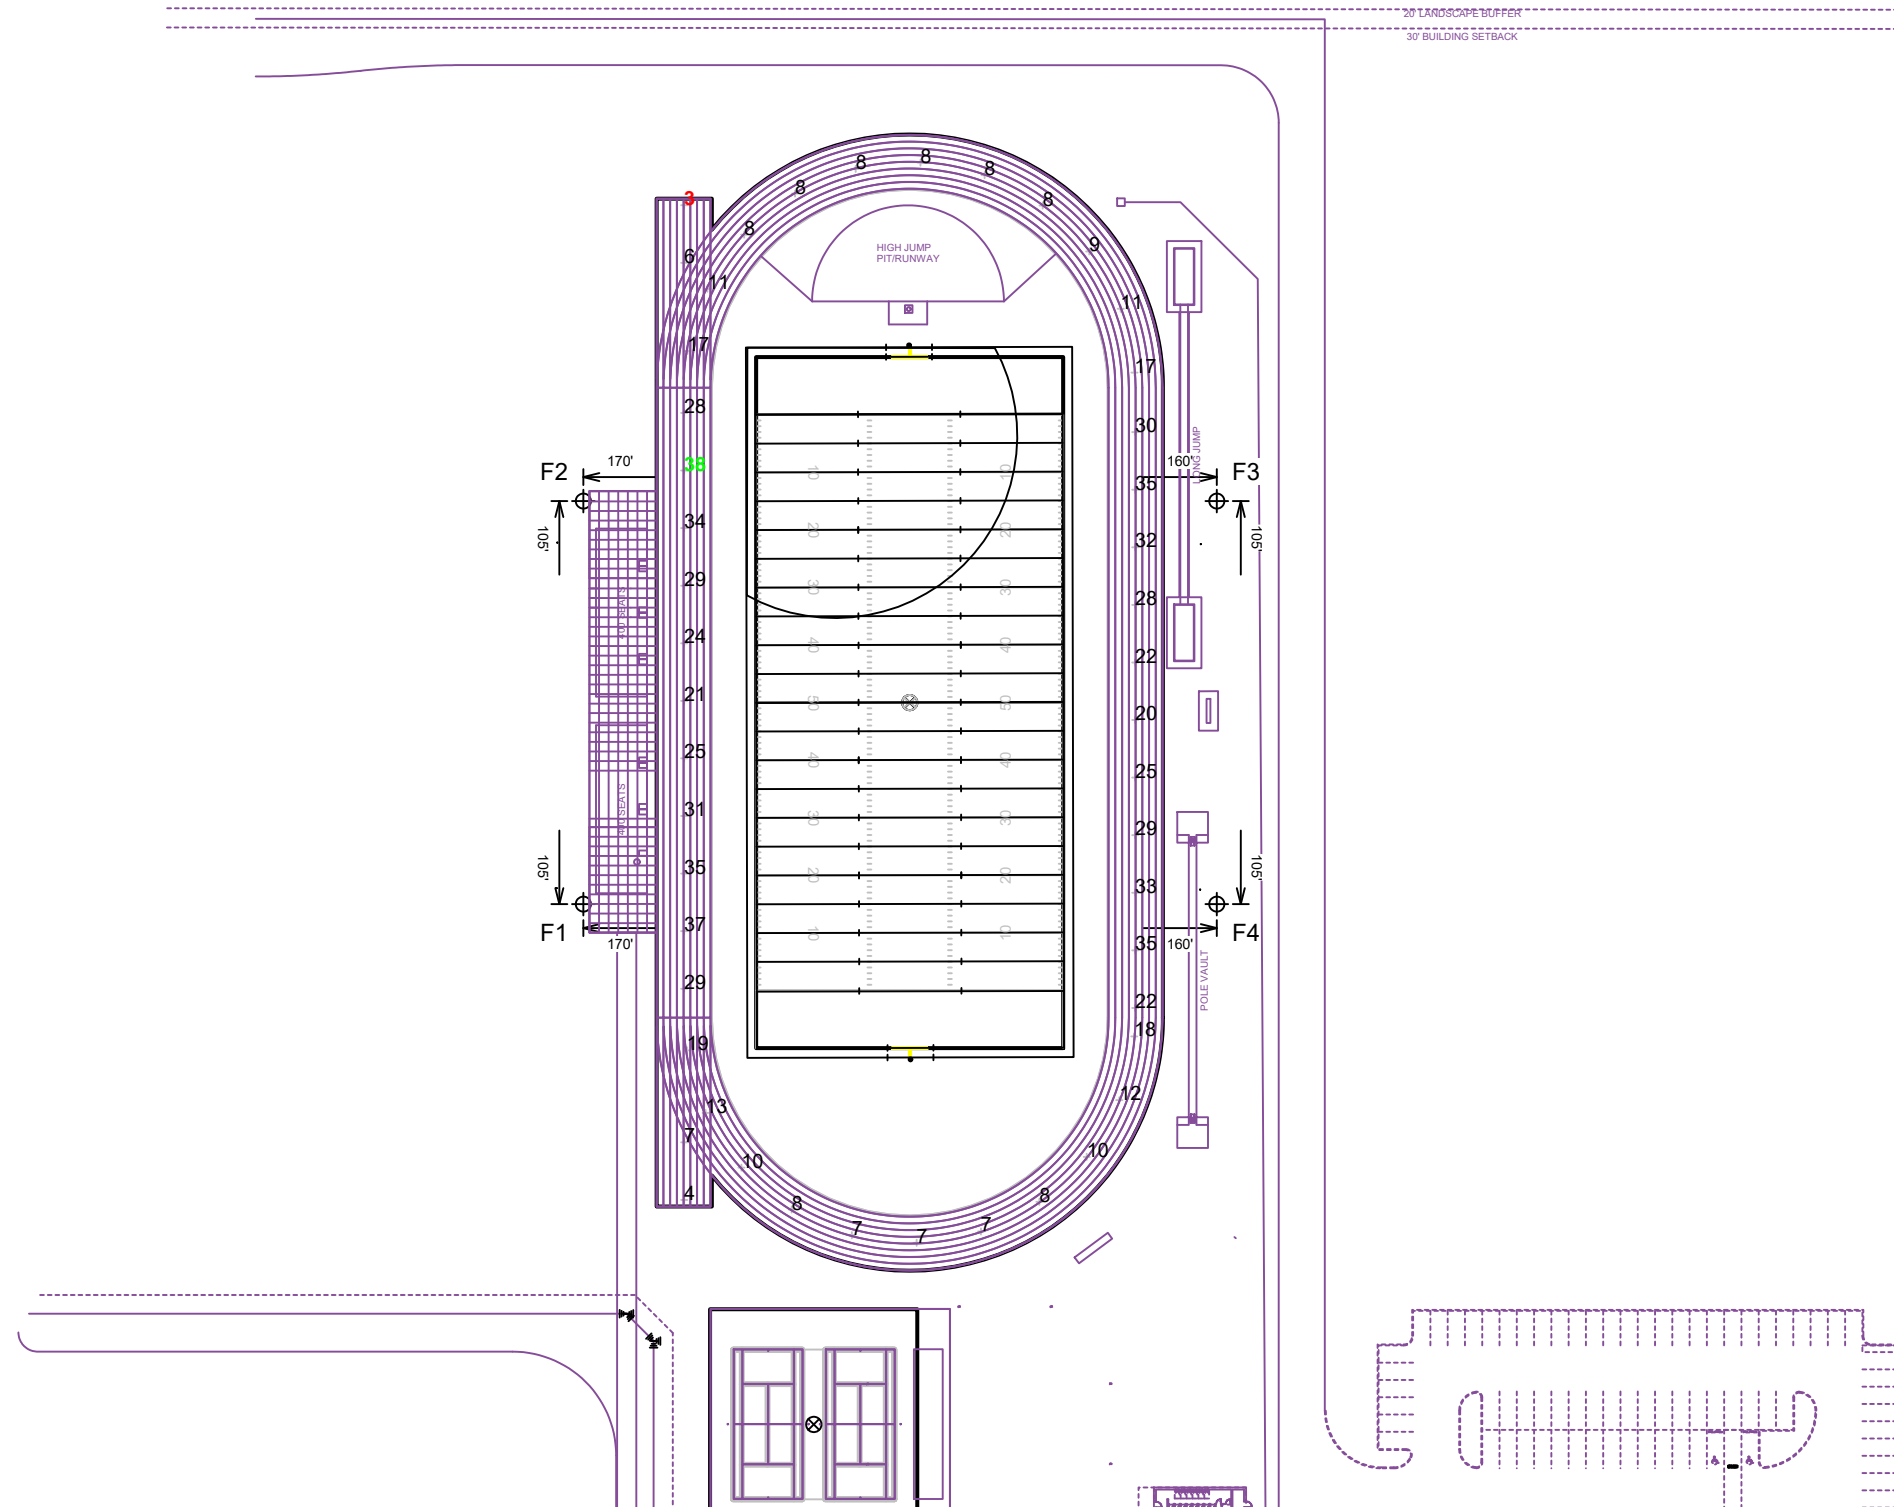


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume $\pm 3\%$ nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) \oplus dimensions are relative to 0,0 reference point(s) \otimes



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY

Rockwall ISD 9th Grade Center South

Rockwall, TX

EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T1-T2	40'	-	40'	TLC-LED-600	2	2	0
2	T3-T4	40'	-	40'	TLC-LED-600	4	2	2
4	TOTALS					12	8	4

GRID SUMMARY	
Name:	Tennis 1-2
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade



ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.52
Maximum:	48
Minimum:	30
Avg / Min:	1.26
Guaranteed Max / Min:	2.5
Max / Min:	1.61
UG (adjacent pts):	0.00
CU:	0.89
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	B
No. of Luminaires:	8
Total Load:	4.64 kW

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

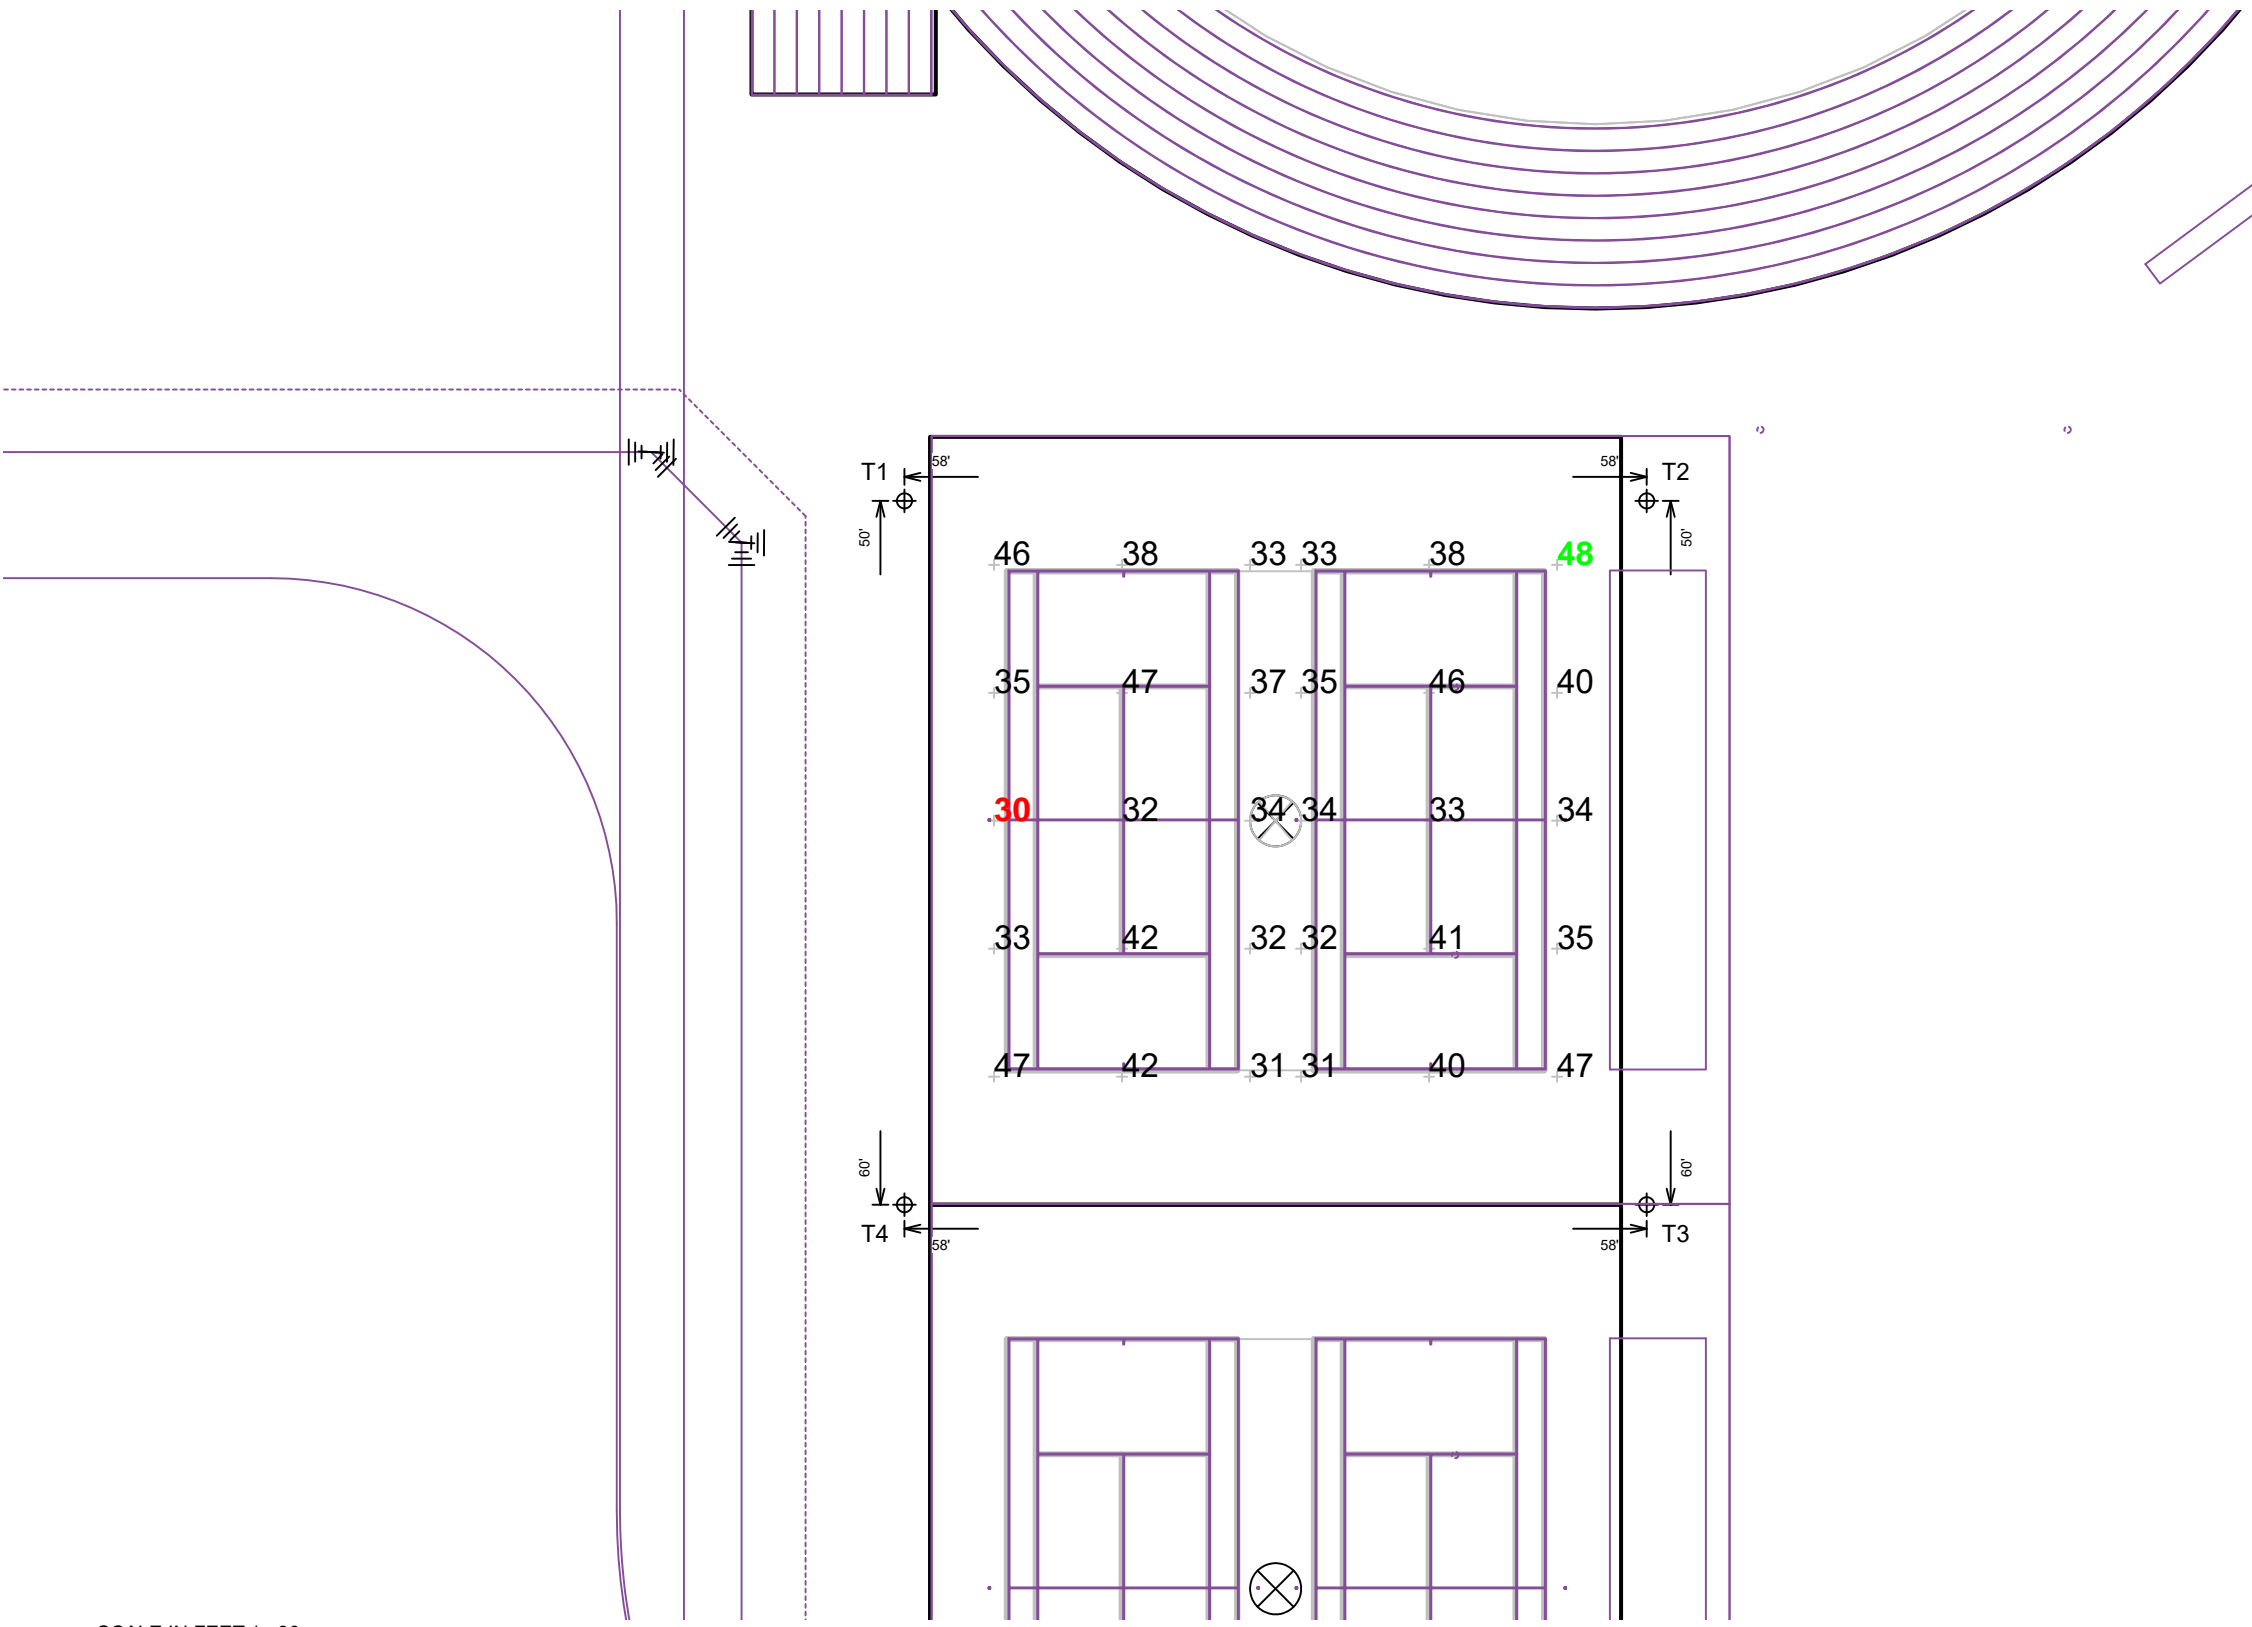

Pole location(s) Ⓢ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY


EQUIPMENT LIST FOR AREAS SHOWN								
Pole				Luminaires				
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	T3-T4	40'	0'	40'	TLC-LED-600	4	2	2
2	T5-T6	40'	-	40'	TLC-LED-600	2	2	0
4	TOTALS					12	8	4

Rockwall ISD 9th Grade Center South

Rockwall, TX

GRID SUMMARY	
Name:	Tennis 3-4
Size:	2 Court - 12' Spacing
Spacing:	20.0' x 20.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY	
MAINTAINED HORIZONTAL FOOTCANDLES	
Entire Grid	
Guaranteed Average:	30
Scan Average:	37.13
Maximum:	49
Minimum:	30
Avg / Min:	1.23
Guaranteed Max / Min:	2.5
Max / Min:	1.64
UG (adjacent pts):	0.00
CU:	0.88
No. of Points:	30
LUMINAIRE INFORMATION	
Applied Circuits:	C
No. of Luminaires:	8
Total Load:	4.64 kW

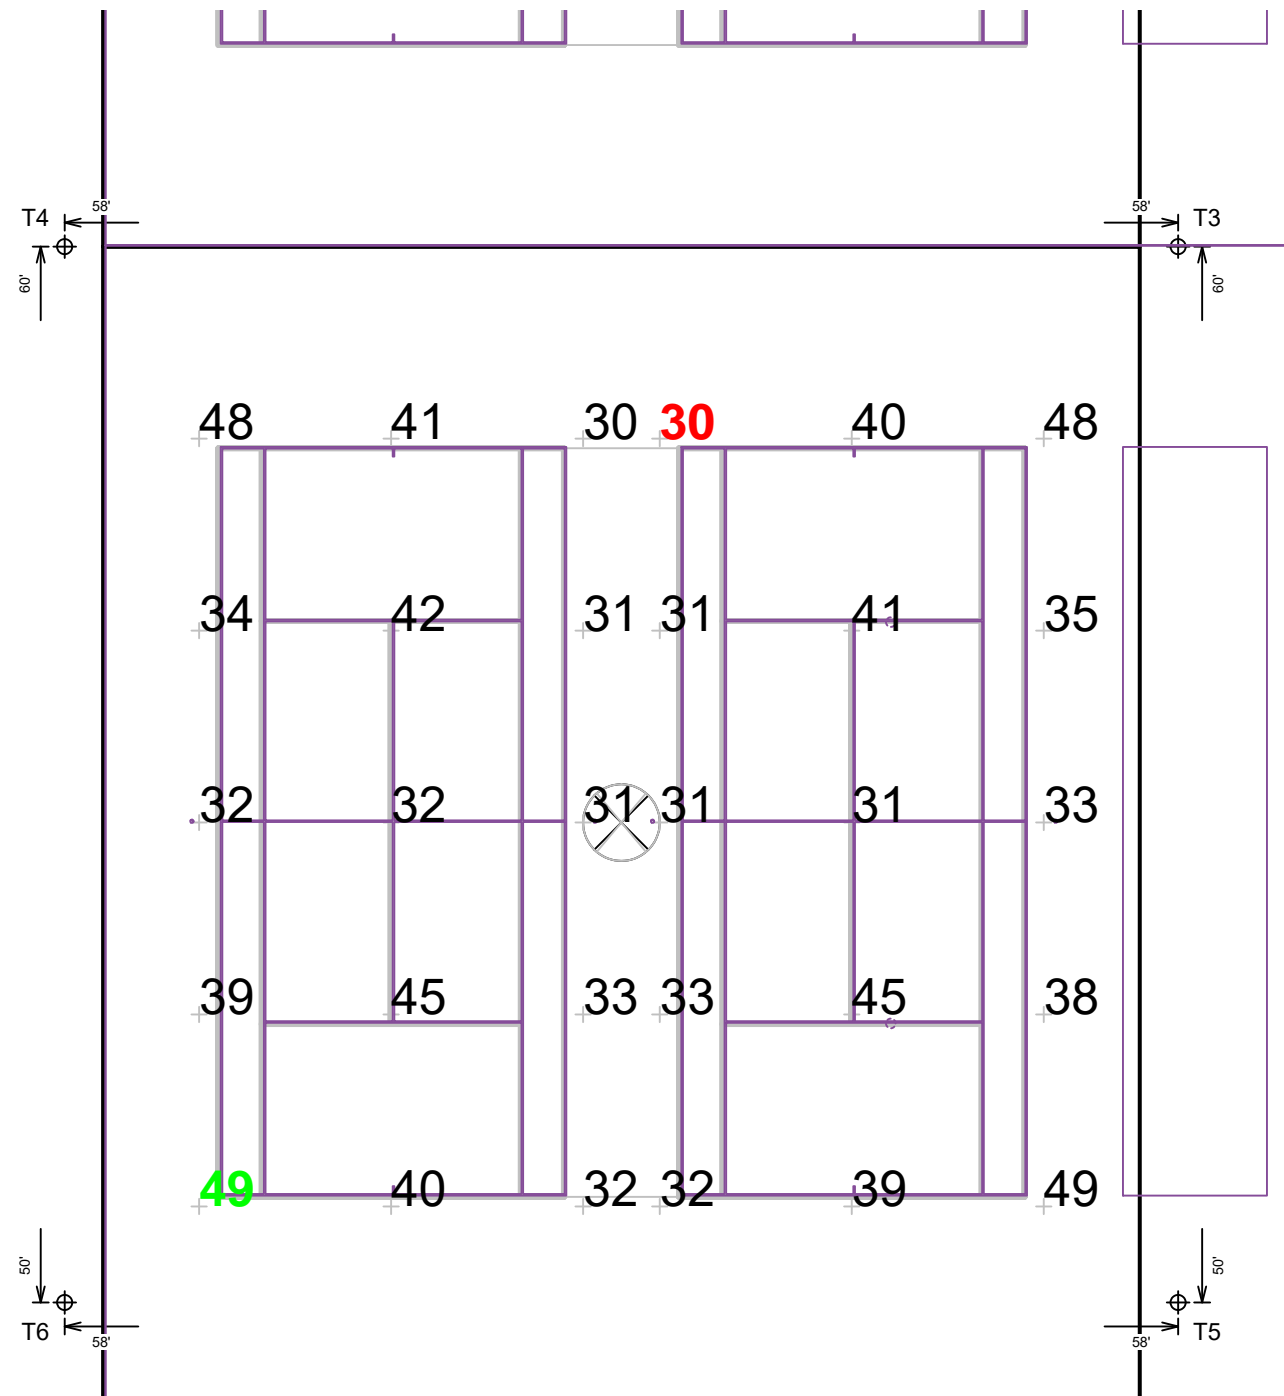

Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.


Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

DO NOT ENTER

SCALE IN FEET 1 : 20



ENGINEERED DESIGN By: Ryan A. Marsh, LC · File #221257A · 28-Jul-22

Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



We Make It Happen.


Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

ILLUMINATION SUMMARY

EQUIPMENT LIST FOR AREAS SHOWN								
Pole			Luminaires					
QTY	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE	QTY / POLE	THIS GRID	OTHER GRIDS
2	A1-A2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1500	4	4	0
2	B1-B2	80'	-	15.5'	TLC-BT-575	1	1	0
				80'	TLC-LED-1500	6	6	0
2	C1-C2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	3	3	0
2	D1-D2	70'	-	15.5'	TLC-BT-575	1	1	0
				70'	TLC-LED-1200	4	4	0
8	TOTALS					42	42	0

GRID SUMMARY	
Name:	Baseball
Size:	Irregular 315' / 390' / 315'
Spacing:	30.0' x 30.0'
Height:	3.0' above grade

ILLUMINATION SUMMARY		
MAINTAINED HORIZONTAL FOOTCANDLES		
	Infield	Outfield
Guaranteed Average:	50	30
Scan Average:	52.69	33.40
Maximum:	69	45
Minimum:	39	26
Avg / Min:	1.34	1.30
Guaranteed Max / Min:	2	2.5
Max / Min:	1.75	1.75
UG (adjacent pts):	1.21	1.34
CU:	0.73	
No. of Points:	25	93
LUMINAIRE INFORMATION		
Applied Circuits:	D	
No. of Luminaires:	42	
Total Load:	49.58 kW	

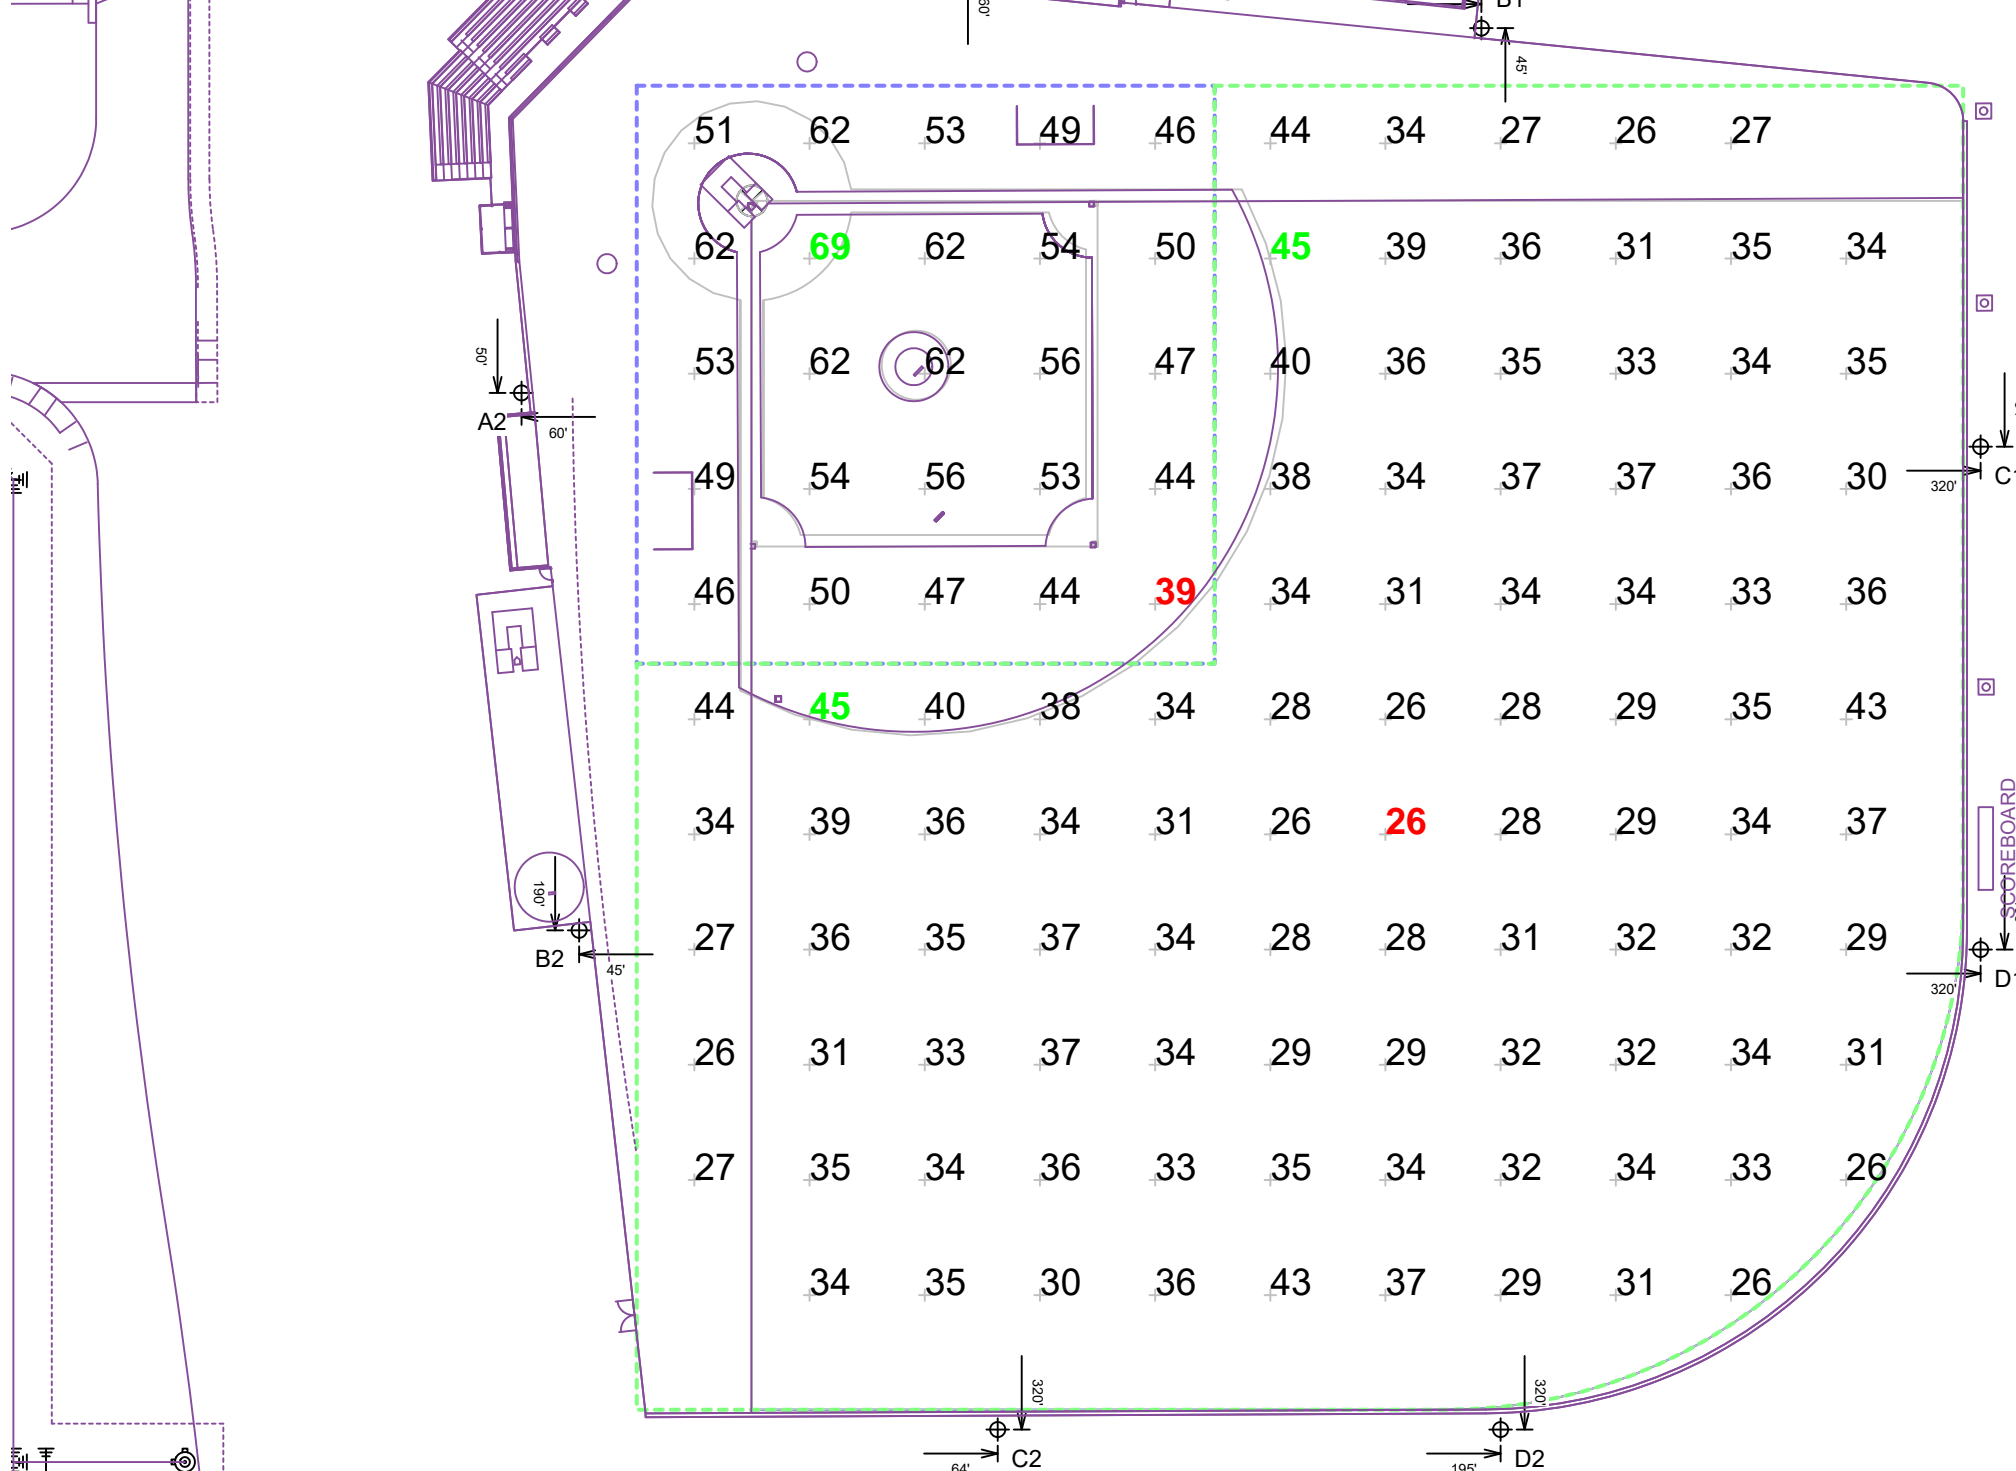


Guaranteed Performance: The ILLUMINATION described above is guaranteed per your Musco Warranty document and includes a 0.95 dirt depreciation factor.

Field Measurements: Individual field measurements may vary from computer-calculated predictions and should be taken in accordance with IESNA RP-6-15.


Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.

Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.



Pole location(s) Ⓧ dimensions are relative to 0,0 reference point(s) ⊗



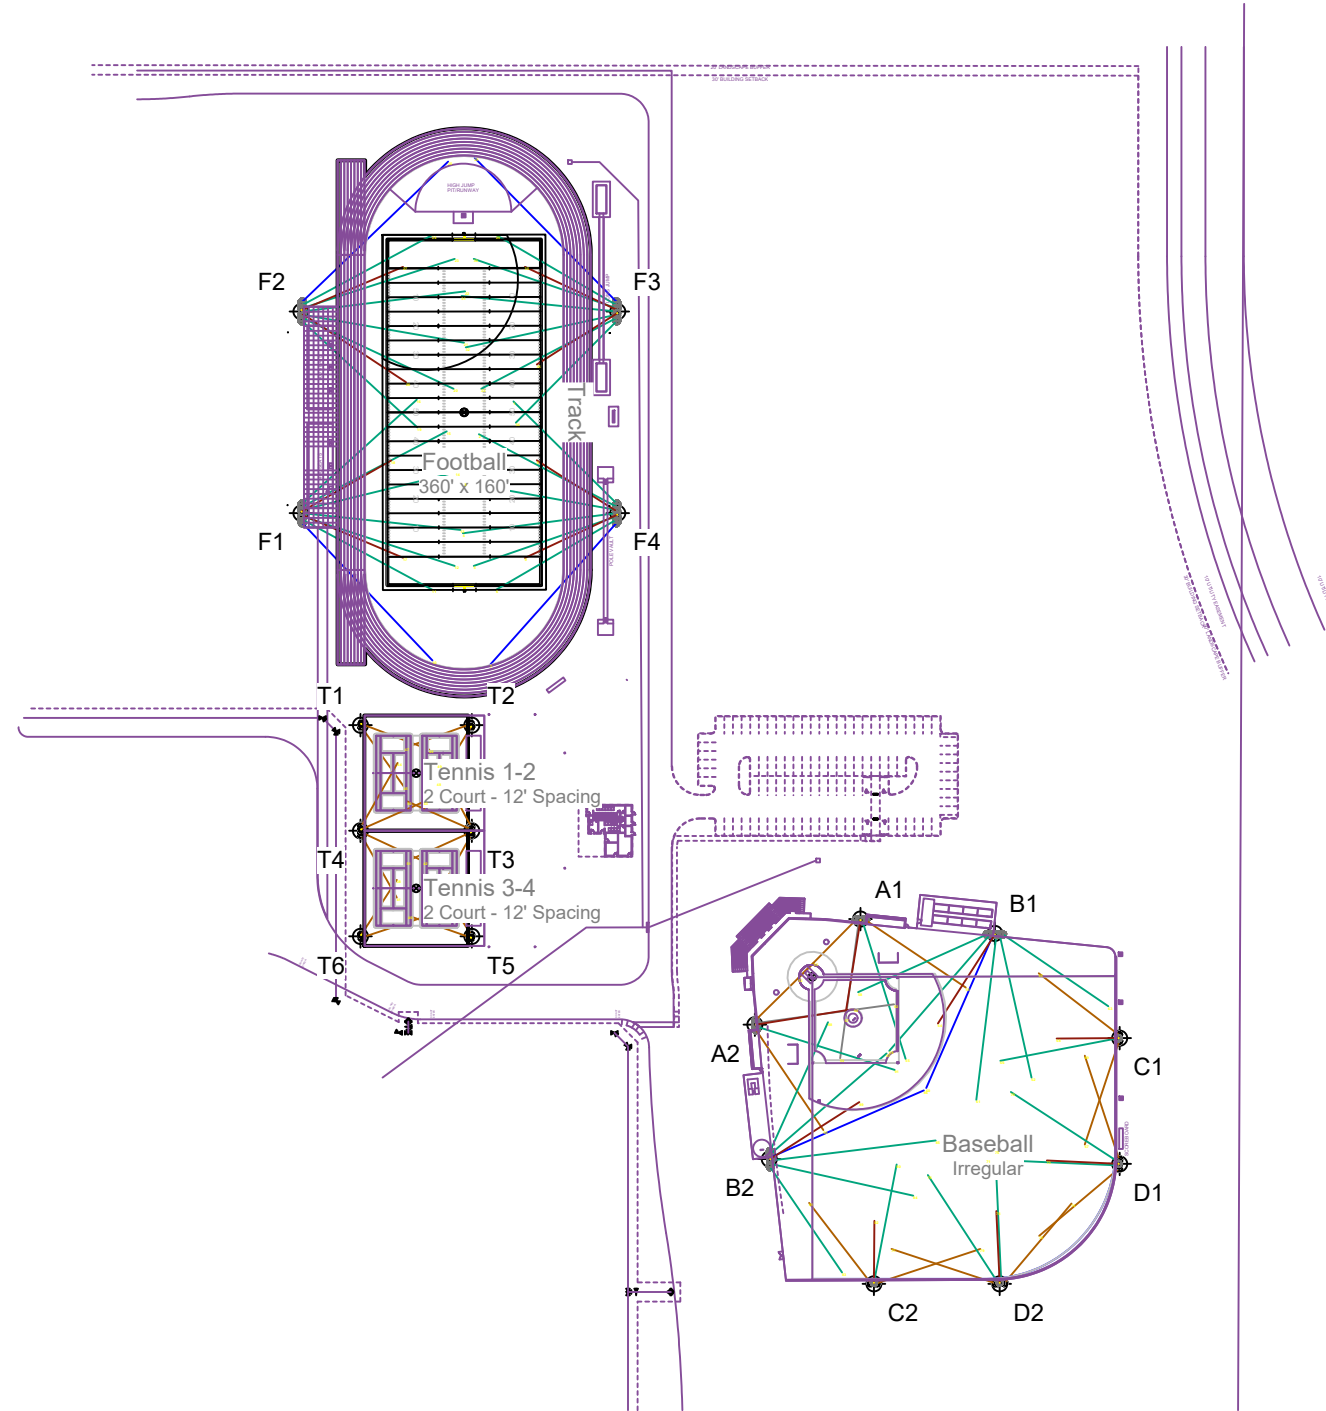

EQUIPMENT LAYOUT

INCLUDES:

- Baseball
- Football
- Tennis 1-2
- Tennis 3-4
- Track

Electrical System Requirements: Refer to Amperage Draw Chart and/or the "Musco Control System Summary" for electrical sizing.


Installation Requirements: Results assume ± 3% nominal voltage at line side of the driver and structures located within 3 feet (1m) of design locations.

EQUIPMENT LIST FOR AREAS SHOWN

QTY	Pole			Luminaires		QTY / POLE	
	LOCATION	SIZE	GRADE ELEVATION	MOUNTING HEIGHT	LUMINAIRE TYPE		
2	A1-A2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1500	1 4	
2	B1-B2	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	1 6	
2	C1-C2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 3	
2	D1-D2	70'	-	15.5' 70'	TLC-BT-575 TLC-LED-1200	1 4	
4	F1-F4	80'	-	15.5' 80'	TLC-BT-575 TLC-LED-1500	2 7	
4	T1-T2 T5-T6	40'	-	40'	TLC-LED-600	2	
2	T3-T4	40'	-	40'	TLC-LED-600	4	
18	TOTALS						94

SINGLE LUMINAIRE AMPERAGE DRAW CHART




Ballast Specifications (.90 min power factor)	Line Amperage Per Luminaire (max draw)						
	208 (60)	220 (60)	240 (60)	277 (60)	347 (60)	380 (60)	480 (60)
Single Phase Voltage							
TLC-LED-1500	8.5	8.1	7.4	6.4	5.1	4.7	3.7
TLC-LED-1200	7.0	6.6	6.1	5.2	4.2	4.0	3.0
TLC-BT-575	3.4	3.2	2.9	2.5	2.0	1.8	1.5
TLC-LED-600	3.4	3.2	3.0	2.6	2.0	1.9	1.5



Pole location(s) ⊕ dimensions are relative to 0,0 reference point(s) ⊗



Not to be reproduced in whole or part without the written consent of Musco Sports Lighting, LLC. ©1981, 2022 Musco Sports Lighting, LLC.

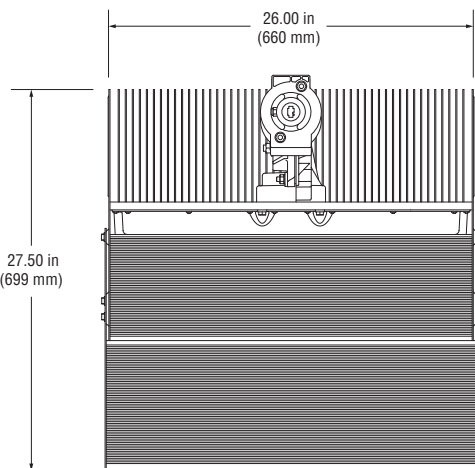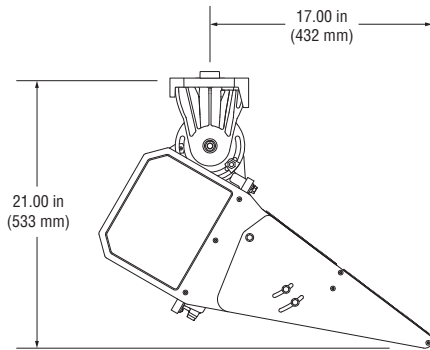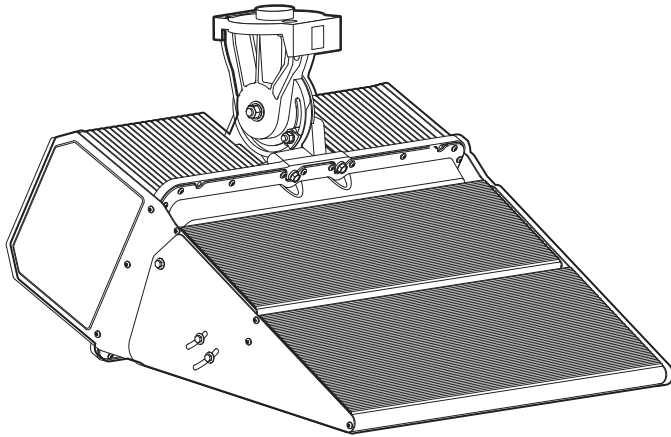

Luminaire Data

Weight (luminaire) 80 lb (36 kg)
 UL listing number..... E338094
 UL listed for USA / Canada..... UL1598 CSA-C22.2 No.250.0
 Ingress protection, luminaire, international IP65
 Ingress protection, luminaire, USA IP54
 Material and finish Aluminum,
 powder-coat painted
 Wind speed rating (aiming only)..... 150 mi/h (67 m/s)
 UL ambient temperature rating, luminaire 50°C (122°F)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11
 L90 (10.5k) >63,500 h
 L80 (10.5k) >63,500 h
 L70 (10.5k) >63,500 h
 CIE correlated color temperature 5700 K
 Color Rendering Index (CRI), typical..... 75
 Color Rendering Index (CRI), minimum 70
 Lumens¹ 121,000

Footnotes:

1) Lumen values at stabilized operation in 25°C ambient temperature environment. Incorporates appropriate dirt depreciation factor for life of luminaire.

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 1,150 W

Per luminaire..... 1,150 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 μs

Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure..... 50°C (122°F)

Ingress protection,
electrical components enclosure..... IP54


Efficiency..... 95%

Dimming mode..... optional

Range, energy consumption..... .20 – 100%

Range, light output..... .25 – 100%

Typical Wiring

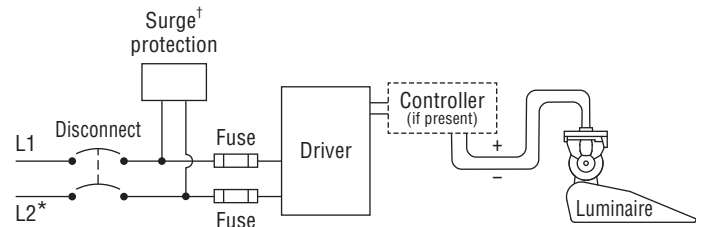

* If L2 (com) is neutral then not switched or fused.
† Not present if indoor installation.

	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	7.11 A	6.83 A	6.46 A	6.18 A	5.92 A	5.13 A	4.10 A	3.74 A	3.56 A	3.43 A	2.96 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.



Luminaire and Driver Components – TLC-BT-575

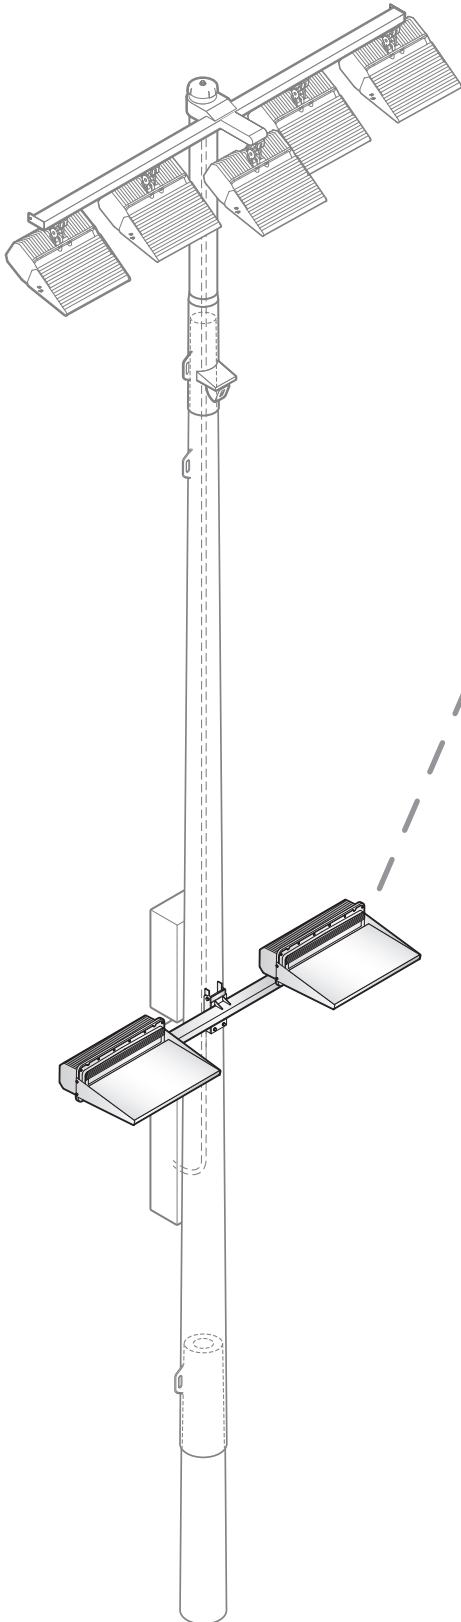

Luminaire Data

Weight (luminaire)	34 lb (15 kg)
UL listing number	E338094
UL Listed for USA / Canada	UL1598 CSA-C22.2 No.250.0
Ingress protection, luminaire, international	IP65
Ingress protection, luminaire, USA	IP54
Material and finish	Aluminum, powder-coat painted
Wind speed rating (aiming only)	150 mi/h (67 m/s)

Photometric Characteristics

Projected lumen maintenance per IES TM-21-11	
L90 (10.5k)	>63,500 h
L80 (10.5k)	>63,500 h
L70 (10.5k)	>63,500 h
CIE correlated color temperature	5700 K
Color Rendering Index (CRI), typical	75
Color Rendering Index (CRI), minimum	70
Lumens ¹	52,000

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

All components from foundation to poletop are designed to work together in Light-Structure System™ to ensure reliable, trouble-free operation.

Luminaire and Driver Components – TLC-BT-575

Driver Data

Electrical Data

Rated wattage¹

Per driver..... 575 W

Per luminaire..... 575 W

Number of luminaires per driver..... 1

Starting (inrush) current..... <40 A, 256 µs


Fuse rating..... 15 A

UL, IEC ambient temperature rating,
electrical components enclosure 50°C (122°F)

Ingress protection,
electrical components enclosure IP54

Efficiency..... 95%

Typical Wiring

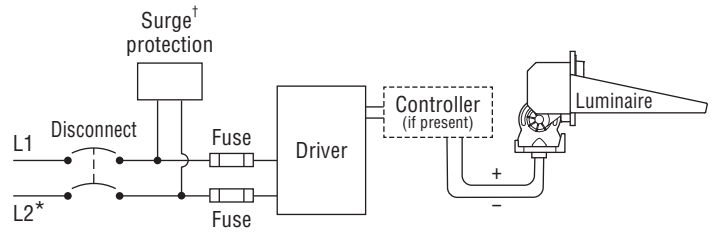

* If L2 (com) is neutral then not switched or fused.

† Not present if indoor installation.



	200 Vac 50/60 Hz	208 Vac 60 Hz	220 Vac 50/60 Hz	230 Vac 50 Hz	240 Vac 50/60 Hz	277 Vac 60 Hz	347 Vac 60 Hz	380 Vac 50/60 Hz	400 Vac 50 Hz	415 Vac 50 Hz	480 Vac 60 Hz
Max operating current² per luminaire	3.30 A	3.17 A	3.00 A	2.87 A	2.75 A	2.38 A	1.90 A	1.74 A	1.65 A	1.59 A	1.38 A

Footnotes:


- 1) Rated wattage is the power consumption, including driver efficiency losses, at stabilized operation in 25°C ambient temperature environment.
- 2) Operating current includes allowance for 0.90 minimum power factor, operating temperature, and LED light source manufacturing tolerances.

Notes

1. Use thermal magnetic HID-rated or D-curve circuit breakers.
2. See *Musco Control System Summary* for circuit information.

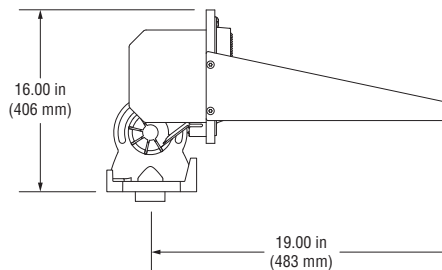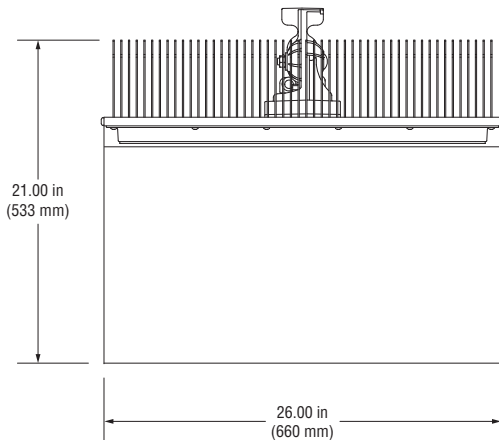

Datasheet: TLC-LED-400 Luminaire and Driver

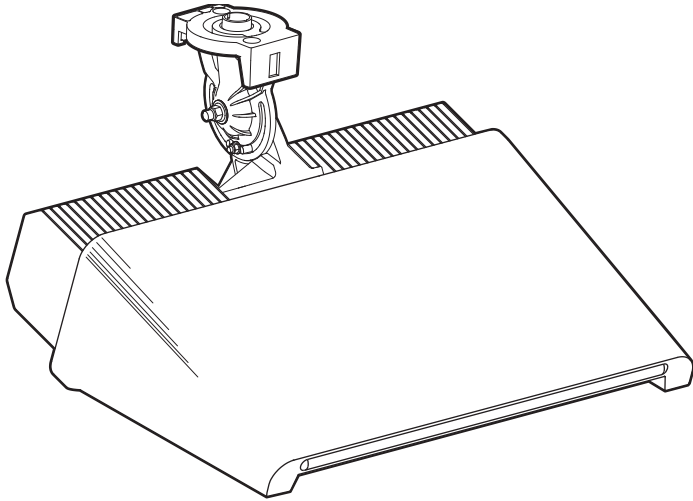

Luminaire Data

Weight (luminaire) 40 lb (18 kg)
 UL listing number E338094
 UL Listed for USA / Canada UL1598 CSA-C22.2 No.250.0
 Ingress protection, luminaire, international IP65
 Ingress protection, luminaire, USA IP54
 Material and finish Aluminum,
 powder-coat painted
 Wind speed rating (aiming only) 150 mi/h (67 m/s)



Photometric Characteristics

Projected lumen maintenance per IES TM-21-11

L90(10.5k) >63,500 h
 L80(10.5k) >63,500 h
 L70(10.5k) >63,500 h
 CIE correlated color temperature 5700 K
 Color Rendering Index (CRI), typical 75
 Color Rendering Index (CRI), minimum 70
 Lumens¹ 46,500

Footnotes:

1) Incorporates appropriate dirt depreciation factor for life of luminaire.

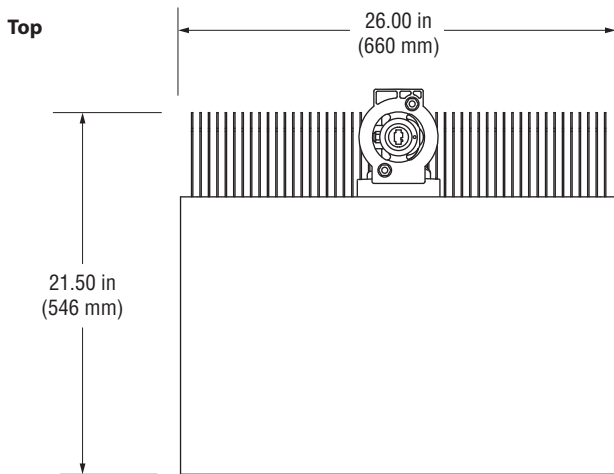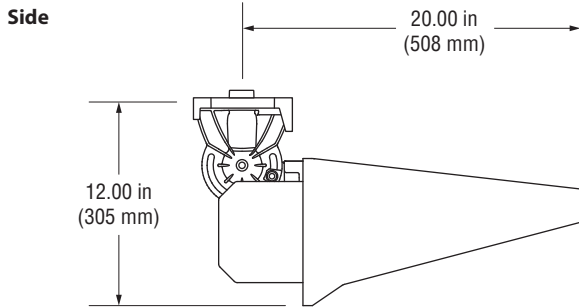



WST LED

Architectural Wall Sconce



Catalog Number
Notes
Type

Hit the Tab key or mouse over the page to see all interactive elements.

A+ Capable Luminaire

This item is an A+ capable luminaire, which has been designed and tested to provide consistent color appearance and system-level interoperability.

- All configurations of this luminaire meet the Acuity Brands' specification for chromatic consistency
- This luminaire is A+ Certified when ordered with DTL® controls marked by a **shaded background**. DTL DLL equipped luminaires meet the A+ specification for luminaire to photocontrol interoperability¹
- This luminaire is part of an A+ Certified solution for ROAM® or XPoint™ Wireless control networks, providing out-of-the-box control compatibility with simple commissioning, when ordered with drivers and control options marked by a **shaded background**¹

To learn more about A+, visit www.acuitybrands.com/aplus.


See ordering tree for details.

A+ Certified Solutions for ROAM require the order of one ROAM node per luminaire. Sold Separately: [Link to Roam](#); [Link to DTL DLL](#)

Specifications


Luminaire

- Height:** 8-1/2"
(21.59 cm)
- Width:** 17"
(43.18 cm)
- Depth:** 10-3/16"
(25.9 cm)
- Weight:** 20 lbs
(9.1 kg)

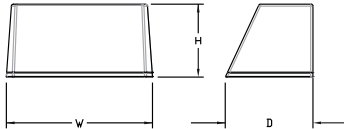


Optional Back Box (PBBW)

- Height:** 8.49"
(21.56 cm)
- Width:** 17.01"
(43.21 cm)
- Depth:** 1.70"
(4.32 cm)

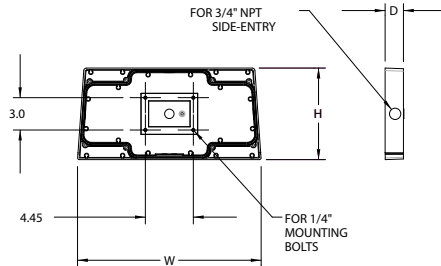

Optional Back Box (BBW)

- Height:** 4"
(10.2 cm)
- Width:** 5-1/2"
(14.0 cm)
- Depth:** 1-1/2"
(3.8 cm)

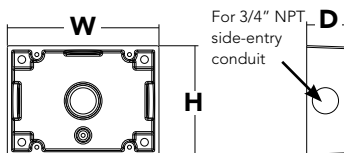

Performance Data

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-40°C (32-104°F).

Ambient		Lumen Multiplier
0°C	32°F	1.03
10°C	50°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
40°C	104°F	0.98

Electrical Load

Performance package	System Watts	Current (A)					
		120	208	240	277	347	480
P1	11	0.1	0.06	0.05	0.04	---	---
	14	---	---	---	---	0.04	0.03
P1 DS	14	0.12	0.07	0.06	0.06	---	---
P2	25	0.21	0.13	0.11	0.1	---	---
	30	---	---	---	---	0.09	0.06
P2 DS	25	0.21	0.13	0.11	0.1	---	---
P3	50	0.42	0.24	0.21	0.19	---	---
	56	---	---	---	---	0.16	0.12
P3 DS	52	0.43	0.26	0.23	0.21	---	---

Projected LED Lumen Maintenance

Values calculated according to IESNA TM-21-11 methodology and valid up to 40°C.

Operating Hours	0	25,000	50,000	100,000
Lumen Maintenance Factor	1.0	>0.95	>0.92	>0.87

Motion Sensor Default Settings

Option	Dimmed State	High Level (when triggered)	Photocell Operation	Ramp-up Time	Dwell Time	Ramp-down Time
*PIR or PIRH	3V (37%) Output	10V (100%) Output	Enabled @ 5FC	3 sec	5 min	5 min
PIR1FC3V or PIRH1FC3V	3V (37%) Output	10V (100%) Output	Enabled @ 1FC	3 sec	5 min	5 min

*for use with site wide Dusk to Dawn control

PER Table

Control	PER (3 wire)	PER5 (5 wire)			PER7 (7 wire)		
			Wire 4/Wire5		Wire 4/Wire5	Wire 6/Wire7	
Photocontrol Only (On/Off)	✓	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM	⊘	✓	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
ROAM with Motion	⊘	⚠	Wired to dimming leads on driver	⚠	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof*	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	
Futureproof* with Motion	⊘	⚠	Wired to dimming leads on driver	✓	Wired to dimming leads on driver	Wires Capped inside fixture	

✓ Recommended

⊘ Will not work

⚠ Alternate

*Futureproof means: Ability to change controls in the future.



Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts.


Performance Package	System Watts (MVOLT*)	Dist. Type	27K (2700K, 70 CRI)					30K (3000K, 70 CRI)					40K (4000K, 70 CRI)					50K (5000K, 70 CRI)				
			Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW	Lumens	B	U	G	LPW
P1	12W	VF	1,494	0	0	0	125	1,529	0	0	0	127	1,639	0	0	0	137	1,639	0	0	0	137
		VW	1,513	0	0	0	126	1,548	0	0	0	129	1,659	0	0	0	138	1,660	0	0	0	138
P2	25W	VF	3,163	1	0	1	127	3,237	1	0	1	129	3,469	1	0	1	139	3,468	1	0	1	139
		VW	3,201	1	0	0	128	3,276	1	0	0	131	3,512	1	0	0	140	3,512	1	0	0	140
P3	50W	VF	6,025	1	0	1	121	6,165	1	0	1	123	6,609	1	0	1	132	6,607	1	0	1	132
		VW	6,098	1	0	1	122	6,240	1	0	1	125	6,689	1	0	1	134	6,691	1	0	1	134



Isofootcandle plots for the WST LED P3 40K VF and VW. Distances are in units of mounting height (10').

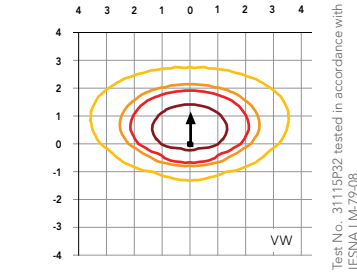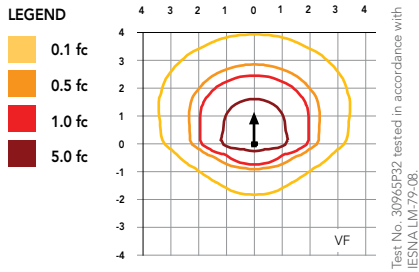

Distribution overlay comparison to 175W metal halide.

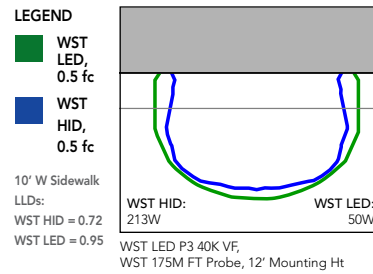

FEATURES & SPECIFICATIONS

INTENDED USE

The classic architectural shape of the WST LED was designed for applications such as hospitals, schools, malls, restaurants, and commercial buildings. The long life LEDs and driver make this luminaire nearly maintenance-free.

CONSTRUCTION

The single-piece die-cast aluminum housing integrates secondary heat sinks to optimize thermal transfer from the internal light engine heat sinks and promote long life. The driver is mounted in direct contact with the casting for a low operating temperature and long life. The die-cast door frame is fully gasketed with a one-piece solid silicone gasket to keep out moisture and dust, providing an IP65 rating for the luminaire.

FINISH

Exterior parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a minimum 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Standard Super Durable colors include dark bronze, black, natural aluminum, sandstone and white. Available in textured and non-textured finishes.

OPTICS

Well crafted reflector optics allow the light engine to be recessed within the luminaire, providing visual comfort, superior distribution, uniformity, and spacing in wall-mount applications. The WST LED has zero uplight and qualifies as a Nighttime Friendly™ product, meaning it is consistent with the LEED® and Green Globes™ criteria for eliminating wasteful uplight.

ELECTRICAL

Light engine(s) consist of 98 high-efficacy LEDs mounted to a metal core circuit board and integral aluminum heat sinks to maximize heat dissipation and promote long life (100,000 hrs at 40°C, L87). Class 2 electronic driver has a power factor >90%, THD <20%. Easily-serviceable surge protection device meets a minimum Category B (per ANSI/IEEE C62.41.2).

INSTALLATION

A universal mounting plate with integral mounting support arms allows the fixture to hinge down for easy access while making wiring connections.

LISTINGS

CSA certified to U.S. and Canadian standards. Luminaire is IP65 rated. PIR and back box options are rated for wet location. Rated for -30°C to 40°C ambient.

DesignLights Consortium® (DLC) Premium qualified product. Not all versions of this product may be DLC Premium qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.

BUY AMERICAN

Product with the BAA option is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT. Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY

5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.





August 31, 2022

TO: Robert Howman
4500 Fuller Drive
Suite 220
Irving, TX 75038

CC: Will Salee
1191 T.L. Townsend Drive
Rockwall, TX 75087

FROM: Bethany Ross
City of Rockwall Planning and Zoning Department
385 S. Goliad Street
Rockwall, TX 75087

SUBJECT: MIS2022-019; *Exceptions and a Variance Related to a Public Secondary School*

Robert:

This letter serves to notify you that the above referenced case (*i.e. Miscellaneous Case*) that you submitted for consideration by the City of Rockwall was approved by the Planning and Zoning Commission on August 30, 2022. The following is a record of all recommendations, voting records and conditions of approval:

Staff Recommendations

- (1) Any construction resulting from the approval of this Miscellaneous Case shall conform to the requirements set forth by the Unified Development Code (UDC), the International Building Code (IBC), the Rockwall Municipal Code of Ordinances, city adopted engineering and fire codes and with all other applicable regulatory requirements administered and/or enforced by the state and federal government.

Planning and Zoning Commission

On August 30, 2022, the Planning and Zoning Commission approved a motion to recommend approval of the miscellaneous case by a vote of 5-0, with Commissioners Conway and Womble absent.

Should you have any questions or concerns regarding your case, please feel free to contact me a (972) 772-6488.

Sincerely,

A handwritten signature in purple ink that reads "Bethany Ross".

Bethany Ross, *Planner*
City of Rockwall Planning and Zoning Department